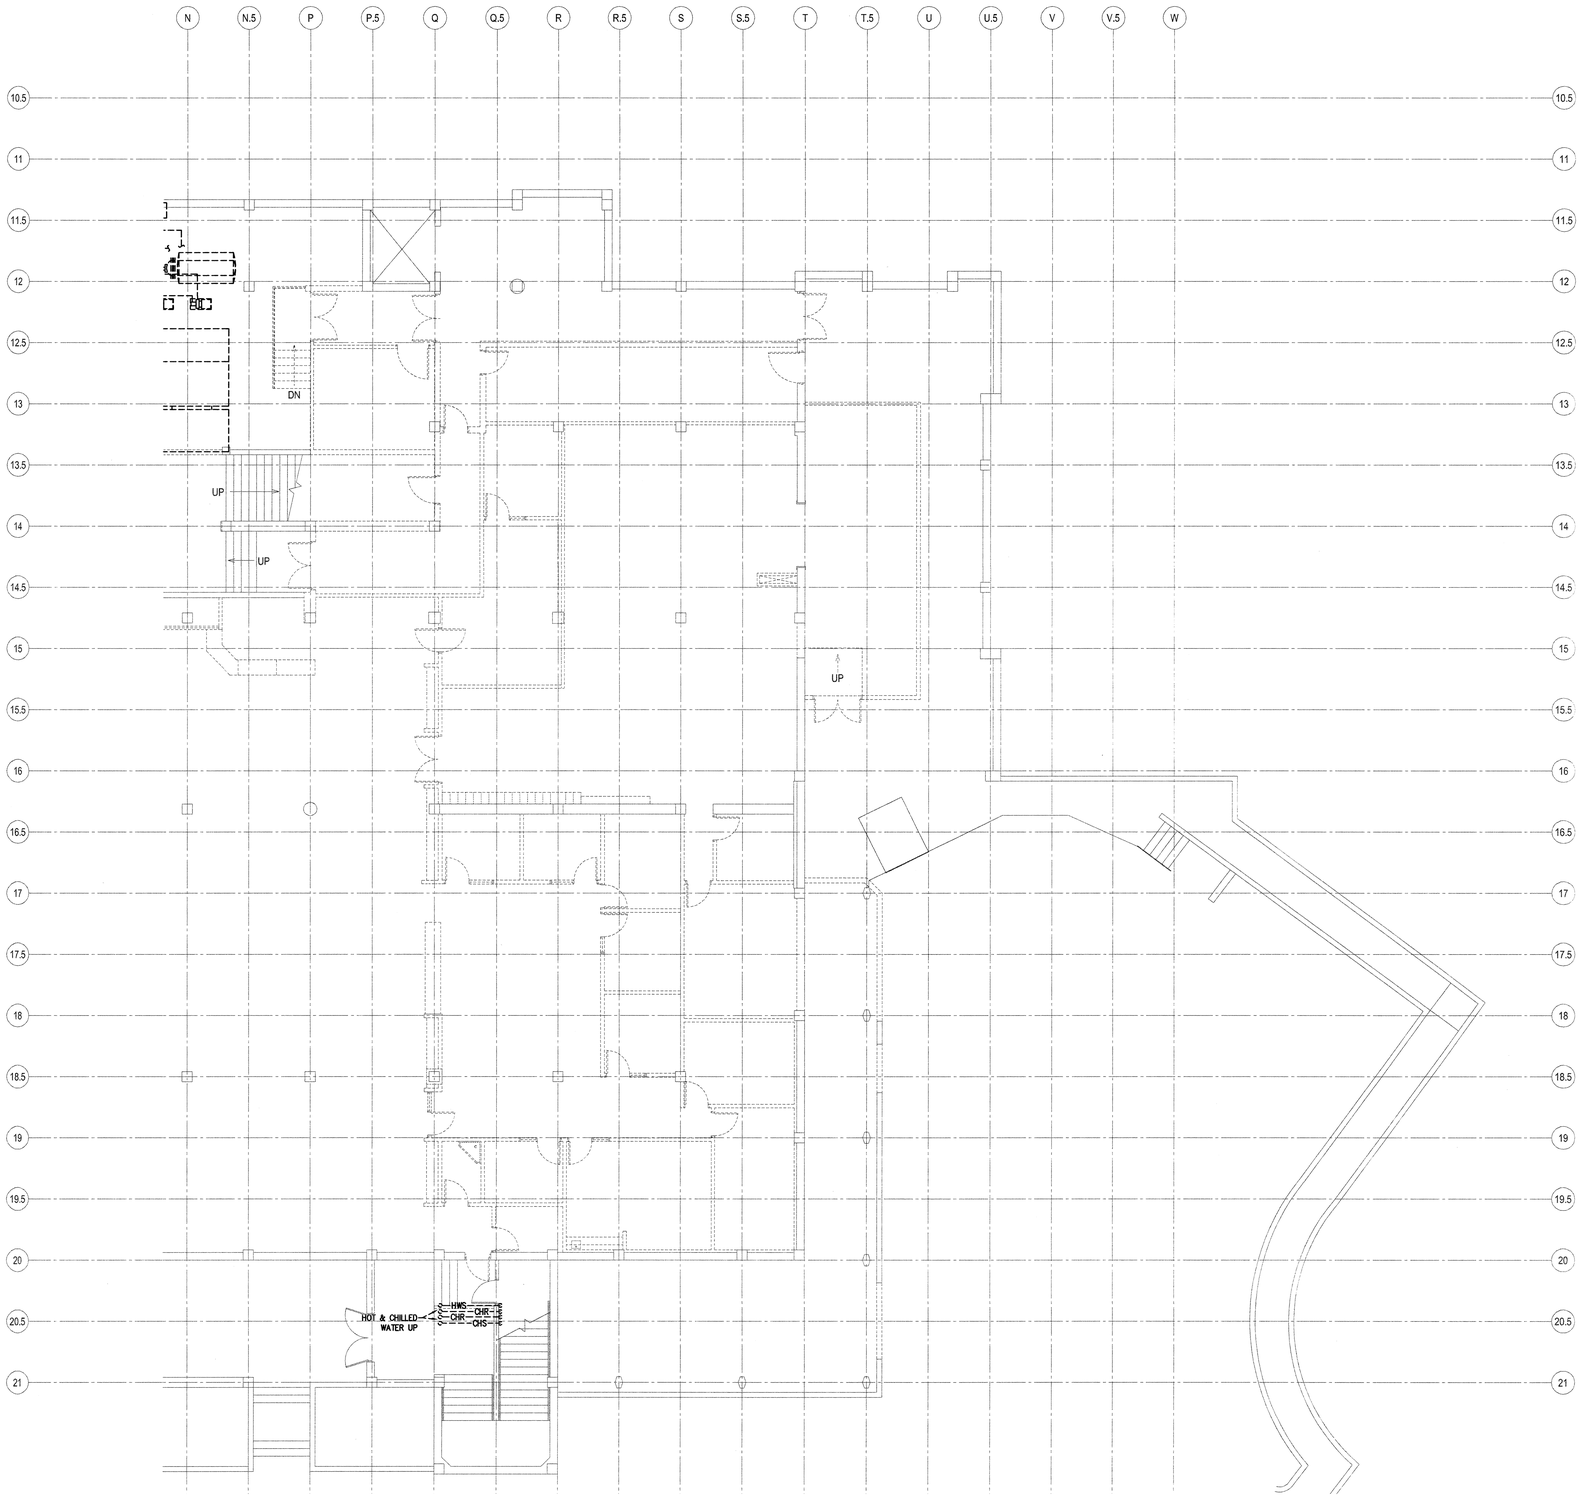

1 FIRST FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "A"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.

KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2418

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

FIRST FLOOR MECH. PIPING DEMO. PLAN AREA "A"
BID PACKAGE #1: DEMOLITION & ABATEMENT

SHEET NUMBER

DMP101.A

Copyright (C) 2005 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

Reproducible Set: X, 32X2, 1:1Trim
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP101.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP101.A.dwg, 2/14/2006 4:11:10 PM, groberts, 1:1

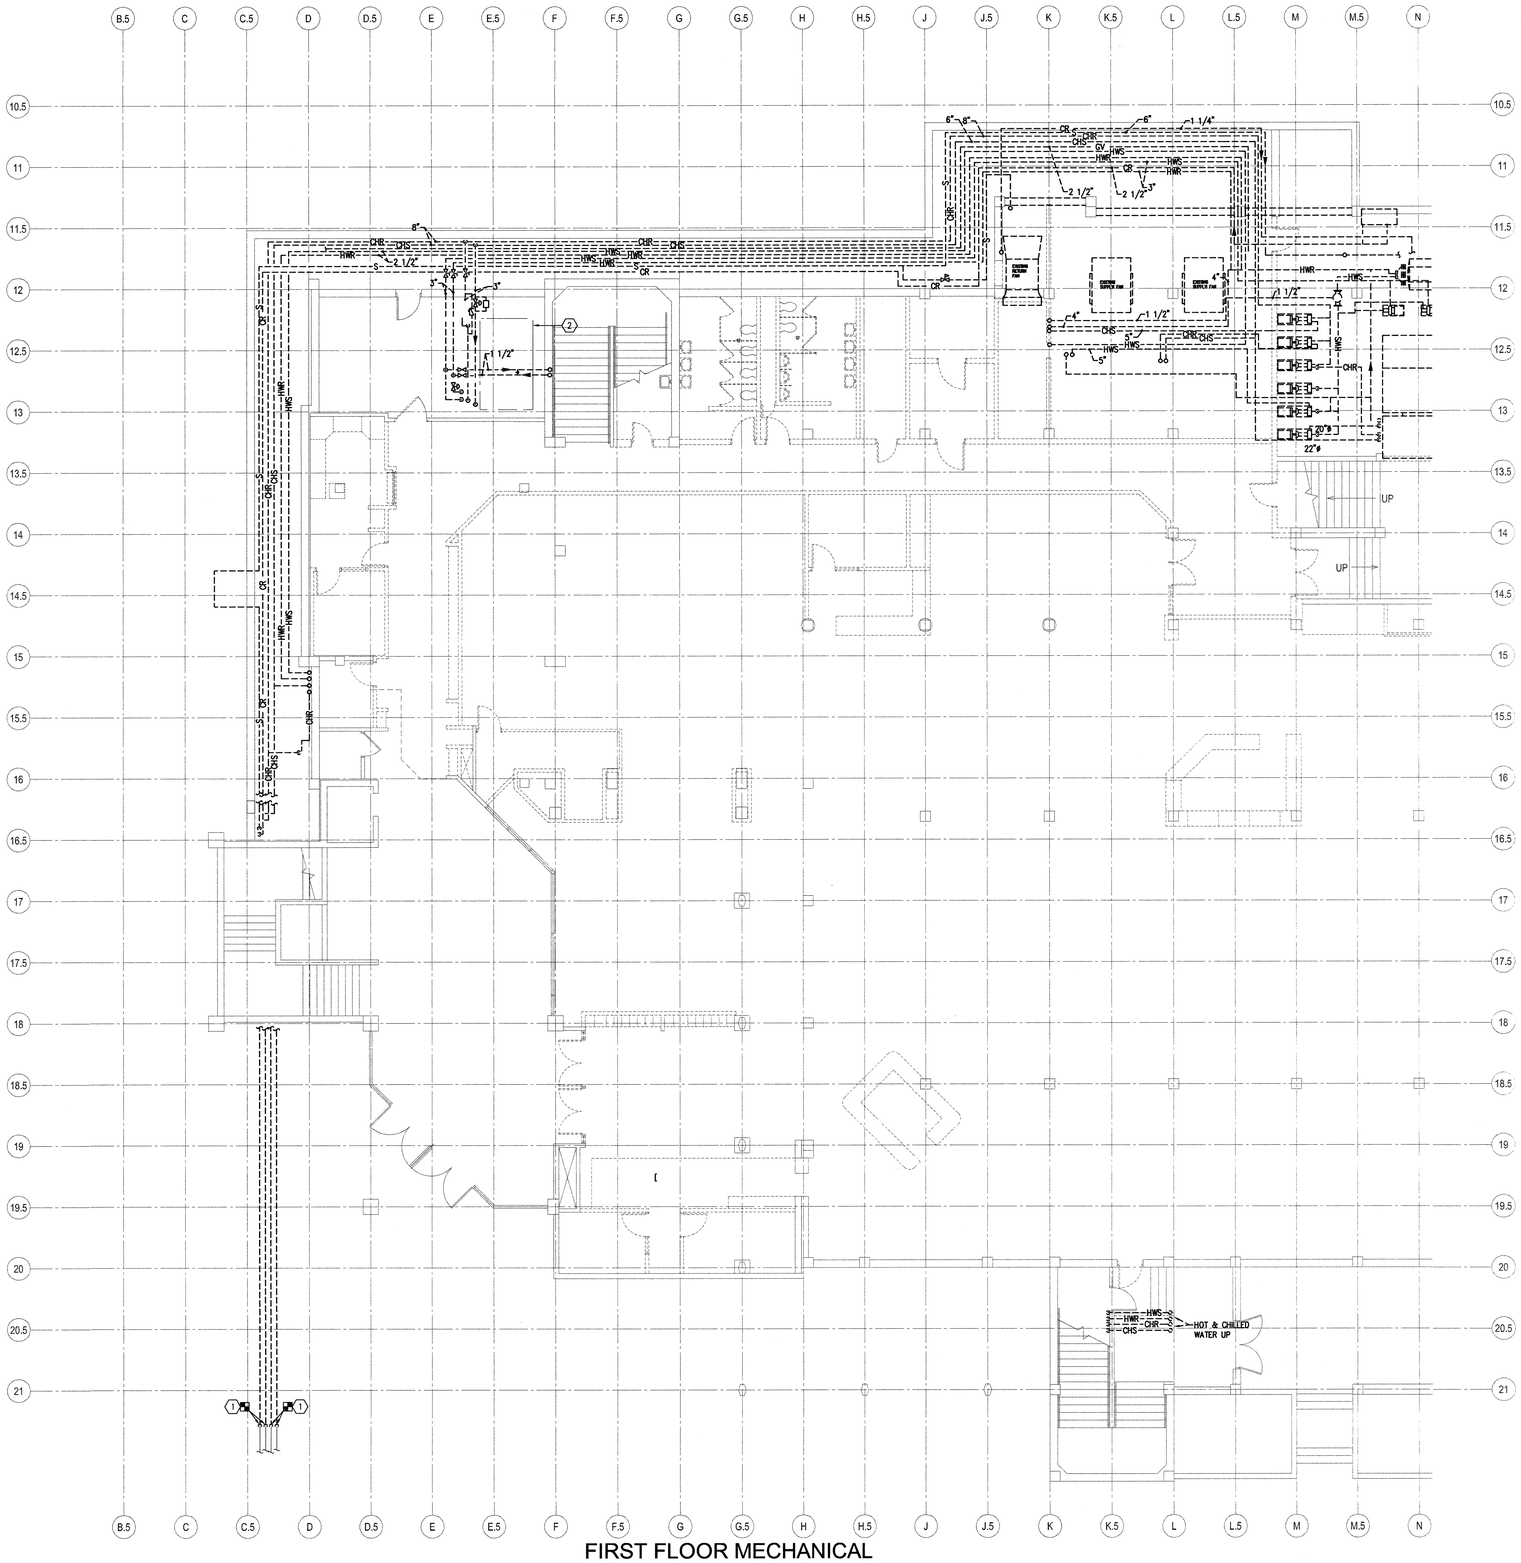

FIRST FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "B"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE STEAM, CONDENSATE, CHILLED SUPPLY AND RETURN AND CHILLED RETURN PIPING IN TUNNEL BACK TO MAINS APPROXIMATELY 50 FEET ADDITIONAL, NOT SHOWN. COORDINATE WITH WEBER STATE UNIVERSITY AND CONSTRUCTION MANAGER TO PROVIDE NEW CAPS AT TIME OF REMOVAL.
2. AIR HANDLER TO REMAIN.

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.K. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

FIRST FLOOR MECH. PIPING DEMO. PLAN AREA "B"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP101.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts, Feb 14, 2006 - 4:10pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP101.B.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP101.B.dwg, 2/14/2006 4:10:57 PM, groberts, 1:1

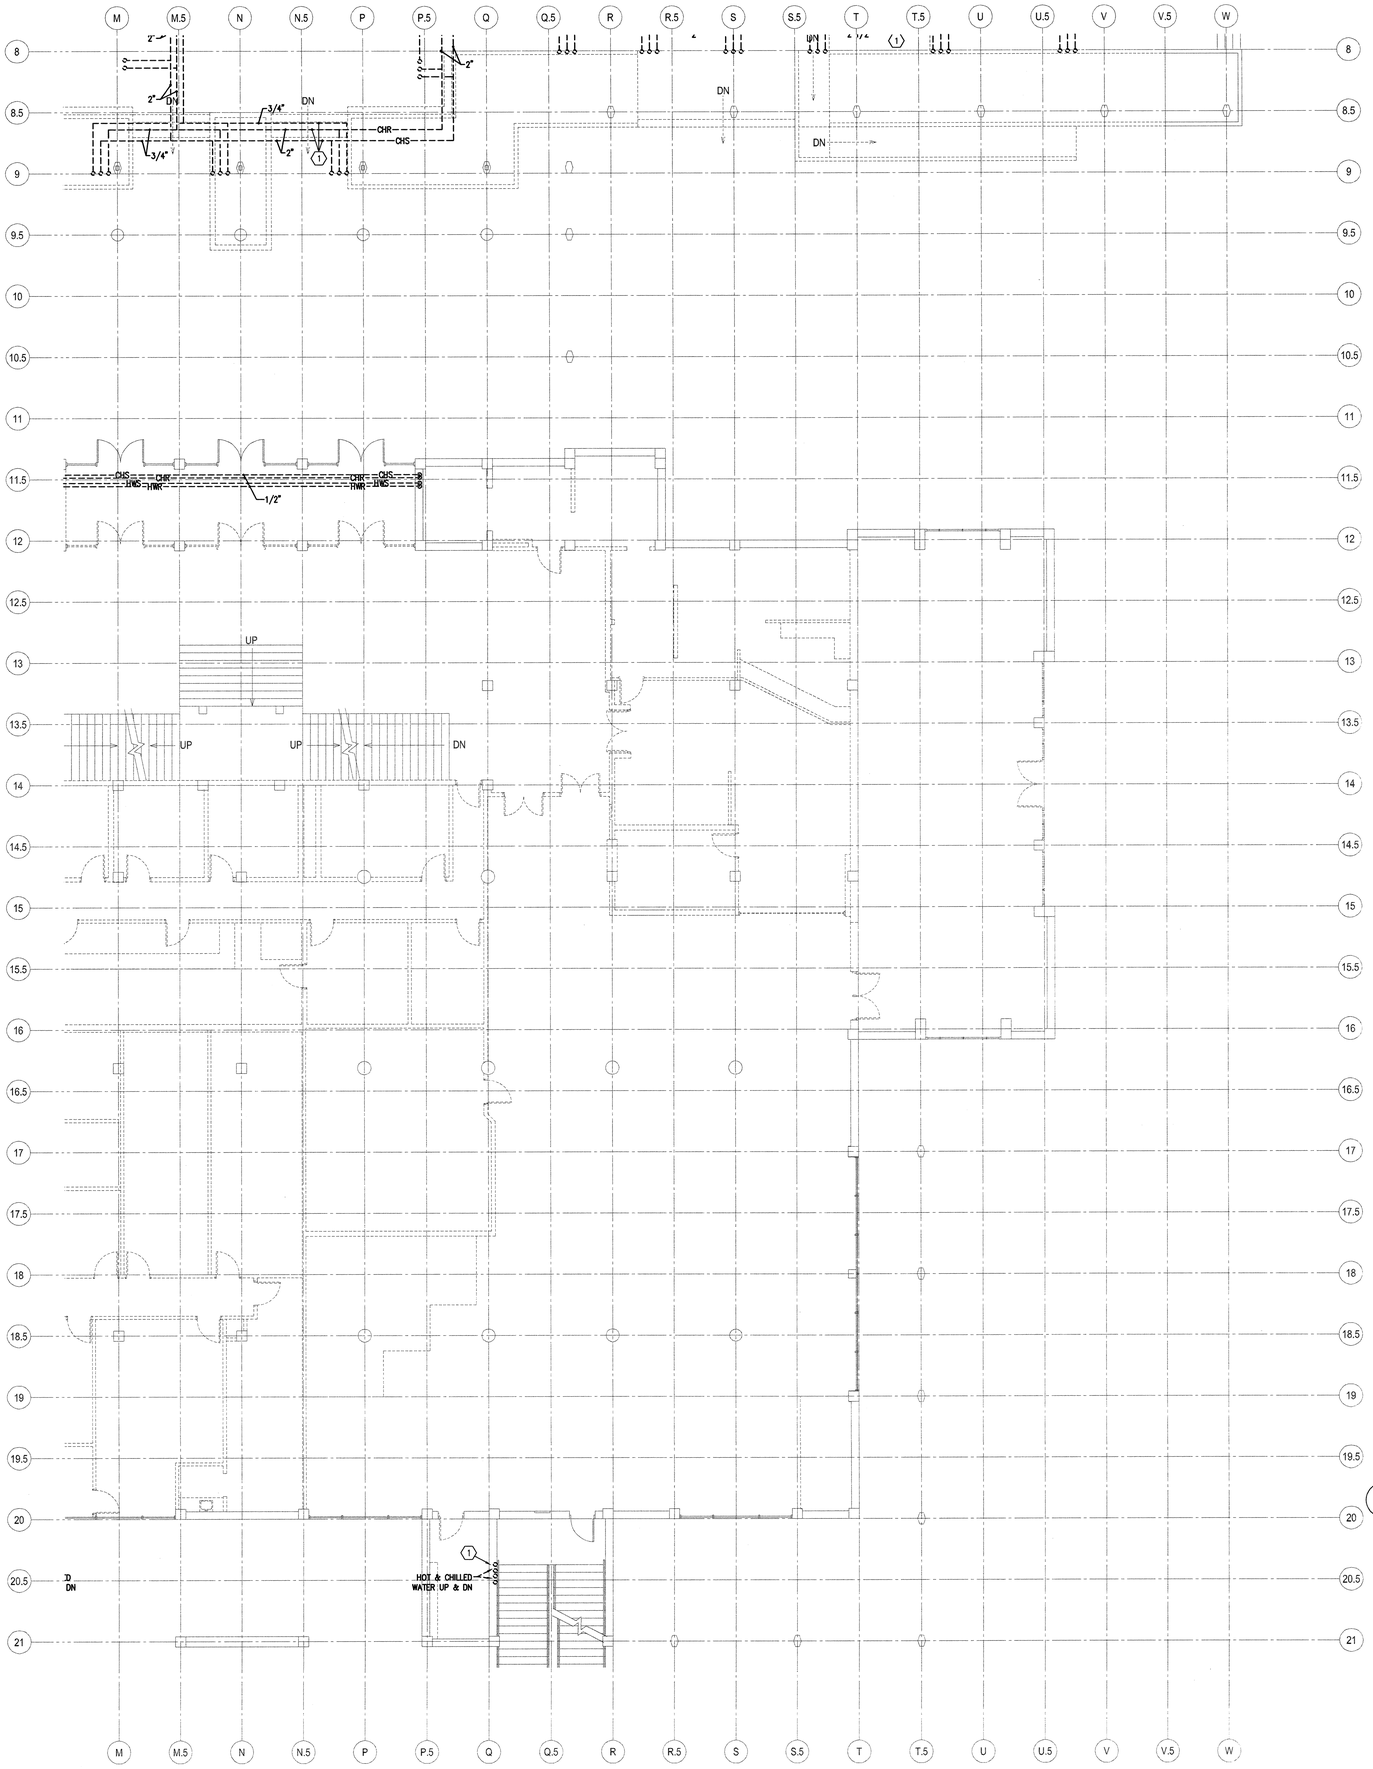

KEYED NOTES

1. REMOVE PIPING THROUGHOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.

1 SECOND FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "A"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF
FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR MECH. PIPING DEMO. PLAN AREA "A"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP102.A

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By:groberts Feb 14, 2006 - 4:10pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.A.dwg, 2/14/2006 4:10:31 PM, groberts, 1:1

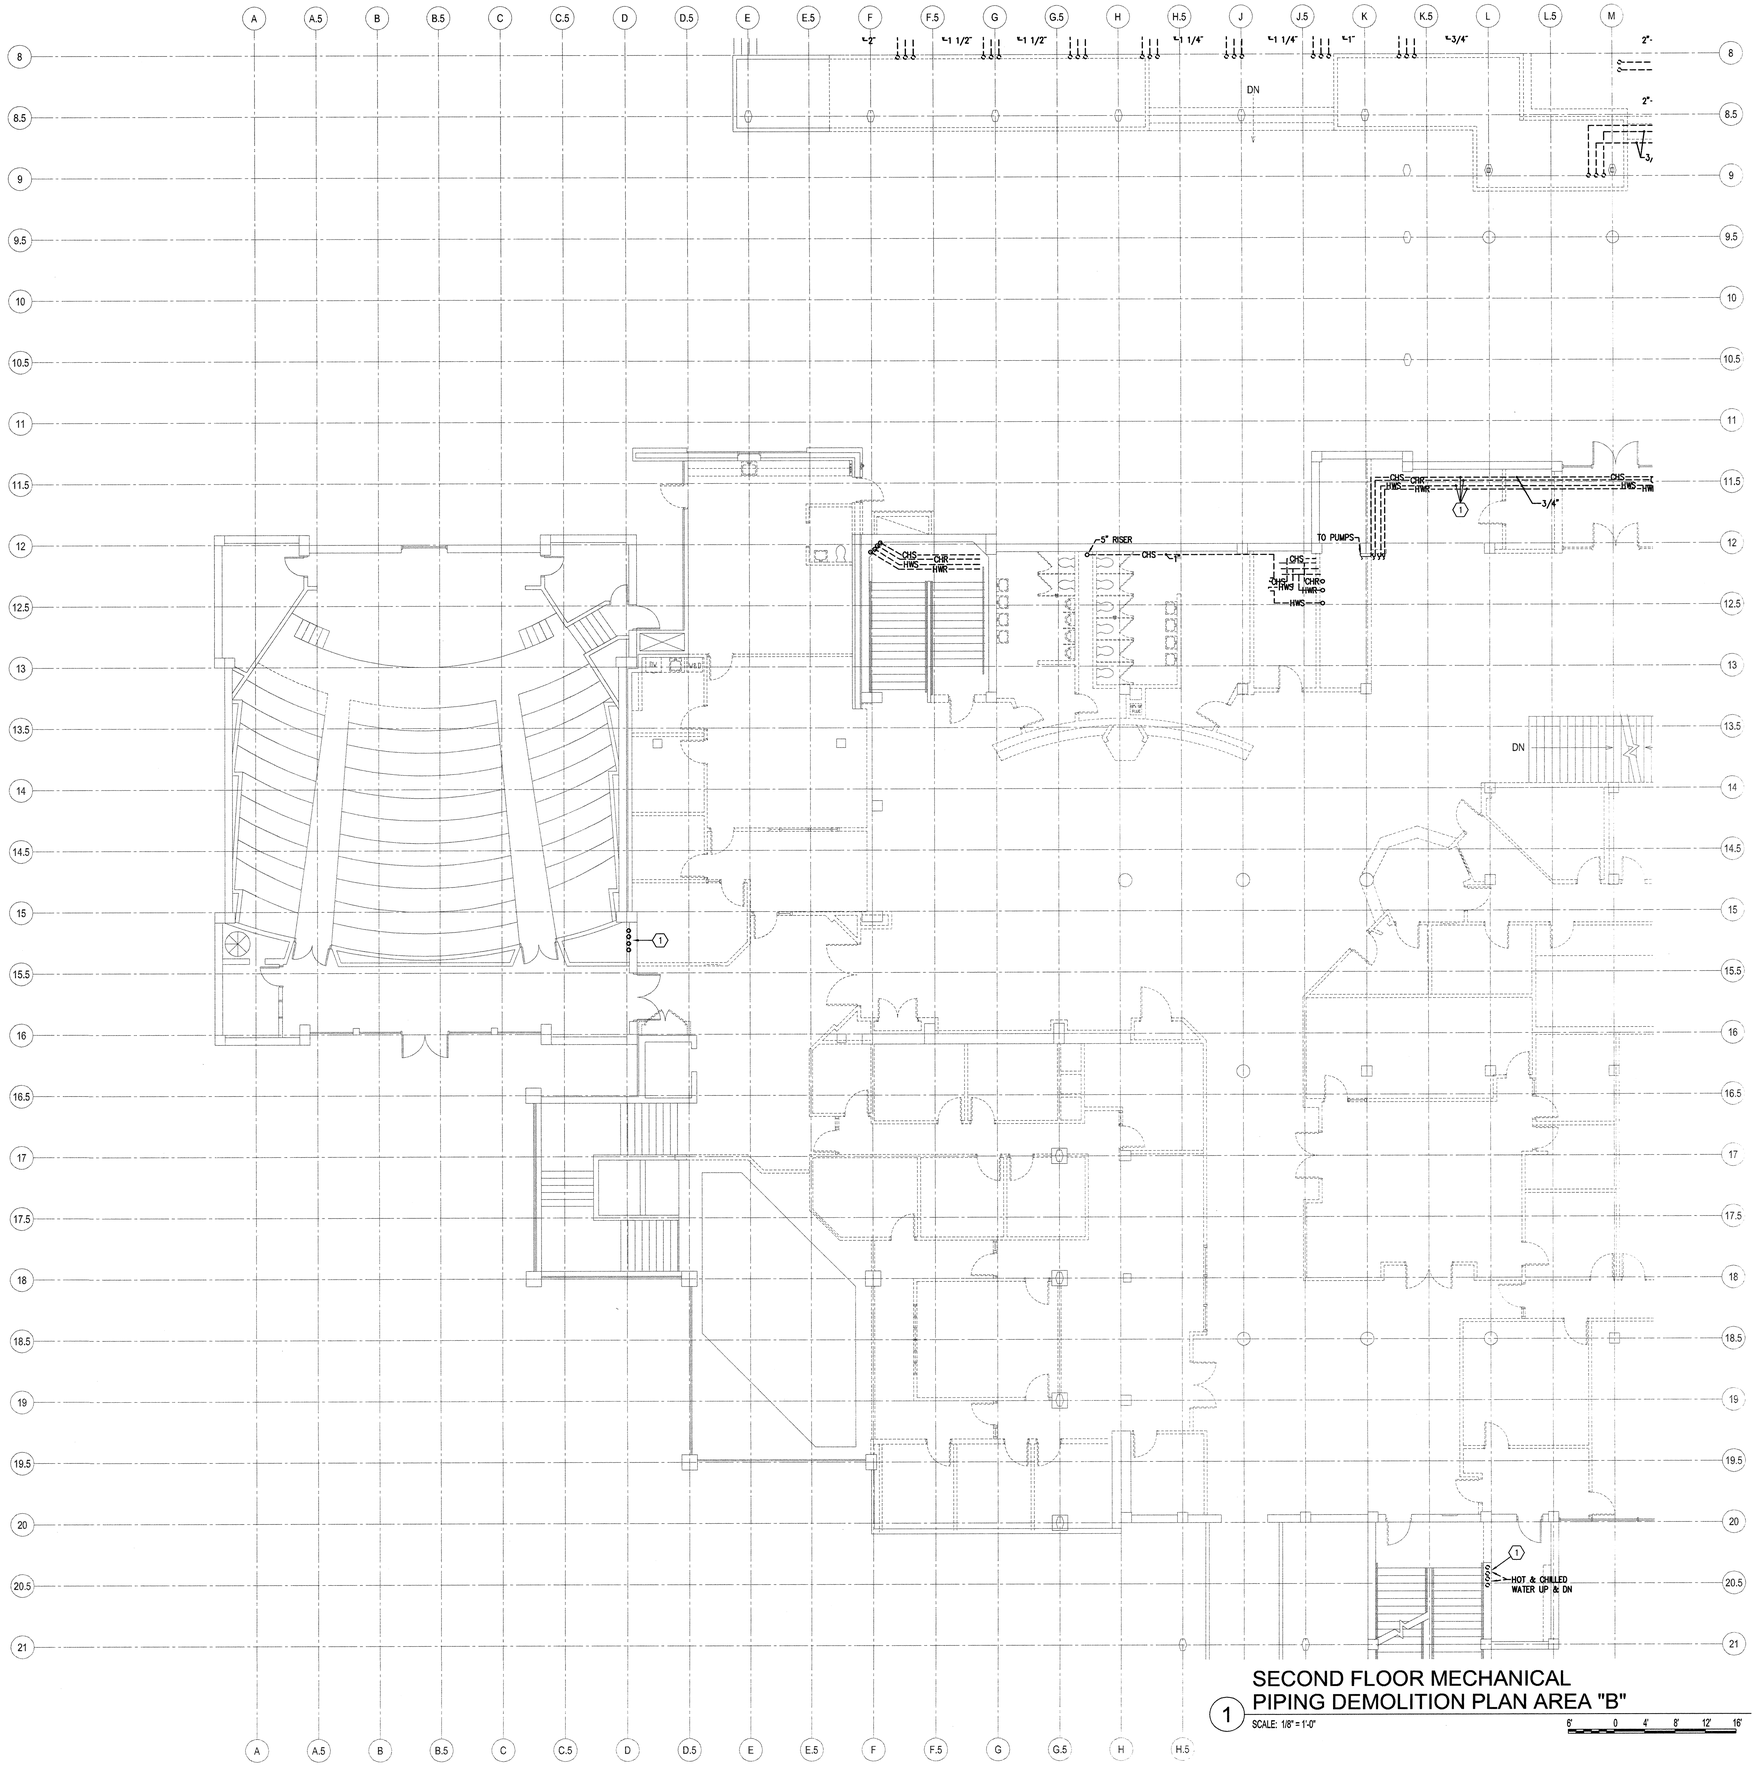

SECOND FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "B"

1 SCALE: 1/8" = 1'-0"

KEYED NOTES

1. REMOVE PIPING THROUGHTOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005566.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR MECH. PIPING DEMO. PLAN AREA "B"
BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP102.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts, Feb 14, 2006 - 4:10pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.B.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.B.dwg, 2/14/2006 4:10:19 PM, groberts, 1:1

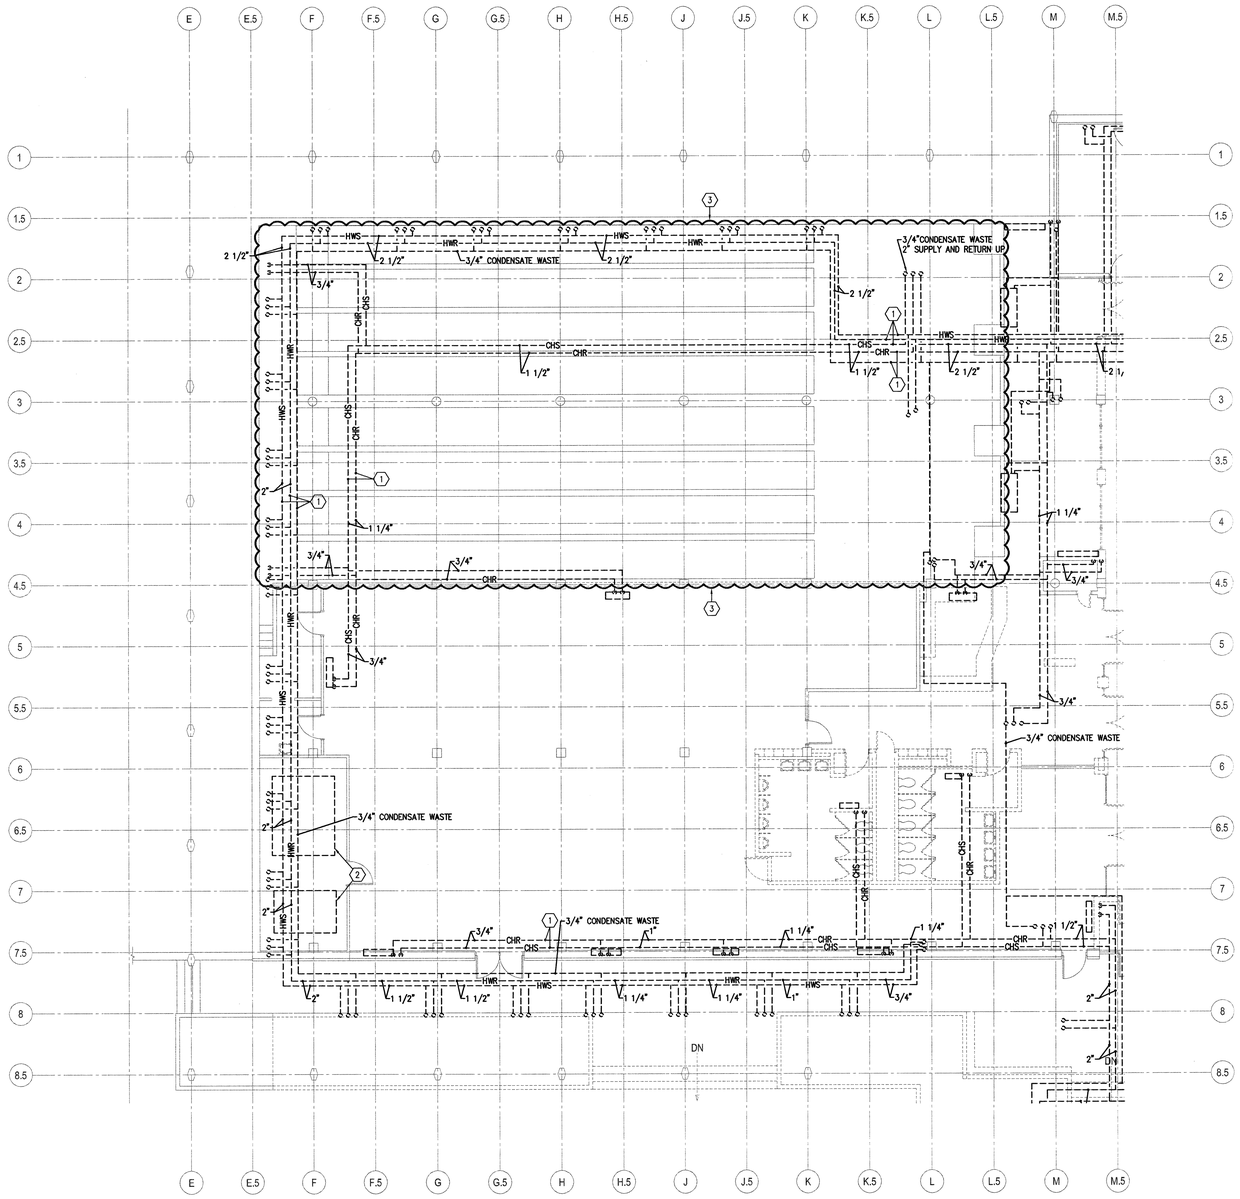

1 SECOND FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "C"

SCALE: 1/8" = 1'-0"

KEYED NOTES

1. REMOVE PIPING THROUGHOUT BUILDING (TYPICAL).
2. REMOVE ALL PIPING ASSOCIATED WITH AIR HANDLERS.
3. DEMOLISH AS FAR BACK AS POSSIBLE AND ABANDON PIPING IN PLACE IF CEILING IS TO REMAIN.

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION
△		
△		
△		
△		
△		
△		
△		

SECOND FLOOR MECH. PIPING DEMO. PLAN AREA "C"
BID PACKAGE #1: DEMOLITION & ABATEMENT

SHEET NUMBER

DMP102.C

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts; Feb 14, 2006 - 4:10pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.C.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.C.dwg, 2/14/2006 4:10:09 PM, groberts, 1:1

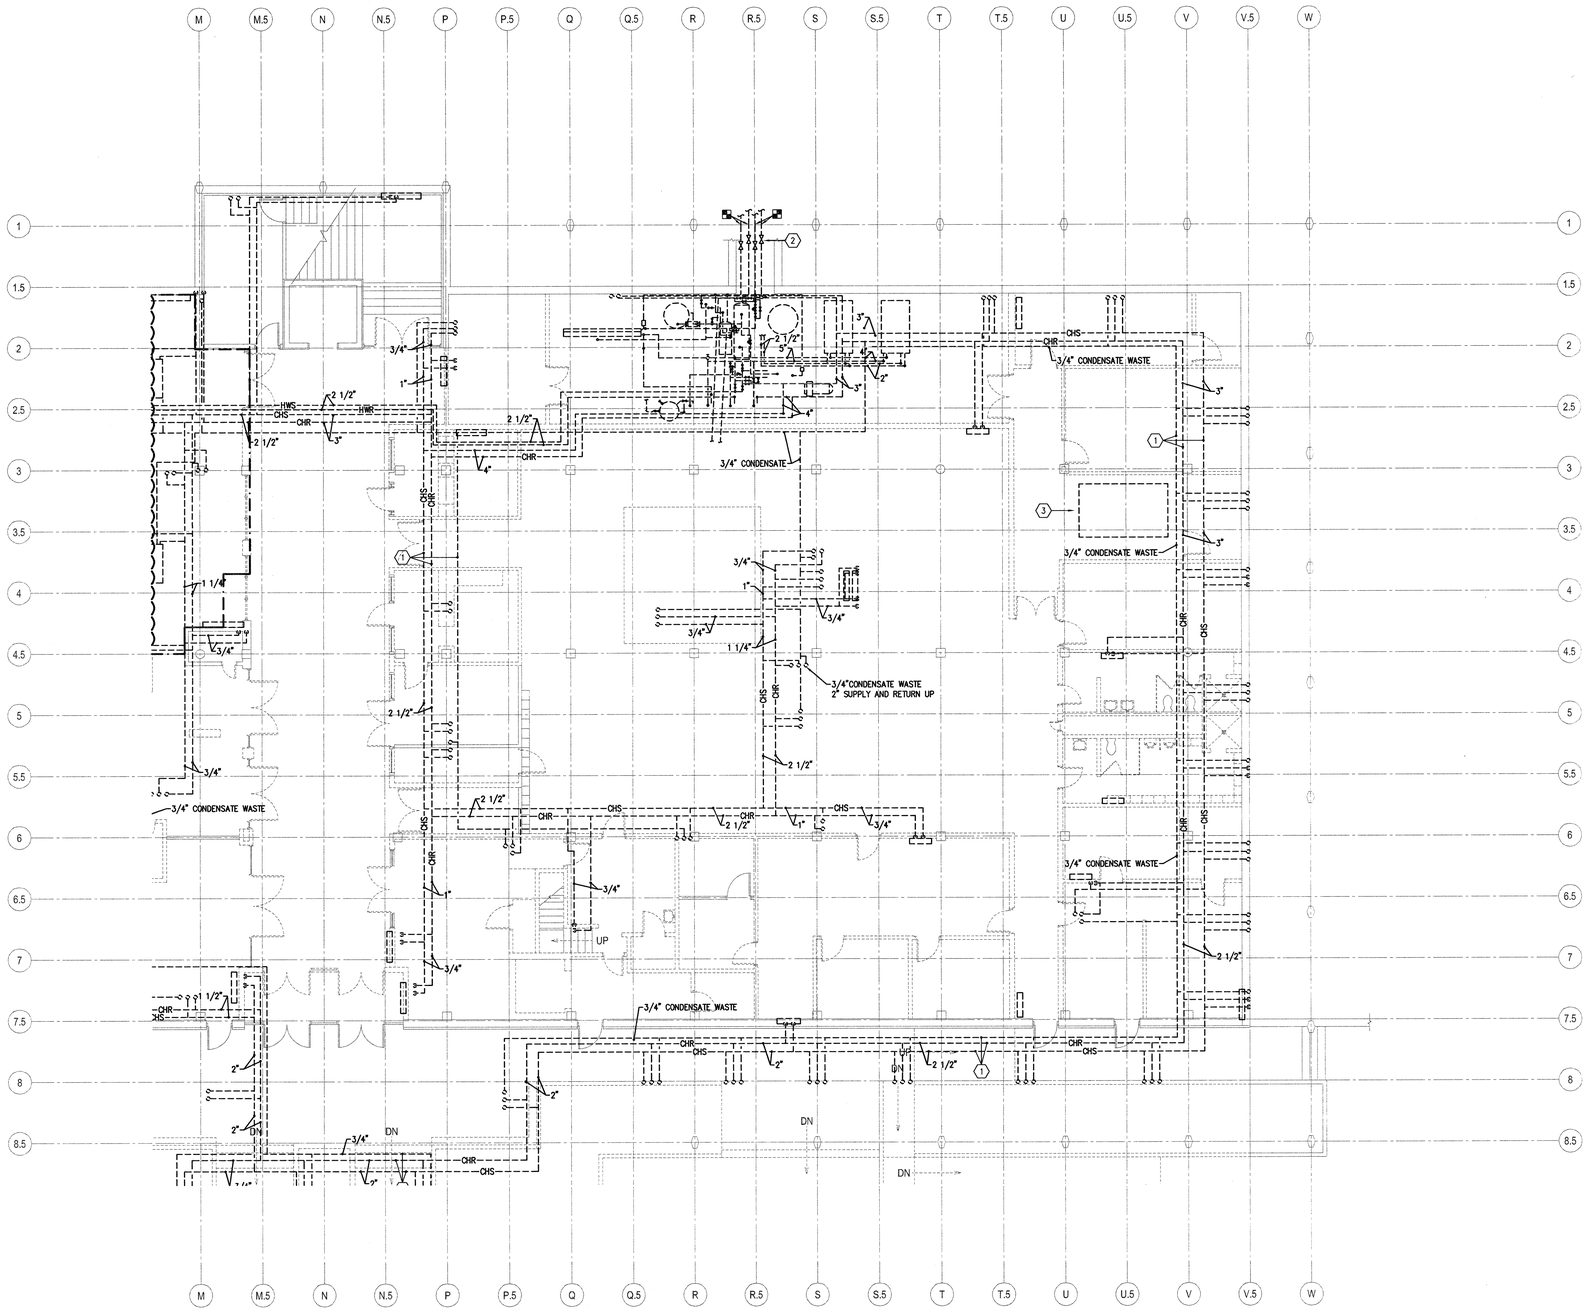

1 SECOND FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "D"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE PIPING THROUGHOUT BUILDING (TYPICAL).
2. REMOVE EXISTING STEAM, CONDENSATE, CHILLED WATER SUPPLY AND RETURN BACK INTO TUNNEL (APPROXIMATELY 30 FEET) PAST EXISTING SHUTOFF VALVES. COORDINATE WITH WEBER STATE UNIVERSITY AND CONSTRUCTION MANGER TO PROVIDE NEW SHUTOFF VALVES AT TIME OF REMOVAL.
3. REMOVE ALL PIPING ASSOCIATED WITH AIR HANDLER.

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
WEBER STATE UNIVERSITY OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO:	2005556.00
DFCM PROJECT NO:	03215810
DRAWN BY: G.R.	CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR MECH. PIPING DEMO. PLAN AREA "D"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP102.D

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts, Feb 14, 2006 - 4:06pm
I:\PROJECTS\2005\Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP102.D.dwg

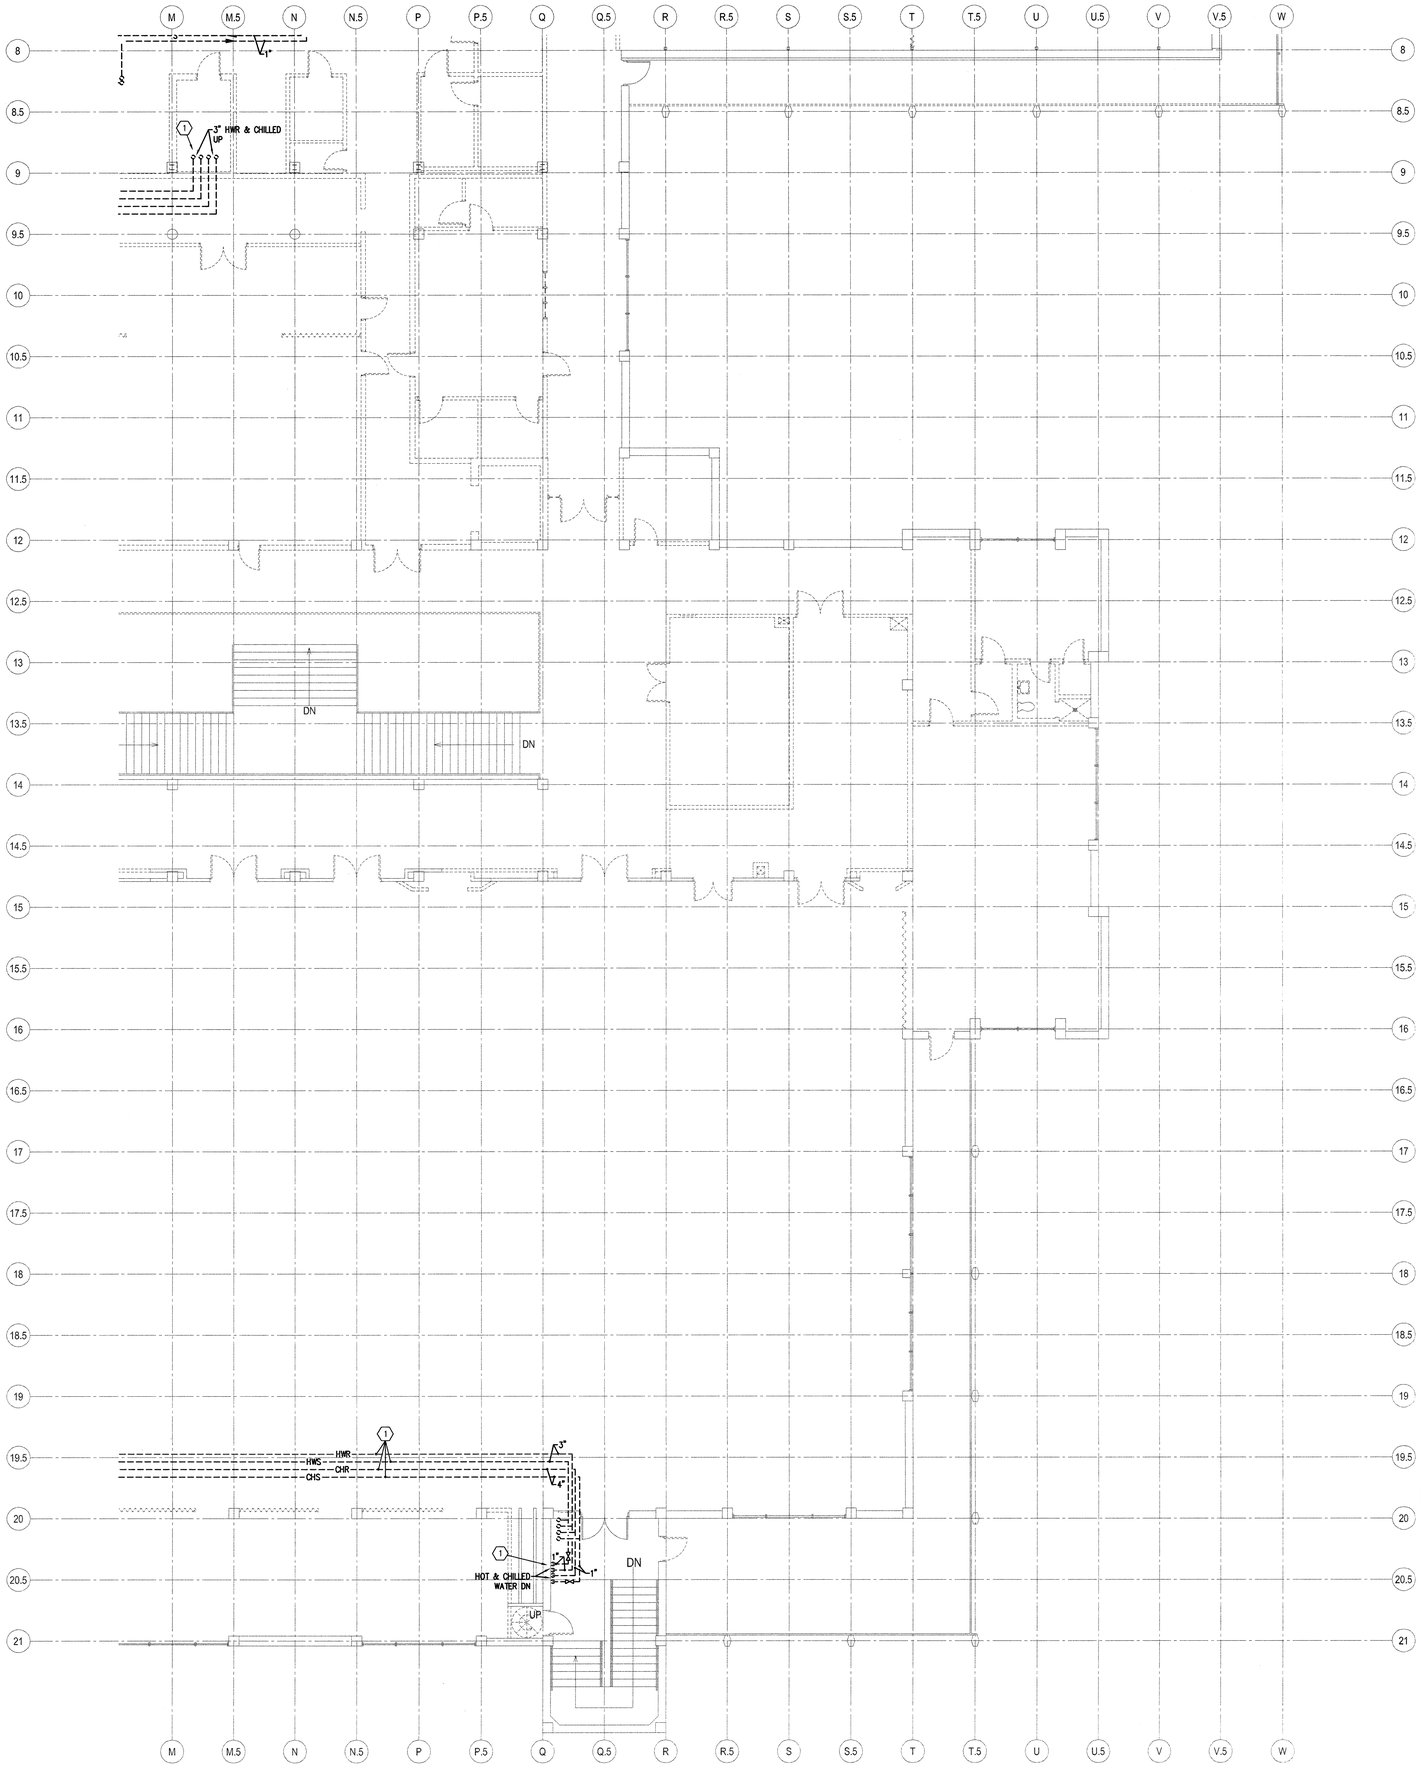

KEYED NOTES

1. REMOVE PIPING THROUGHTOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

1 THIRD FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "A"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

WEBER STATE UNIVERSITY

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR MECH. PIPING DEMO. PLAN AREA "A"
BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP103.A

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts, Feb 14, 2006 - 4:09pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.A.dwg, 2/14/2006 4:09:43 PM, groberts, 1:1

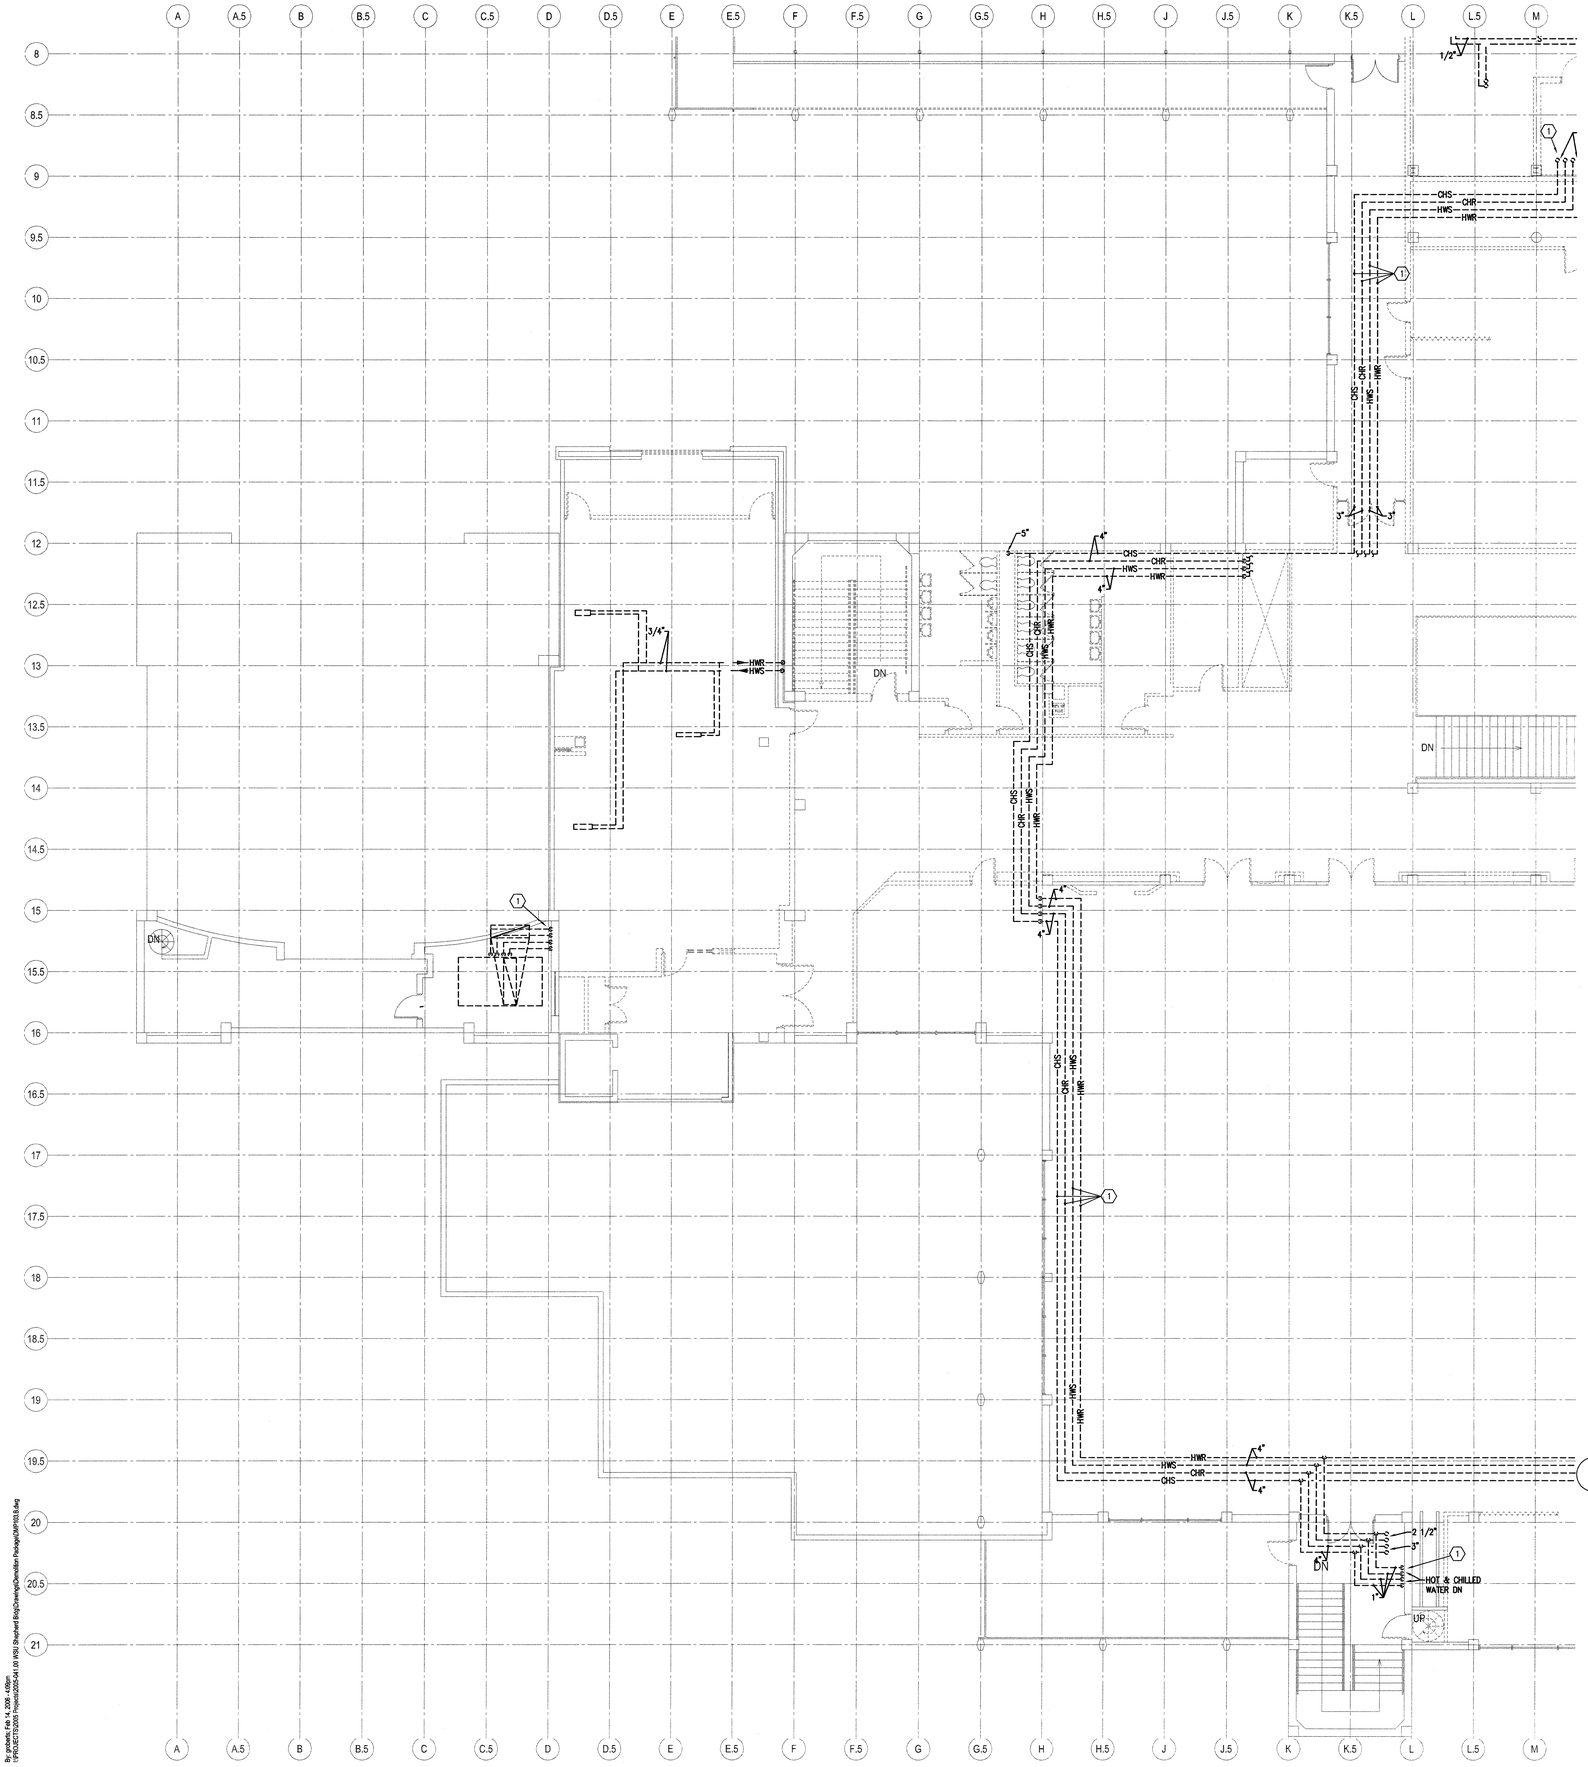

THIRD FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "B"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE PIPING THROUGHTOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
WEBER STATE UNIVERSITY OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR MECH. PIPING DEMO. PLAN AREA "B"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP103.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By:groberts Par:A.1,DDE,.100ev
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.B.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.B.dwg, 2/14/2006 4:09:31 PM, groberts, 1:1

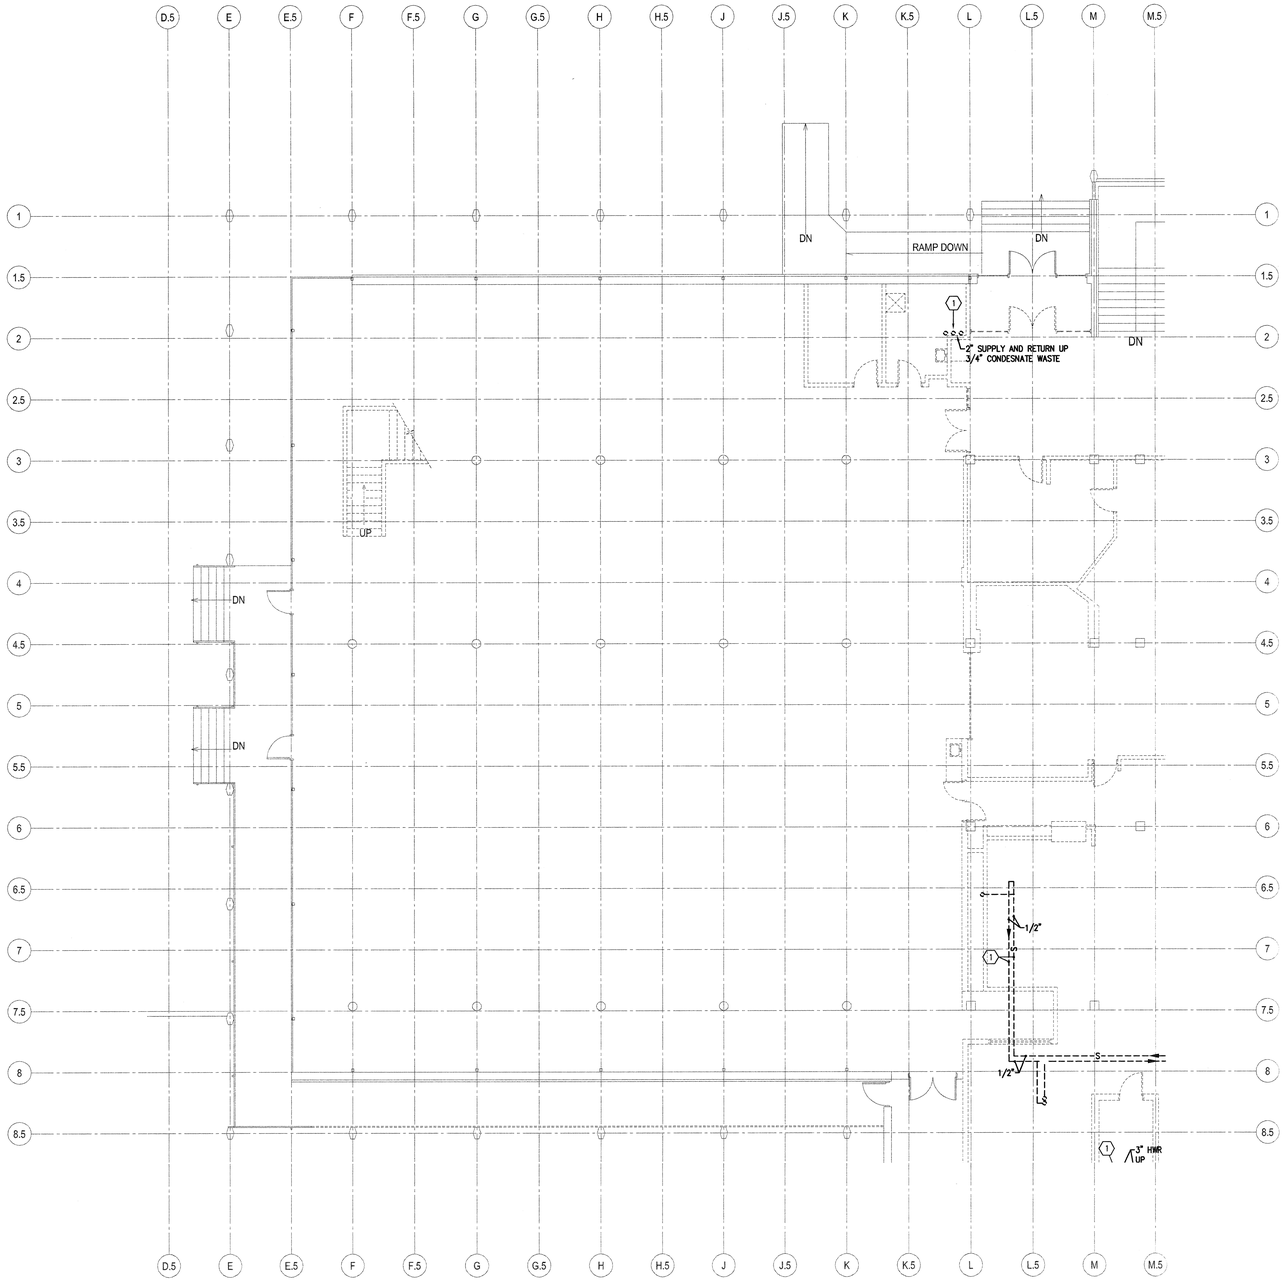

THIRD FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "C"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE PIPING THROUGHTOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 20055556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR MECH. PIPING DEMO. PLAN AREA "C"
BID PACKAGE #1: DEMOLITION & ABATEMENT

SHEET NUMBER

DMP103.C

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts, Feb 14, 2006 - 4:09pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.C.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.C.dwg, 2/14/2006 4:09:18 PM, groberts, 1:1

THIRD FLOOR MECHANICAL PIPING DEMOLITION PLAN AREA "D"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE PIPING THROUGHTOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.



KEY PLAN:

MHTN ARCHITECTS, INC
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR MECH. PIPING DEMO. PLAN AREA "D"
BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER:

DMP103.D

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts, Feb 14, 2006 - 4:08pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.D.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DMP103.D.dwg, 2/14/2006 4:08:54 PM, groberts, 1:1

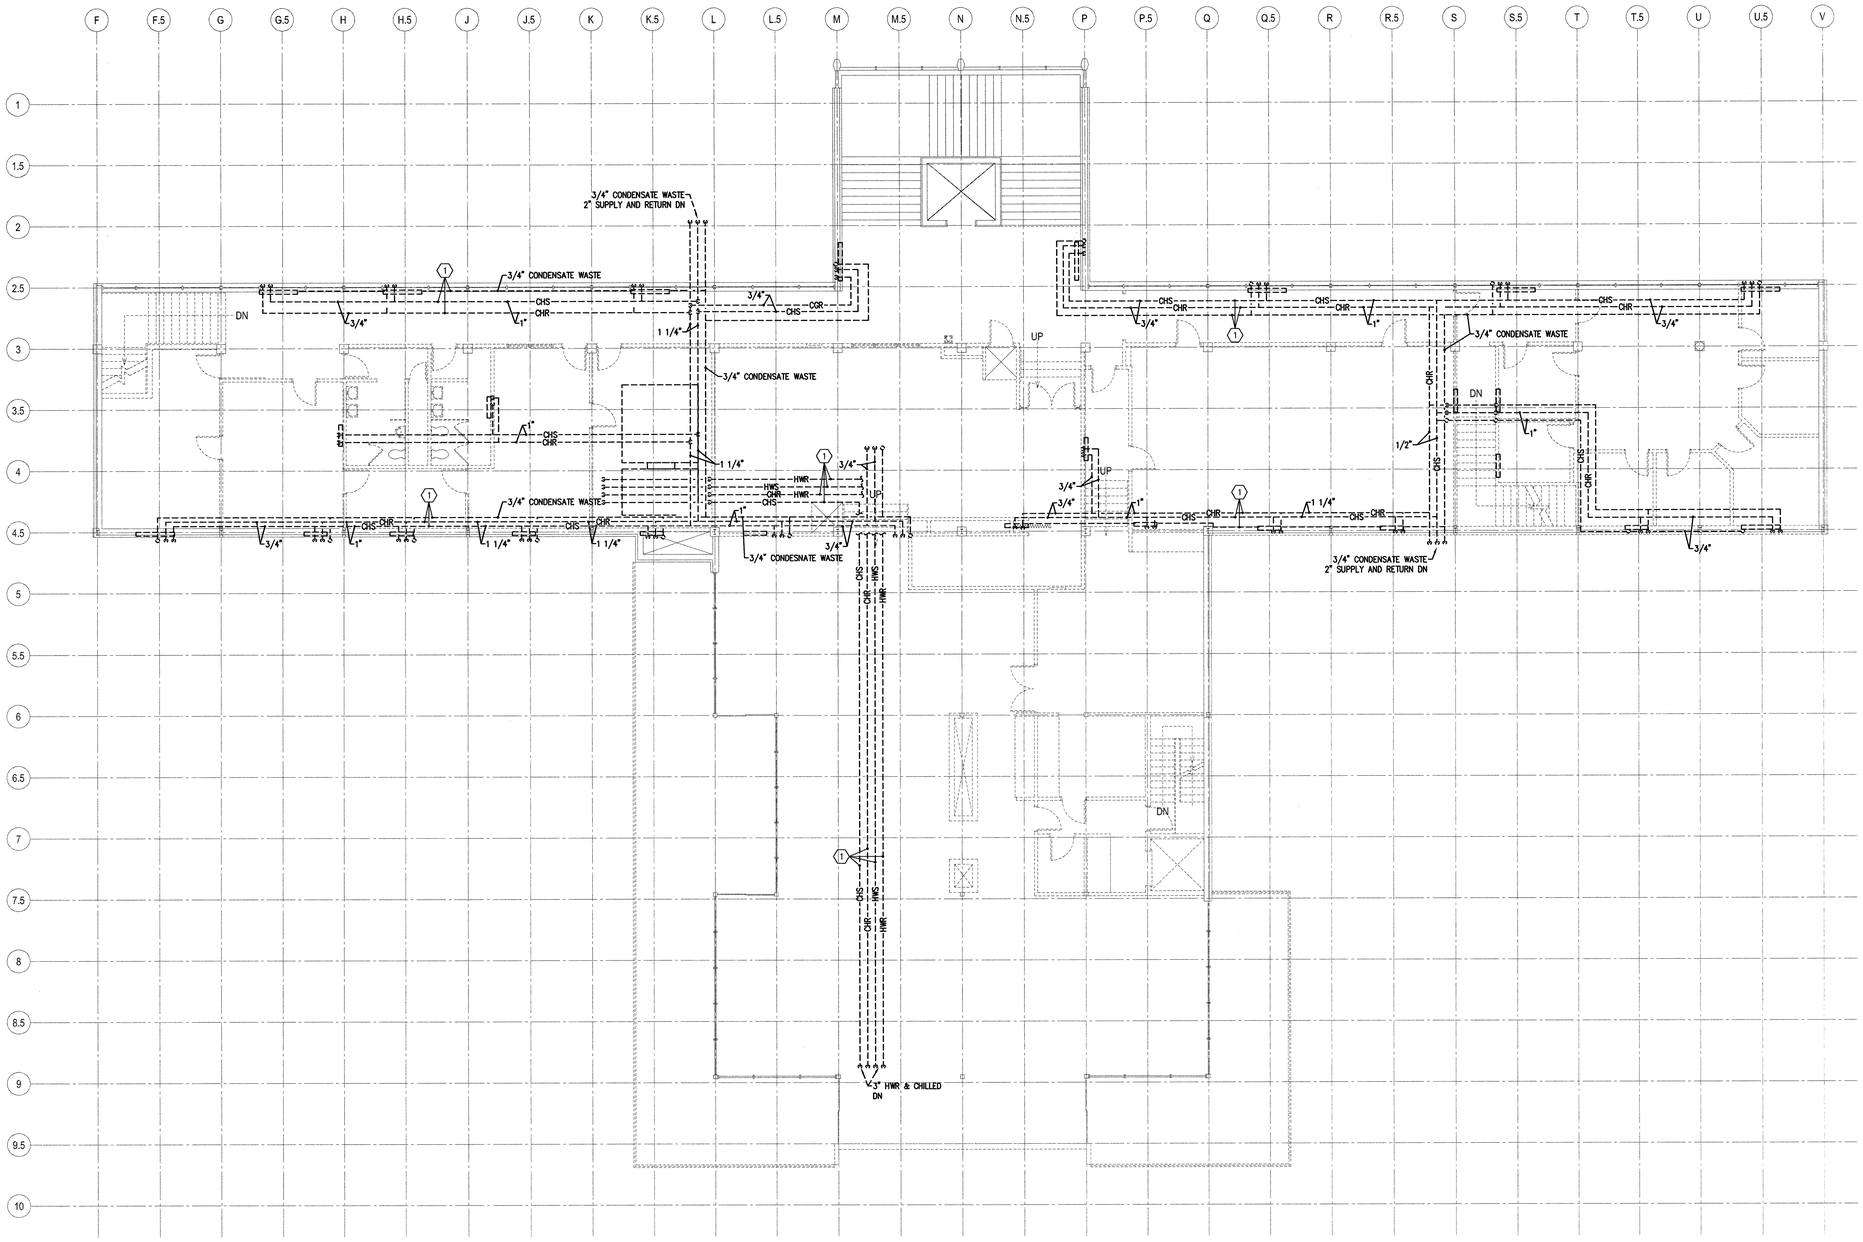

EAST SIDE FOURTH FLOOR MECHANICAL PIPING DEMOLITION PLAN

1 SCALE: 1/8" = 1'-0"

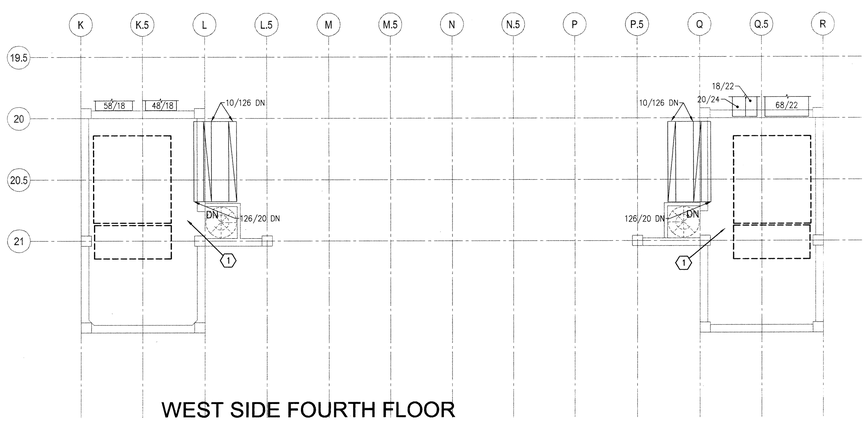

WEST SIDE FOURTH FLOOR MECHANICAL PIPING DEMOLITION PLAN

2 SCALE: 1/8" = 1'-0"

KEYED NOTES

1. REMOVE PIPING THROUGHOUT BUILDING (TYPICAL).

GENERAL NOTES

A. ALL DUCTWORK, EQUIPMENT, CONTROLS, VAV BOXES, DIFFUSERS, THERMOSTAT, GRILLES, STEAM SUPPLY AND CONDENSATE PIPING, HOT WATER SUPPLY AND RETURN PIPING, ETC. SHOWN DASHED AND DARK ARE TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ANY HVAC CONTROLS OR CONTROL PANELS TO BE SALVAGED, WILL BE REMOVED PRIOR TO DEMOLITION BY OWNER.

KEY PLAN:



MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.K. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

FOURTH FLOOR MECH. PIPING DEMO.PLAN AREA "D"
BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DMP104.D

g:\Drawings\Demolition Package\DMP104.D.dwg, 2/14/2006 4:08:28 PM, groberts, 1:1

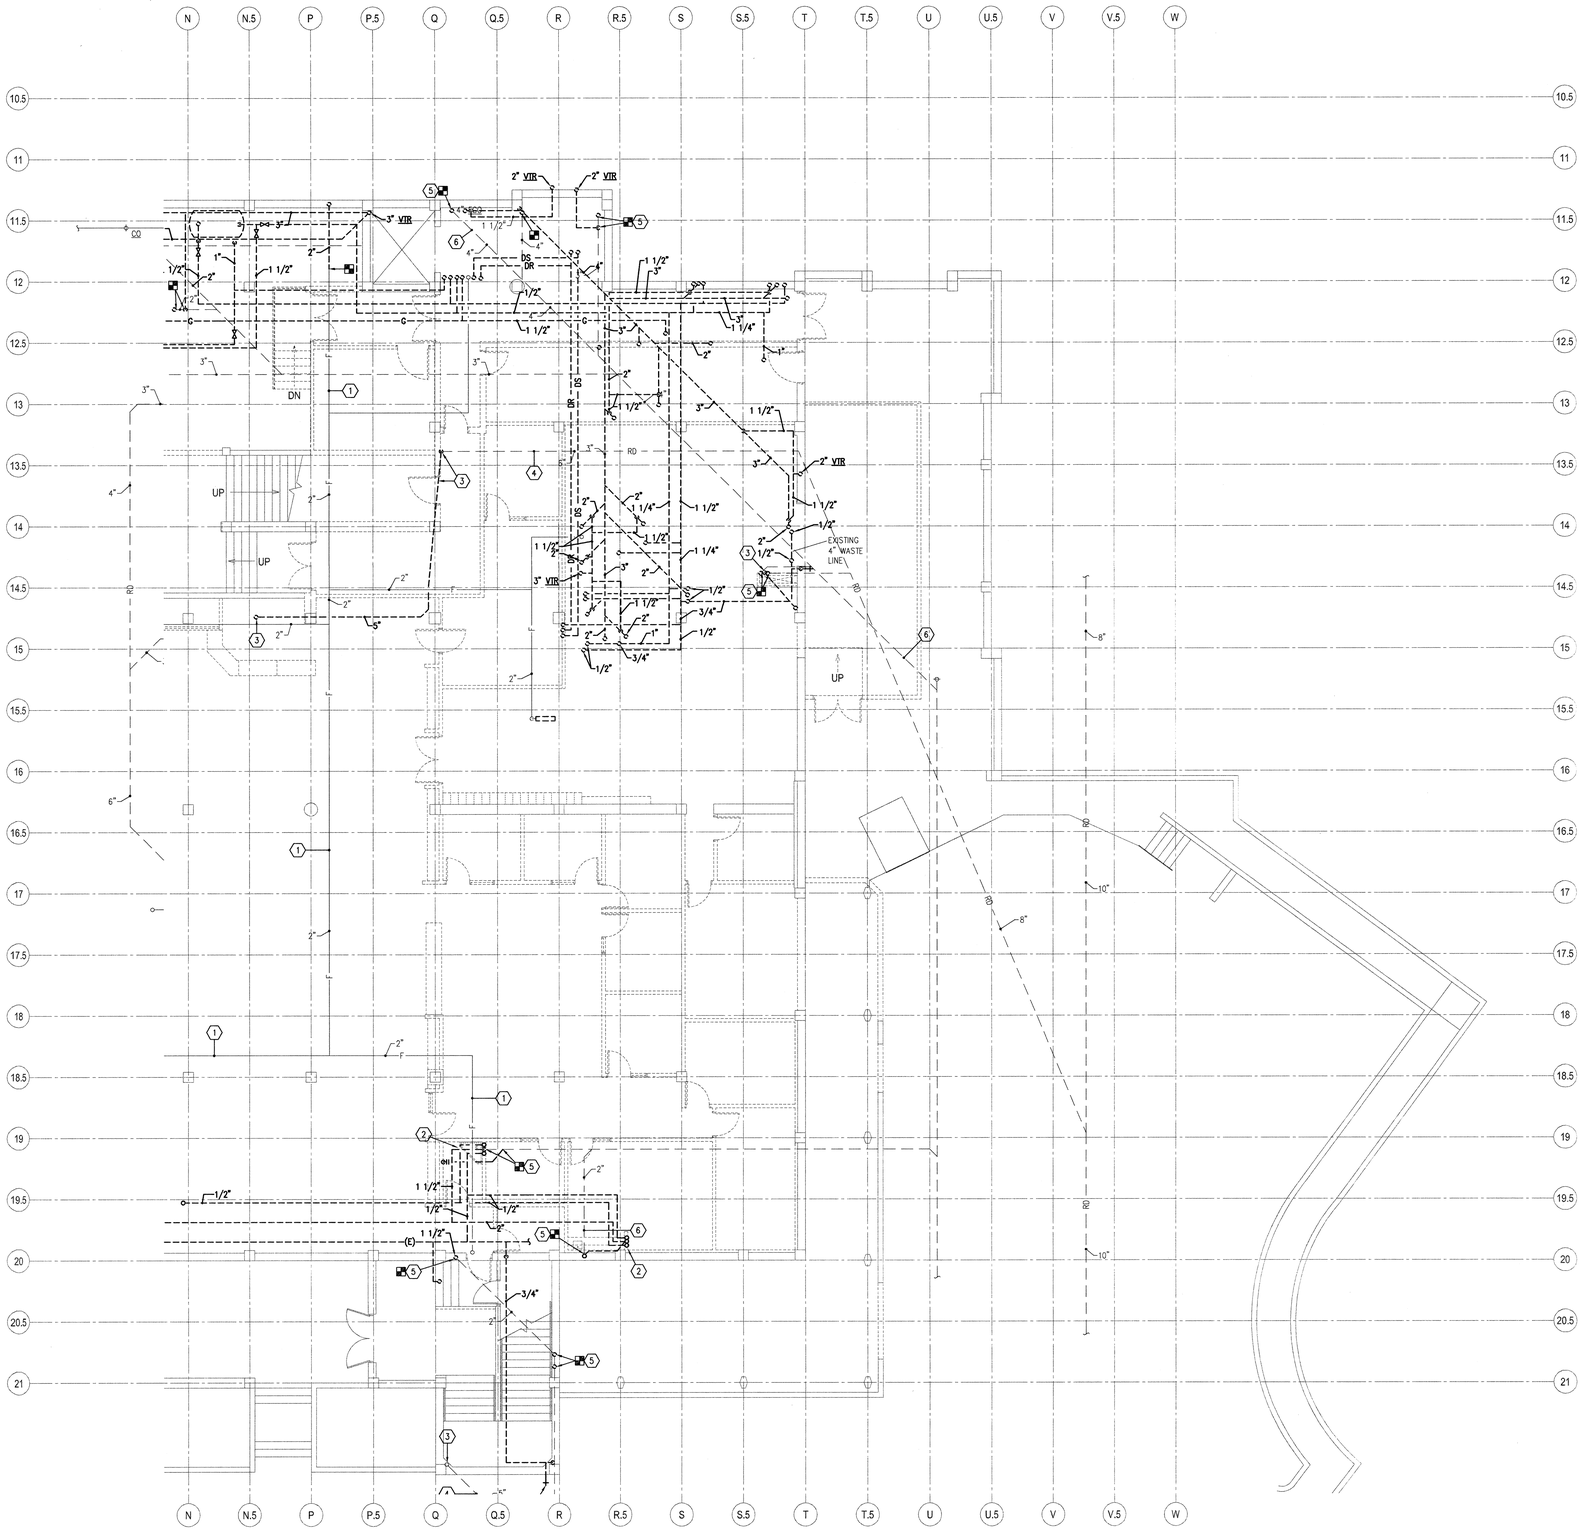

FIRST FLOOR PLUMBING DEMOLITION PLAN AREA "A"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. EXISTING FIRE SPRINKLER MAIN AND DISTRIBUTION SYSTEM TO REMAIN.
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE.
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING AND CAP EXISTING WHERE IT GOES THROUGH FLOOR OR WALL.
4. EXISTING STORM DRAINAGE PIPING BELOW FLOOR TO REMAIN.
5. CAP WASTE LINE BELOW FLOOR AND REMOVE ACCESSIBLE WASTE ABOVE FLOOR UP THROUGH BUILDING.
6. ABANDON EXISTING WASTE IN PLACE.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

WEBER STATE UNIVERSITY

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.G.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

FIRST FLOOR PLUMB. DEMO. PLAN AREA "A"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL101.A

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts Feb 14, 2006 - 4:04pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL101.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL101.A.dwg, 2/14/2006 4:04:40 PM, groberts, 1:1

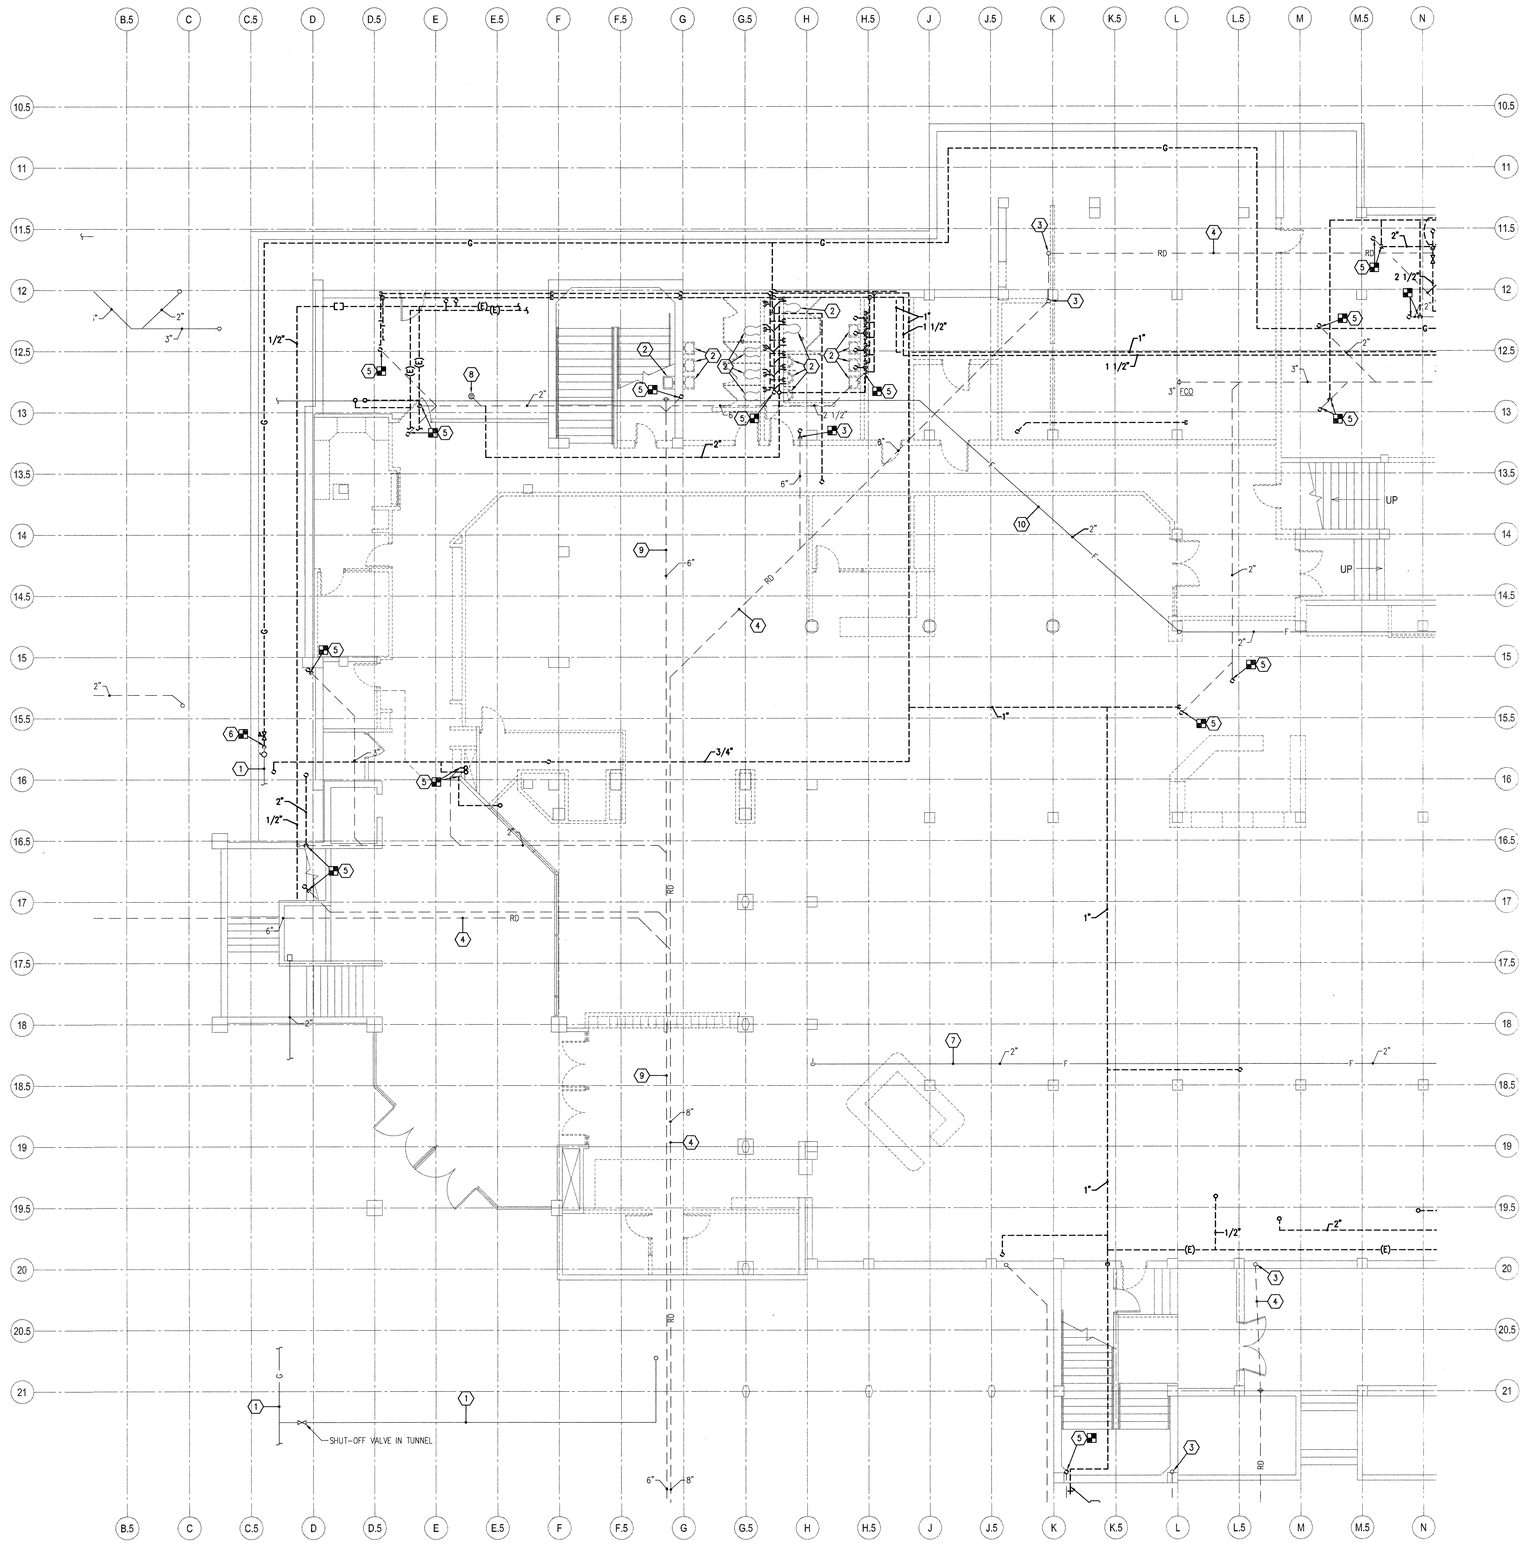

1 FIRST FLOOR PLUMBING DEMOLITION PLAN AREA "B"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. EXISTING GAS TO REMAIN.
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE.
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING AND CAP EXISTING WHERE IT GOES THROUGH FLOOR OR WALL.
4. EXISTING STORM DRAINAGE PIPING BELOW FLOOR TO REMAIN.
5. CAP WASTE LINE BELOW FLOOR AND REMOVE ACCESSIBLE WASTE ABOVE FLOOR UP THROUGH BUILDING.
6. WEBER STATE UNIVERSITY TO PROVIDE NEW SHUTOFF VALVE AND CAP GAS PIPE. - COORDINATE WITH WEBER STATE UNIVERSITY AND CONSTRUCTION MANAGER.
7. EXISTING FIRE SPRINKLER MAIN AND DISTRIBUTION SYSTEM TO REMAIN.
8. EXISTING PLUMBING FIXTURE TO REMAIN.
9. EXISTING WASTE PIPING BELOW FLOOR TO REMAIN.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax: (801) 322-2418

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF
FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

FIRST FLOOR
PLUMB. DEMO.
PLAN AREA "B"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL101.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts, Feb 14, 2006 - 4:04pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL101.B.dwg

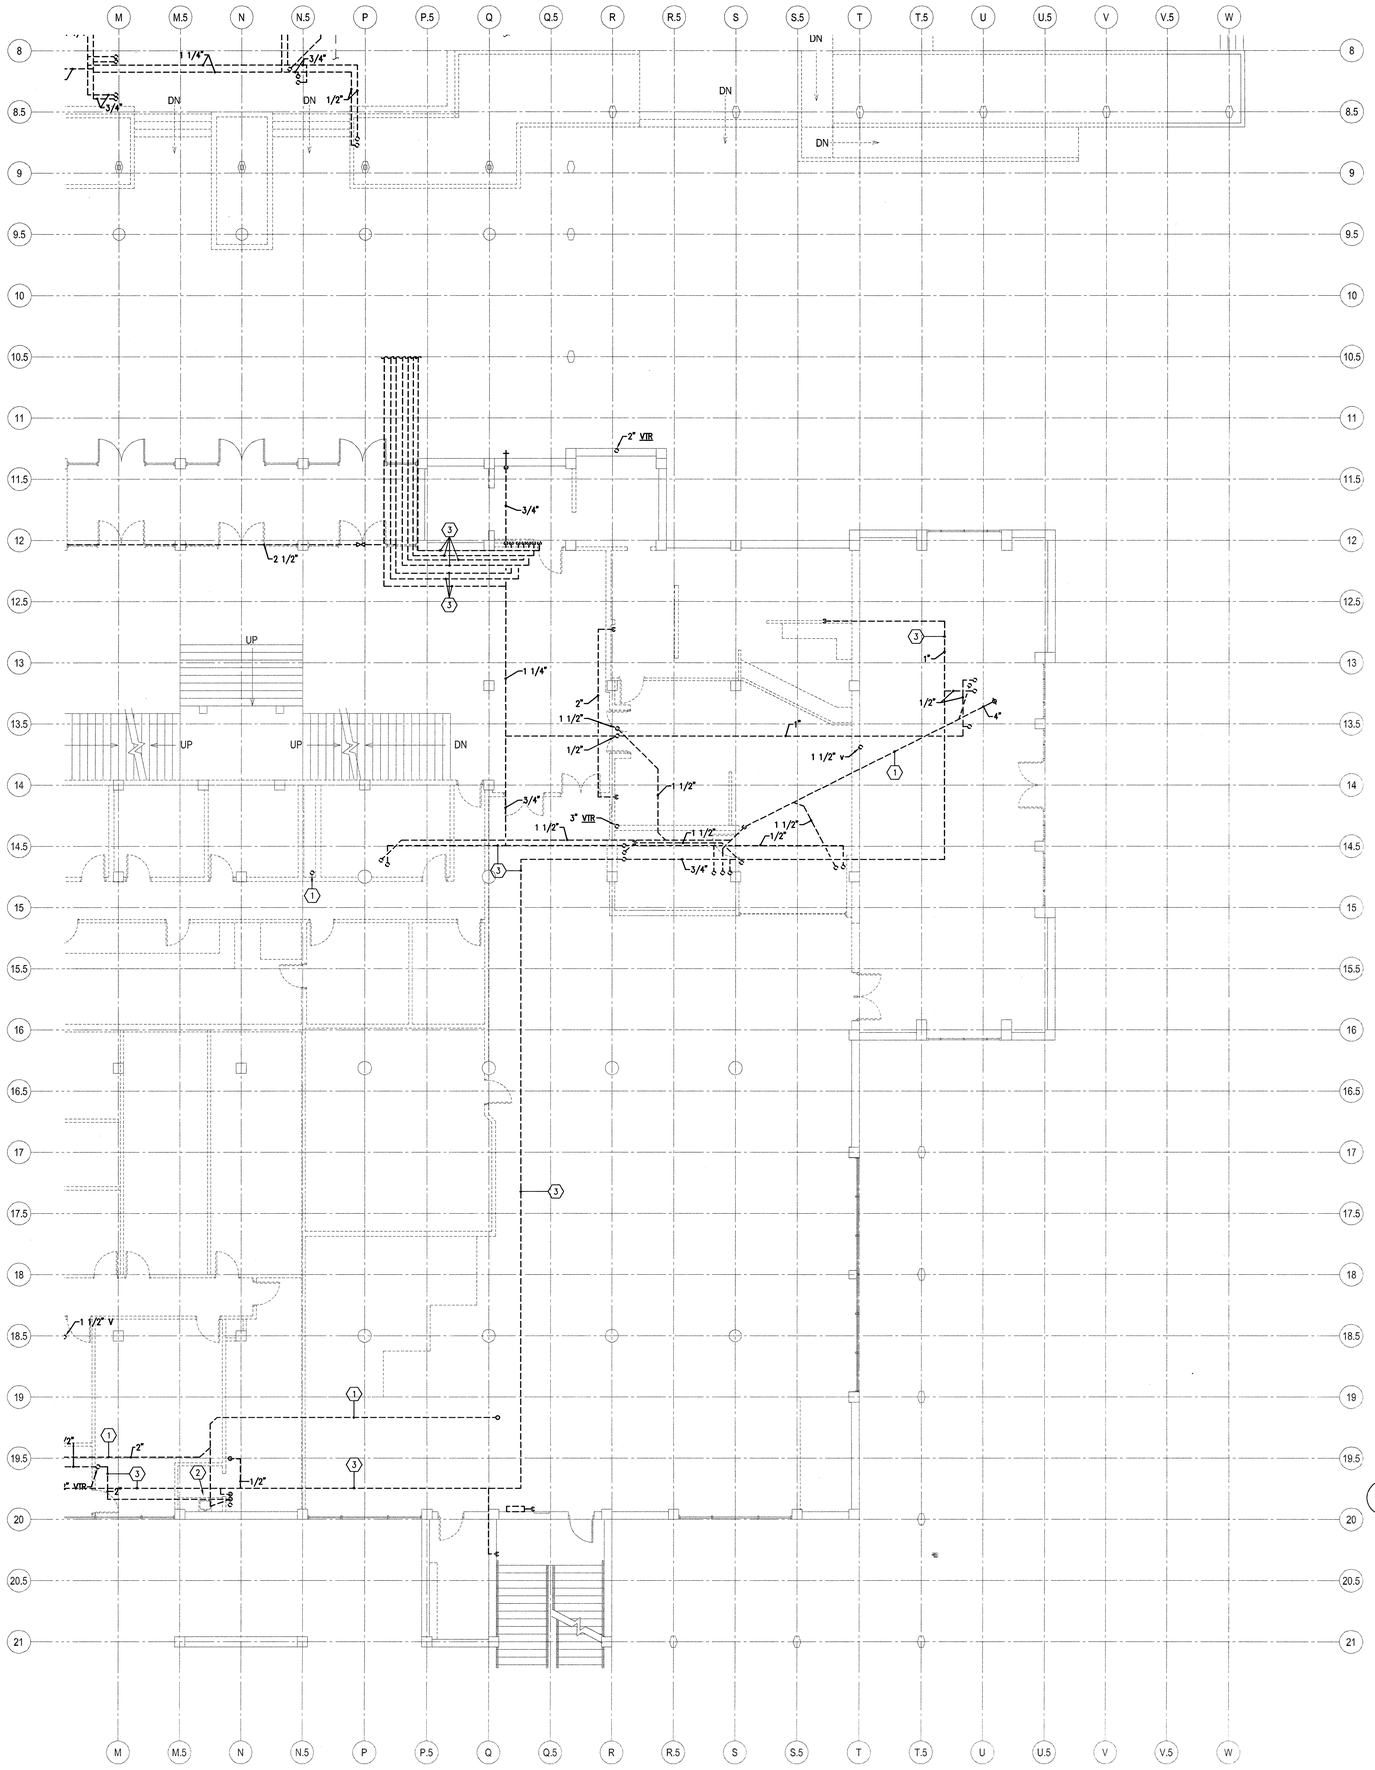

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION AND ROOF DRAINAGE PIPING (TYPICAL).

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.

1 SECOND FLOOR PLUMBING DEMOLITION PLAN AREA "A"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

WEBER STATE UNIVERSITY

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR PLUMB. DEMO. PLAN AREA "A"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL102.A

Copyright (c) 2005 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts Feb 14, 2006 - 4:03pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.A.dwg, 2/14/2006 4:03:50 PM, groberts, 1:1

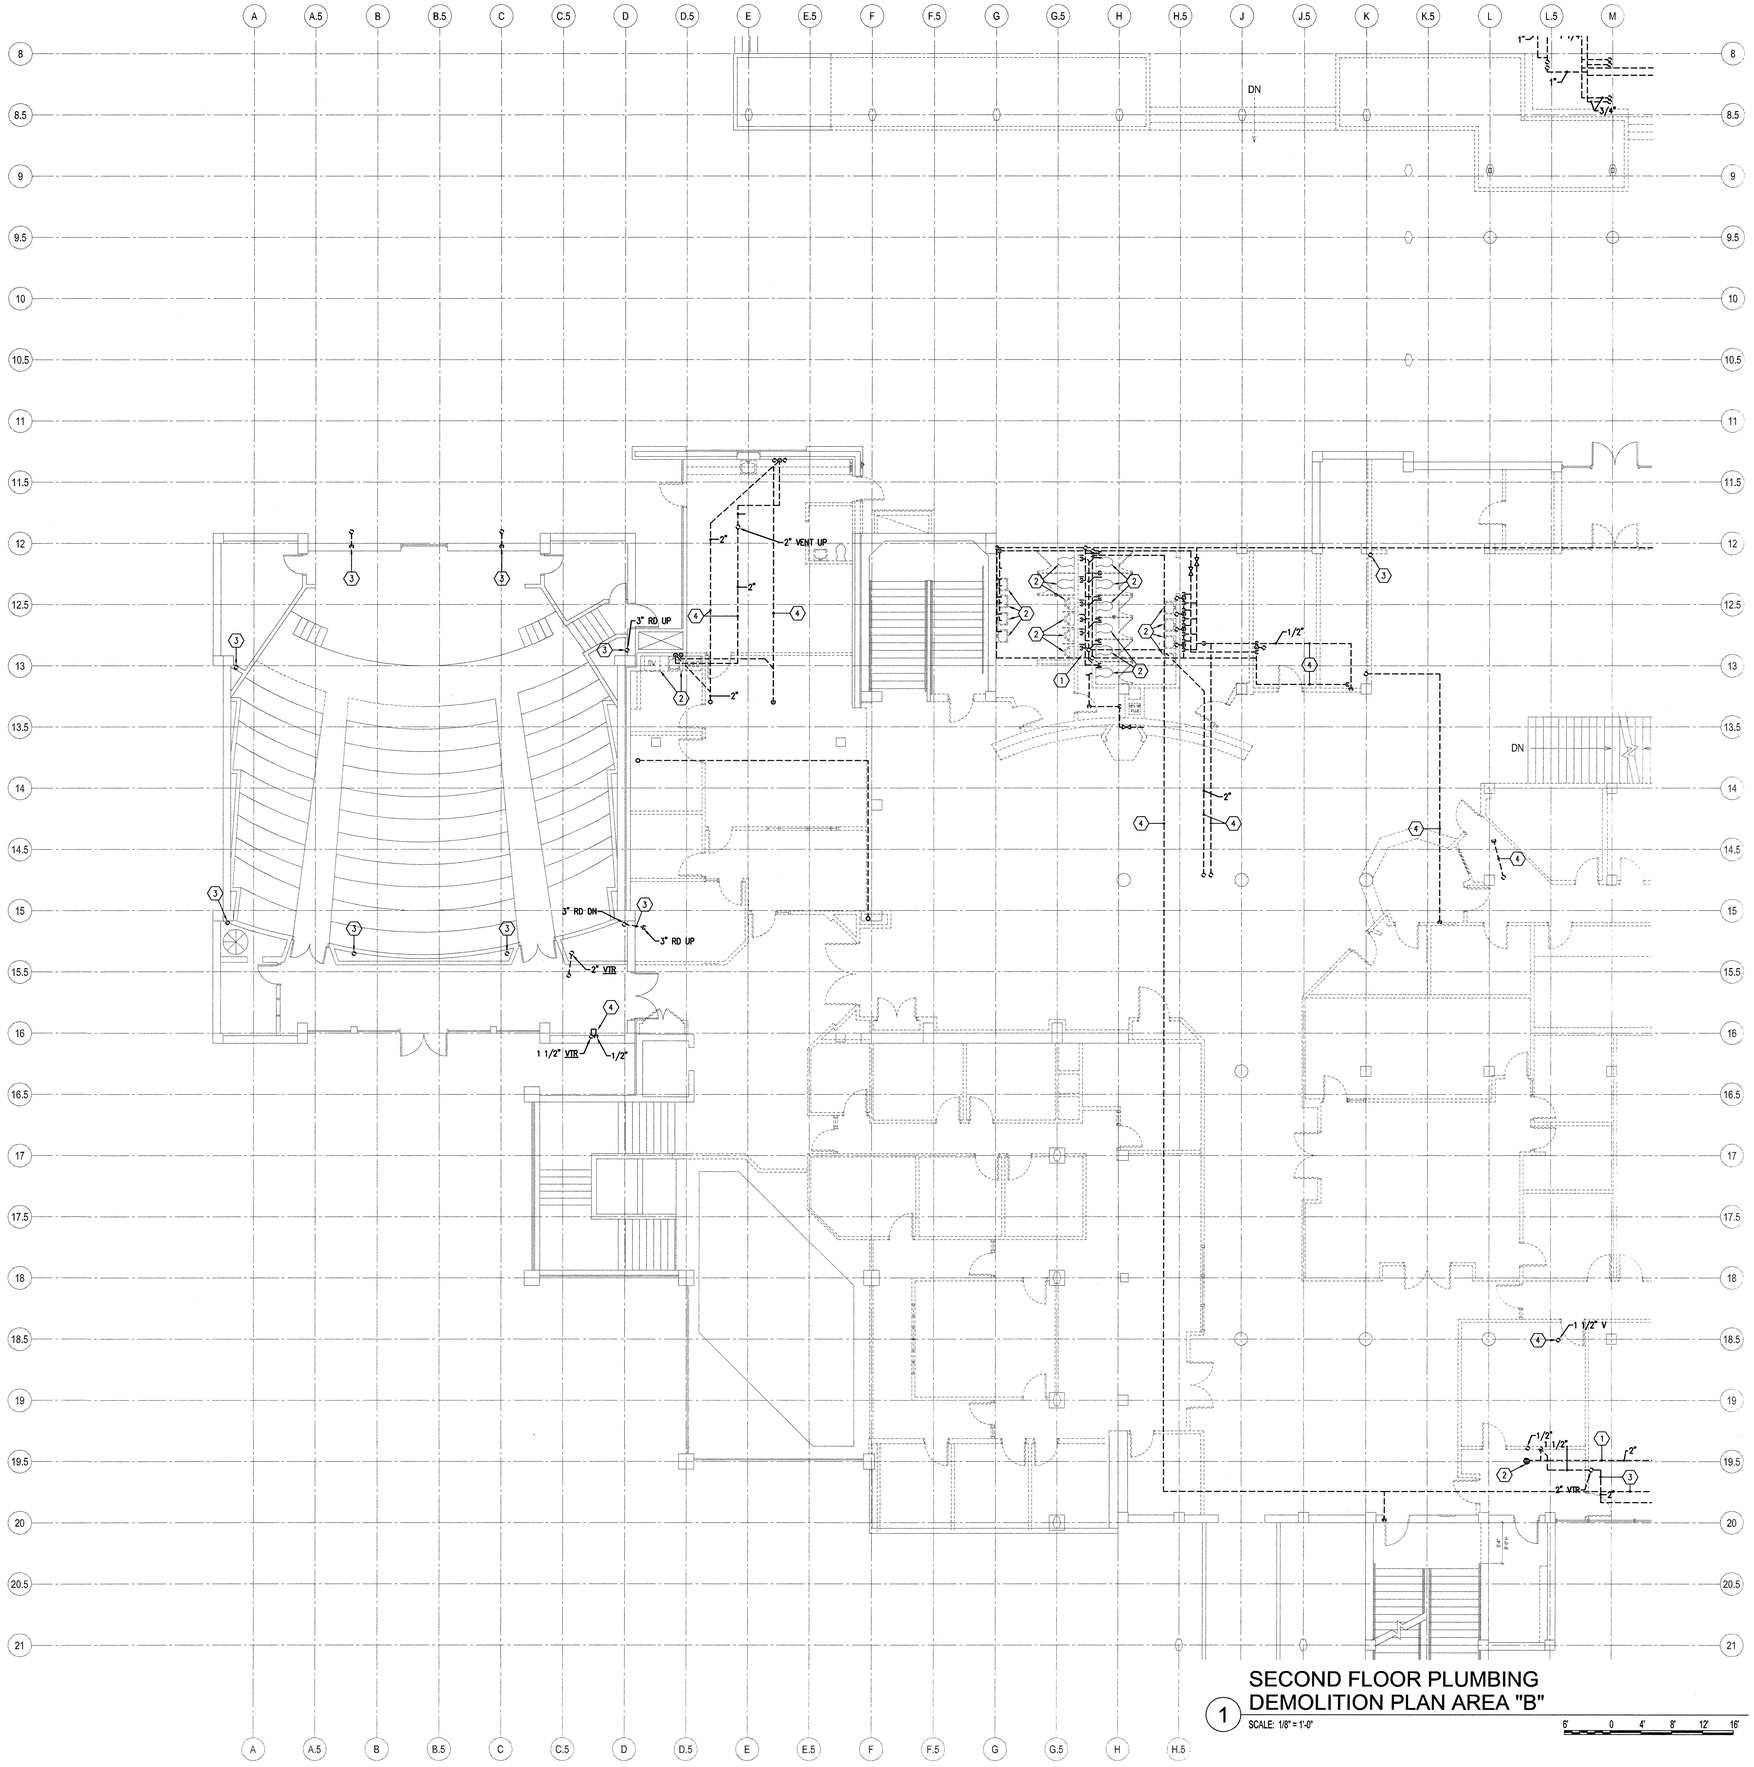

1 SECOND FLOOR PLUMBING DEMOLITION PLAN AREA "B"

SCALE: 1/8" = 1'-0"

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION AND ROOF DRAINAGE PIPING (TYPICAL).

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

D. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2418

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO: 20055556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR PLUMB. DEMO. PLAN AREA "B"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL102.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By:groberts Feb 14, 2006 - 4:03pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.B.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.B.dwg, 2/14/2006 4:03:35 PM, groberts, 1:1

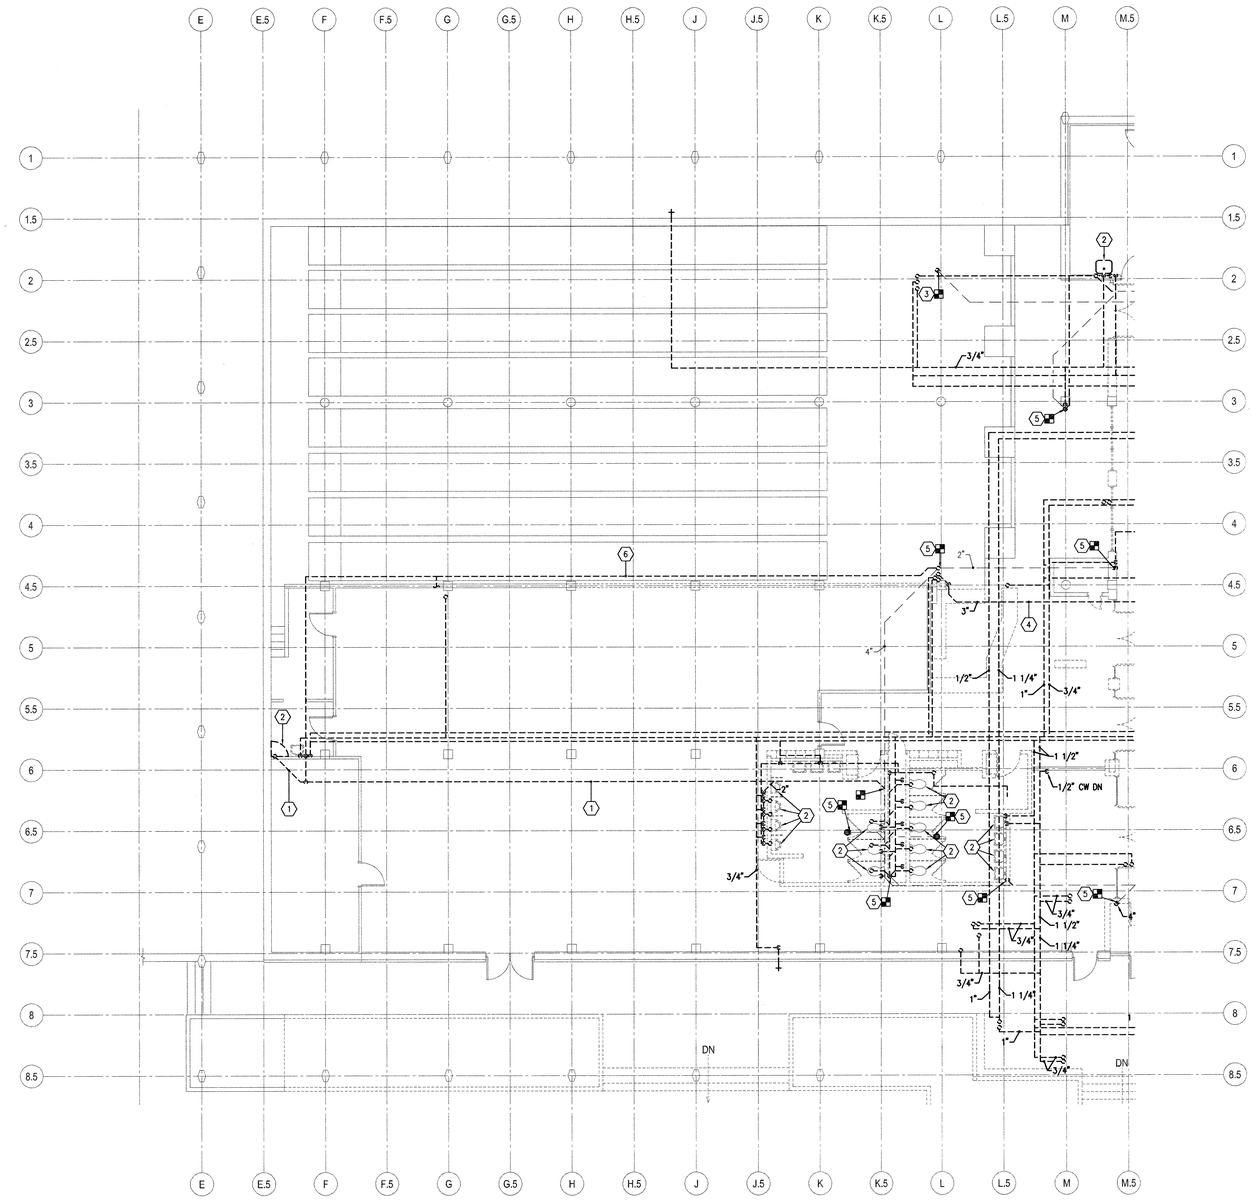

SECOND FLOOR PLUMBING DEMOLITION PLAN AREA "C"

1

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE BELOW FLOOR TO MAKE ROOM FOR NEW.
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE.
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING AND CAP EXISTING WHERE IT GOES THROUGH FLOOR OR WALL.
4. REMOVE EXISTING ROOF DRAIN BELOW SLAB TO MAKE ROOM FOR NEW.
5. CAP WASTE LINE BELOW FLOOR.
6. REMOVE EXISTING VENT ABOVE CEILING.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

D. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF
FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

SECOND FLOOR PLUMB. DEMO. PLAN AREA "C"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL102.C

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts, Feb 14, 2006 - 4:03pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.C.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.C.dwg, 2/14/2006 4:03:19 PM, groberts, 1:1

1 SECOND FLOOR PLUMBING DEMOLITION PLAN AREA "D"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. EXISTING WASTE BELOW SLAB TO REMAIN.
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE.
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING AND CAP EXISTING WHERE IT GOES THROUGH FLOOR OR WALL.
4. EXISTING STORM DRAINAGE BELOW FLOOR TO REMAIN.
5. CAP WASTE LINE BELOW FLOOR.
6. COORDINATE WITH WEBER STATE UNIVERSITY AND CONSTRUCTION MANGER TO PROVIDE CAP ON GAS PIPE AT TIME OF REMOVAL.
7. REMOVE EXISTING ROOF DRAIN BELOW SLAB TO MAKE ROOM FOR NEW.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION:
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION:

SECOND FLOOR PLUMB. DEMO. PLAN AREA "D"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL102.D

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts Feb 14, 2006 - 4:03pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.D.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL102.D.dwg, 2/14/2006 4:03:03 PM, groberts, 1:1

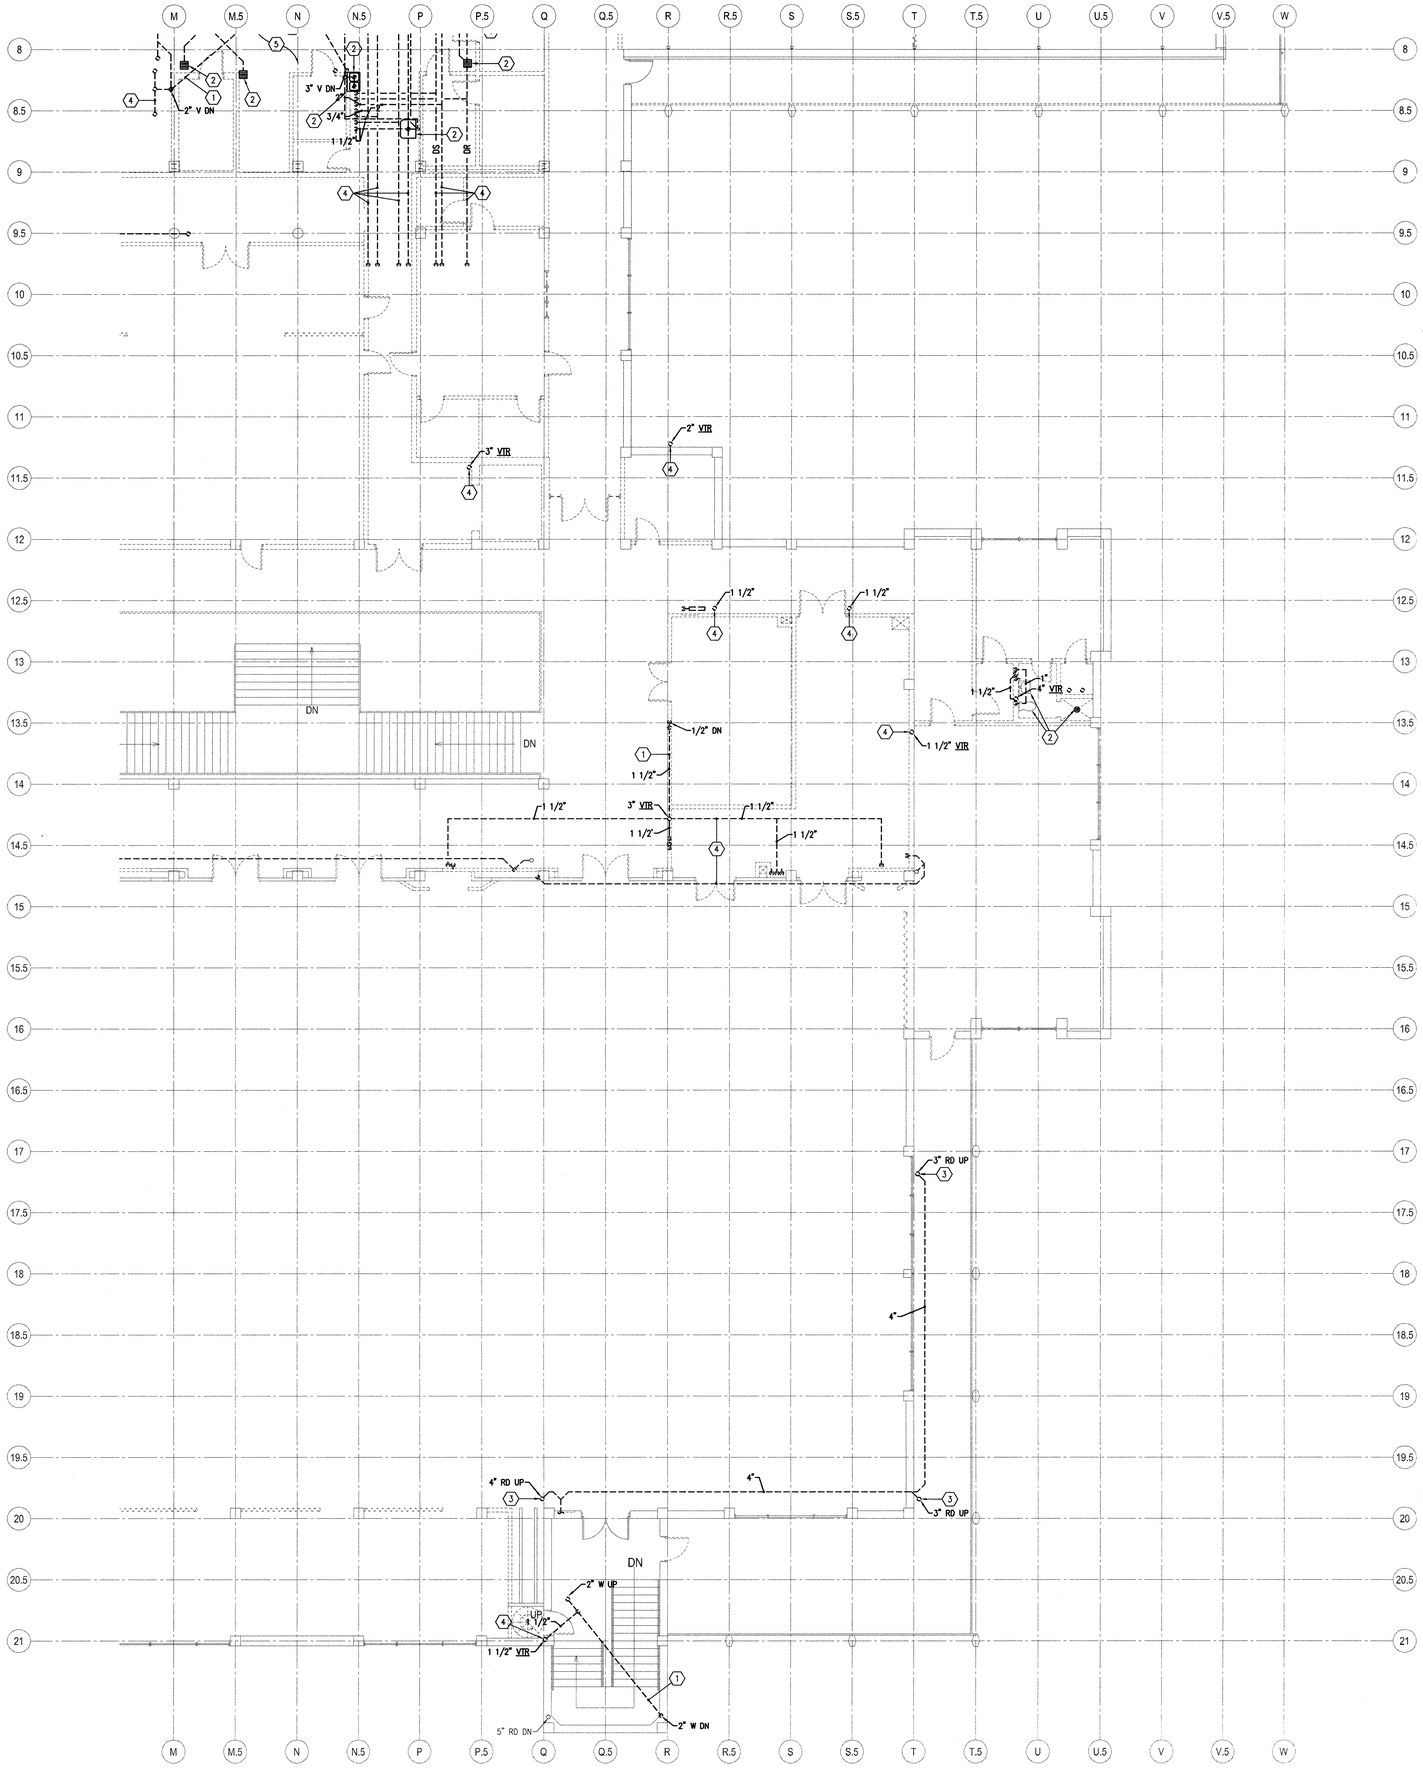

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING INCLUDING ROOF DRAINS ON ROOF (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION, AND ROOF DRAINAGE PIPING (TYPICAL).

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.

1 THIRD FLOOR PLUMBING DEMOLITION PLAN AREA "A"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

WEBER STATE UNIVERSITY

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR PLUMB. DEMO. PLAN AREA "A"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL103.A

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By:groberts File: A 22X36 - ARCH
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.A.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.A.dwg, 2/14/2006 4:02:41 PM, groberts, 1:1

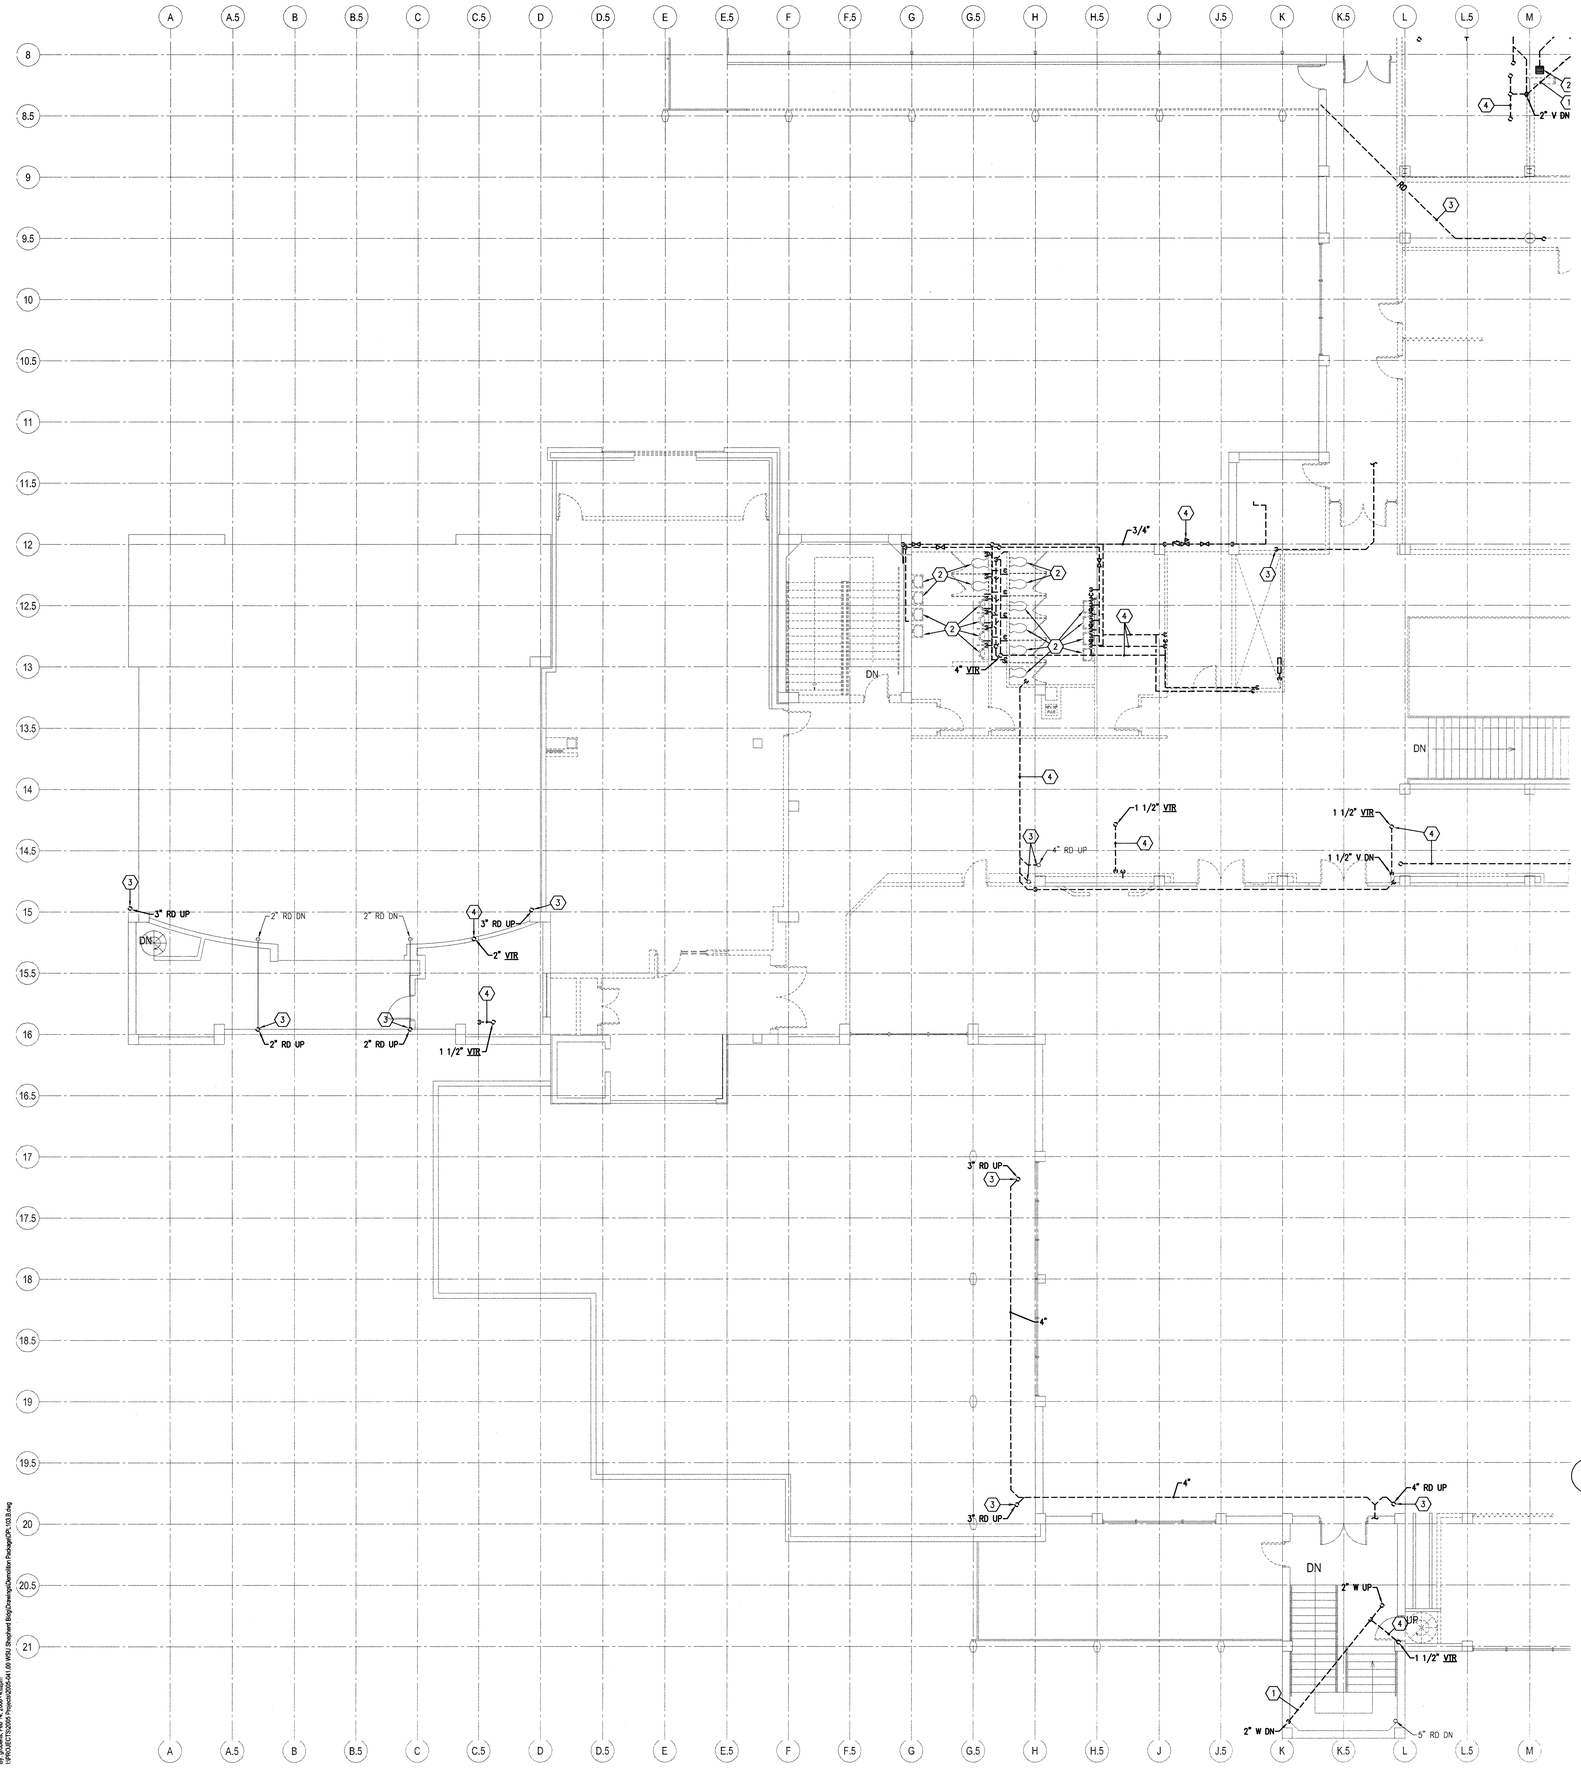

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING INCLUDING ROOF DRAINS ON ROOF (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION, AND ROOF DRAINAGE PIPING (TYPICAL).

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.

1 THIRD FLOOR PLUMBING DEMOLITION PLAN AREA "B"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF
FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO. 2005556.00
DFCM PROJECT NO. 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR PLUMB. DEMO. PLAN AREA "B"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL103.B

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts, File: 14, 2006 - 4:02pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.B.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.B.dwg, 2/14/2006 4:02:26 PM, groberts, 1:1

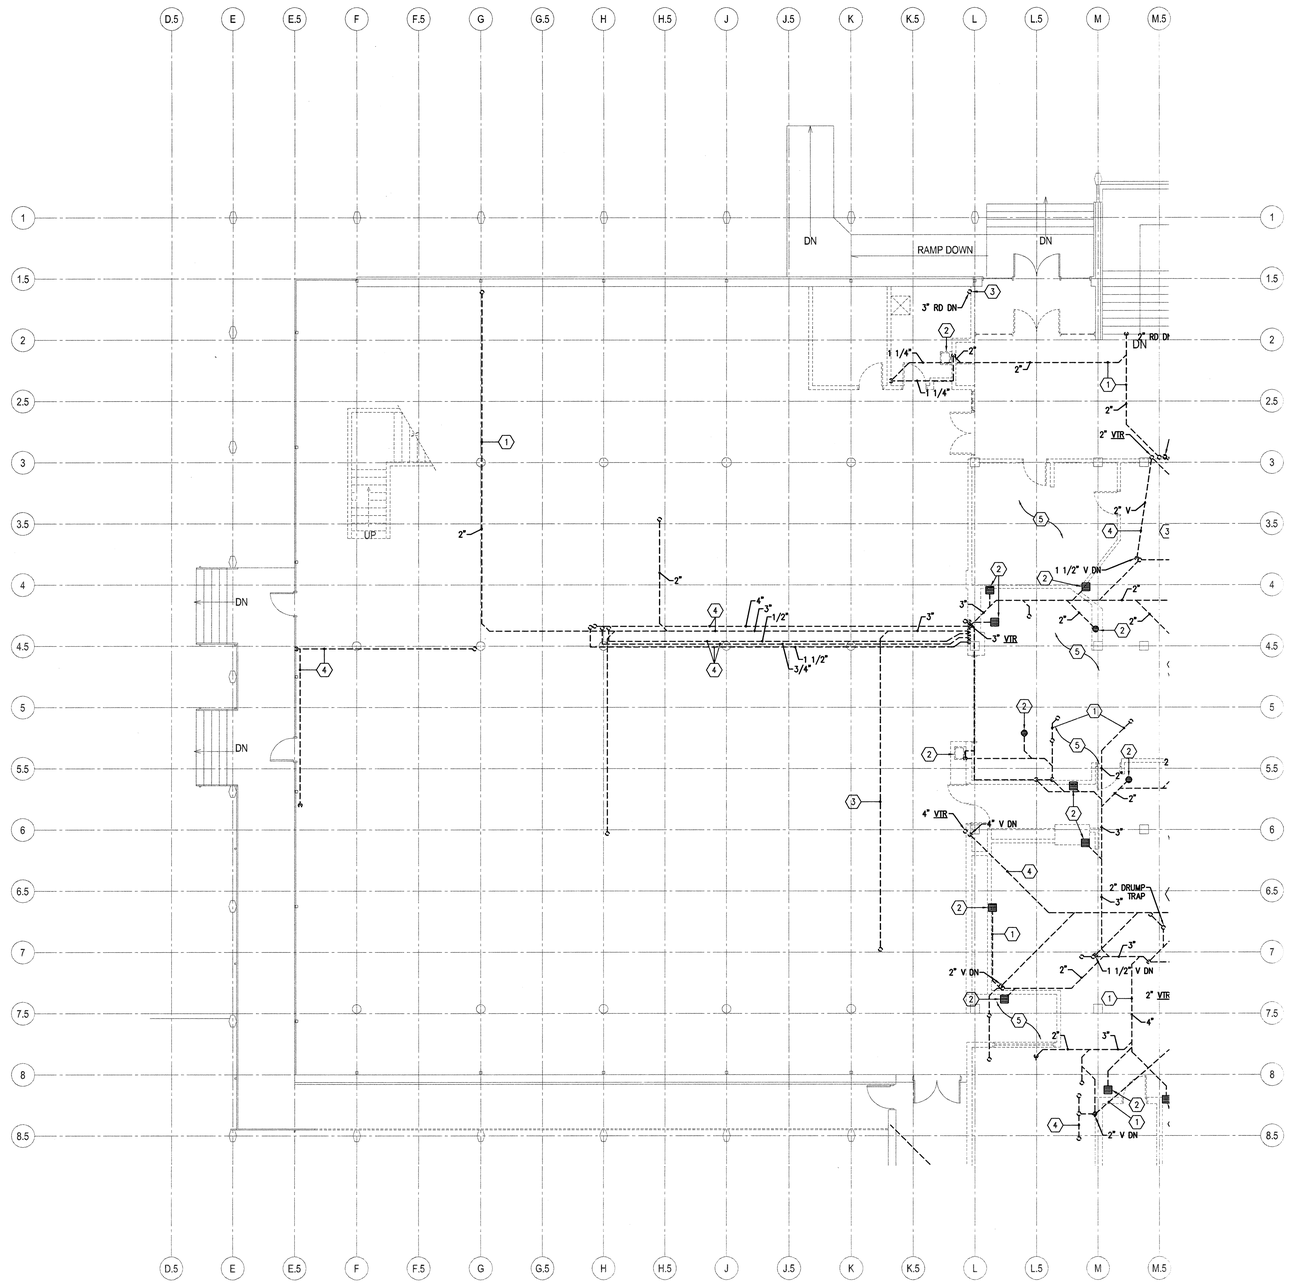

1 THIRD FLOOR PLUMBING DEMOLITION PLAN AREA "C"

SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING INCLUDING ROOF DRAINS ON ROOF (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION AND ROOF DRAINAGE PIPING (TYPICAL).
5. REMOVE ALL KITCHEN PLUMBING FIXTURES AND ASSOCIATED PIPING IN THIS AREA.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone (801) 322-2400 / Fax (801) 322-2416

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR PLUMB. DEMO. PLAN AREA "C"

BID PACKAGE #1: DEMOLITION & ABATEMENT

SHEET NUMBER

DPL103.C

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts: Feb 14, 2006 - 4:02pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.C.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.C.dwg, 2/14/2006 4:02:10 PM, groberts, 1:1

THIRD FLOOR PLUMBING DEMOLITION PLAN AREA "D"

1 SCALE: 1/8" = 1'-0"

6' 0 4' 8' 12' 16'

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING INCLUDING ROOF DRAINS ON ROOF (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION AND ROOF DRAINAGE PIPING (TYPICAL).
5. REMOVE ALL KITCHEN PLUMBING FIXTURES AND ASSOCIATED PIPING IN THIS AREA.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.



KEY PLAN:

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2418

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

WEBER STATE UNIVERSITY

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.R. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISIONS:

NO.	DATE	DESCRIPTION

THIRD FLOOR PLUMB. DEMO. PLAN AREA "D"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL103.D

Copyright (C) 2006 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By groberts Feb 14, 2006 - 4:01pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL103.D.dwg

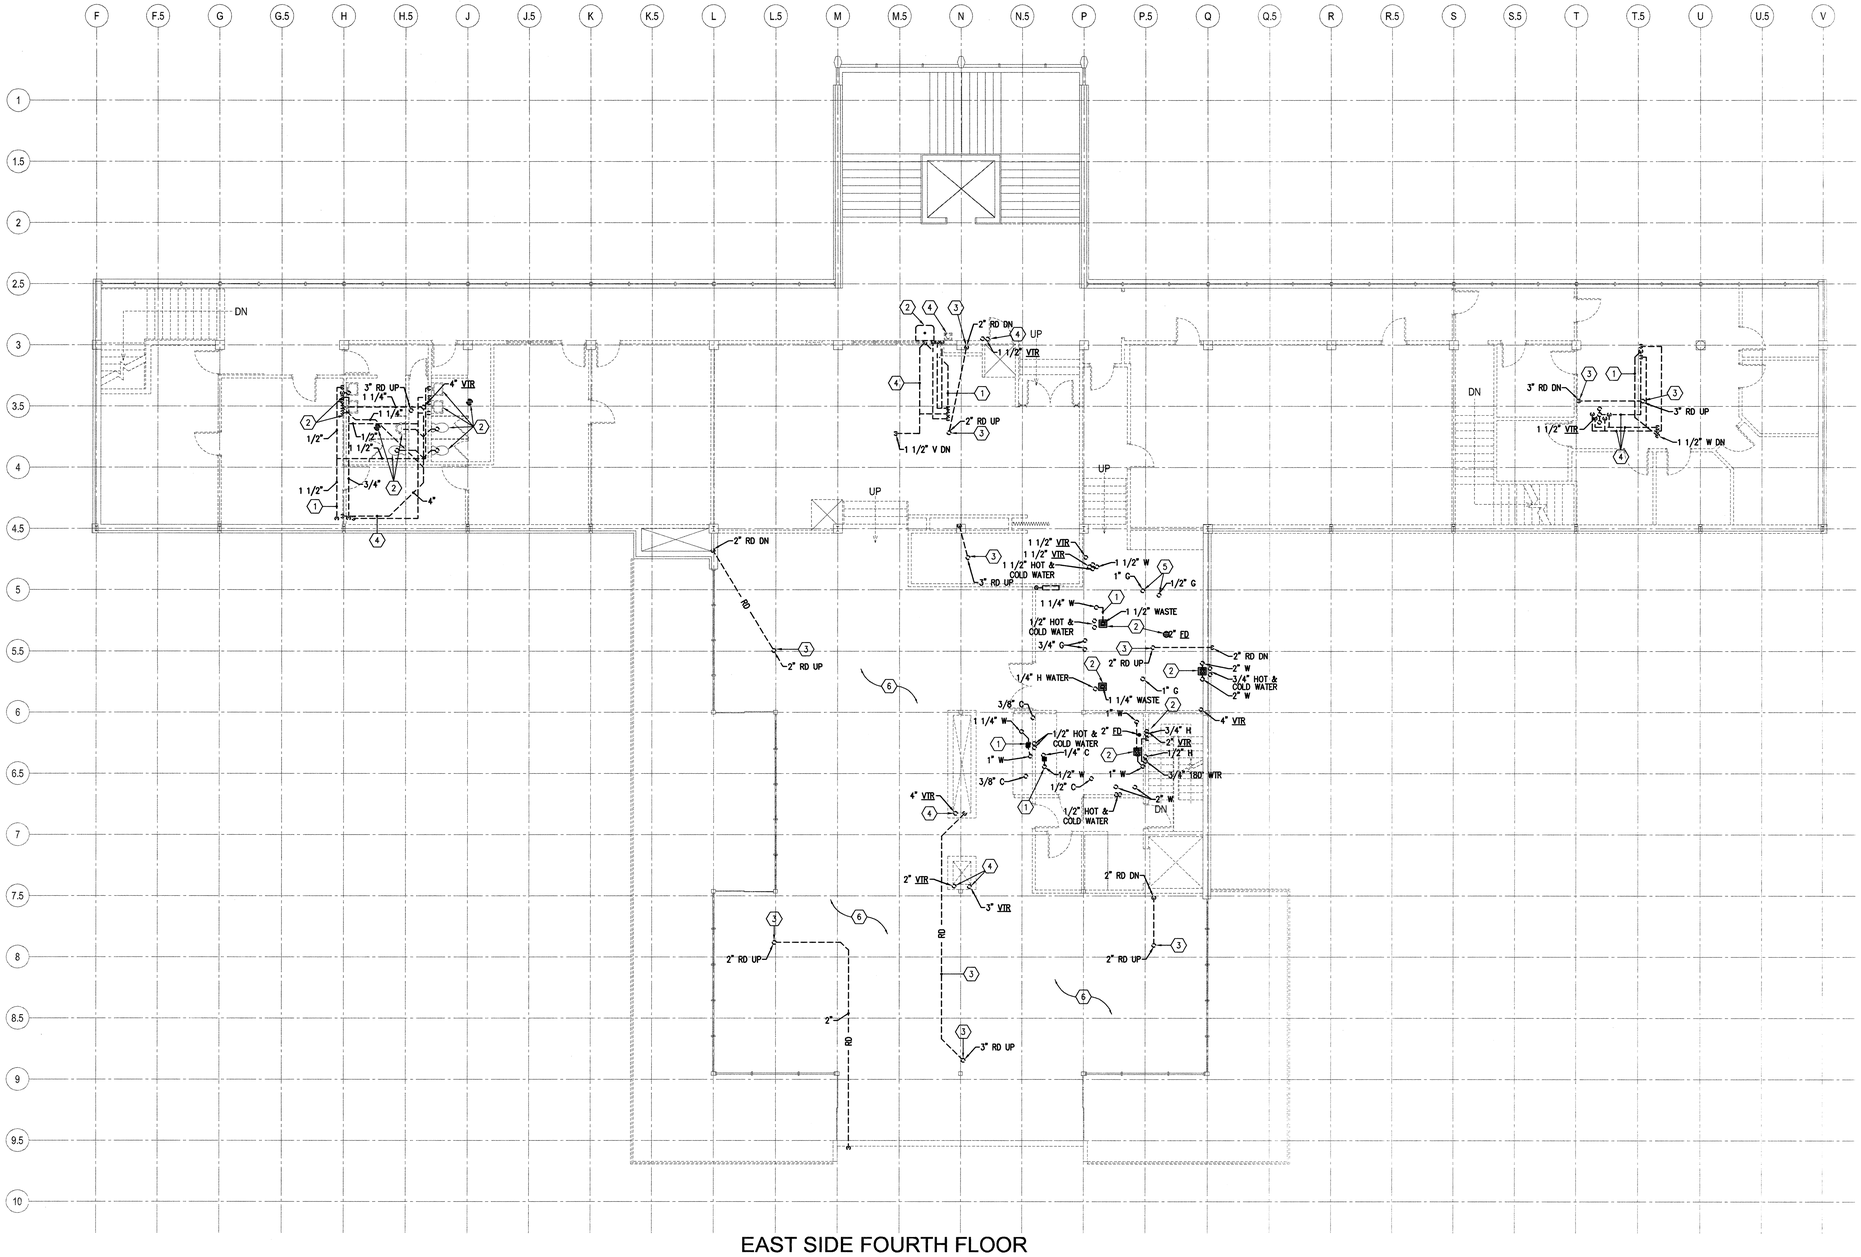

1 EAST SIDE FOURTH FLOOR PLUMBING DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

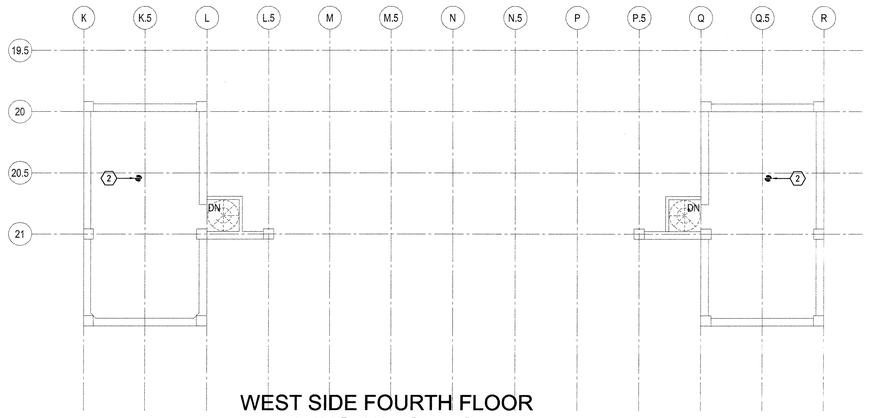

2 WEST SIDE FOURTH FLOOR PLUMBING DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

KEYED NOTES

1. REMOVE EXISTING WASTE PIPE (TYPICAL).
2. REMOVE EXISTING PLUMBING FIXTURE, WASTE, VENT, HOT AND COLD WATER PIPING BACK AS FAR AS POSSIBLE (TYPICAL).
3. REMOVE ACCESSIBLE ROOF DRAINAGE PIPING ABOVE FLOOR UP THROUGH BUILDING INCLUDING ROOF DRAINS ON ROOF (TYPICAL).
4. REMOVE ALL WASTE, DOMESTIC WATER, VENT, RECIRCULATION AND ROOF DRAINAGE PIPING (TYPICAL).
5. REMOVE GAS THROUGHOUT BUILDING BACK TO BUILDING DISCONNECT POINT.
6. REMOVE ALL WASTE, VENT, ROOF DRAIN, HOT, COLD AND RECIRCULATION PIPING BELOW FLOOR IN THIS AREA.

GENERAL NOTES

A. ALL EXISTING WASTE AND ROOF DRAINAGE PIPING BELOW GROUND TO REMAIN UNLESS SHOWN OTHERWISE. ALL ABOVE GROUND WASTE, VENT, STORM WATER, NATURAL GAS, DOMESTIC COLD AND HOT PIPING TO BE REMOVED UNLESS NOTED OTHERWISE.

B. ALL PIPING SHOWN DARK DASHED TO BE REMOVED.

C. CONTRACTOR TO FIELD VERIFY EXTENT OF EXISTING PIPING TO BE REMOVED.

D. OWNER TO SALVAGE ALL FLUSH VALVES, FAUCETS, AND ELECTRIC WATER COOLERS BEFORE DEMOLITION BEGINS.

E. COORDINATE WITH ARCHITECTURAL DEMOLITION DRAWINGS.

KEY PLAN:



MHTN ARCHITECTS, INC
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

Colvin Engineering Associates, Inc.
244 West 300 North Suite 200
Salt Lake City, Utah 84103
Phone: (801) 322-2400 / Fax: (801) 322-2418

SHEPHERD UNION RENOVATION
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

WEBER STATE UNIVERSITY

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO: 2005556.00
DFCM PROJECT NO: 03215810
DRAWN BY: G.K. CHECKED BY: B.R.C.

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	BID PACKAGE #1

REVISION:

NO.	DATE	DESCRIPTION

FOURTH FLOOR PLUMB. DEMO. PLAN AREA "D"

BID PACKAGE #1:
DEMOLITION & ABATEMENT

SHEET NUMBER

DPL104.D

Copyright (C) 2005 by Colvin Engineering Associates, Inc. Salt Lake City, Utah. All rights reserved. Unauthorized copying and/or use is illegal and subject to prosecution.

By: groberts Feb 14, 2006 - 4:11pm
I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL104.D.dwg

I:\PROJECTS\2005 Projects\2005-041.00 WSU Shepherd Bldg\Drawings\Demolition Package\DPL104.D.dwg, 2/14/2006 4:11:52 PM, groberts, 1:1

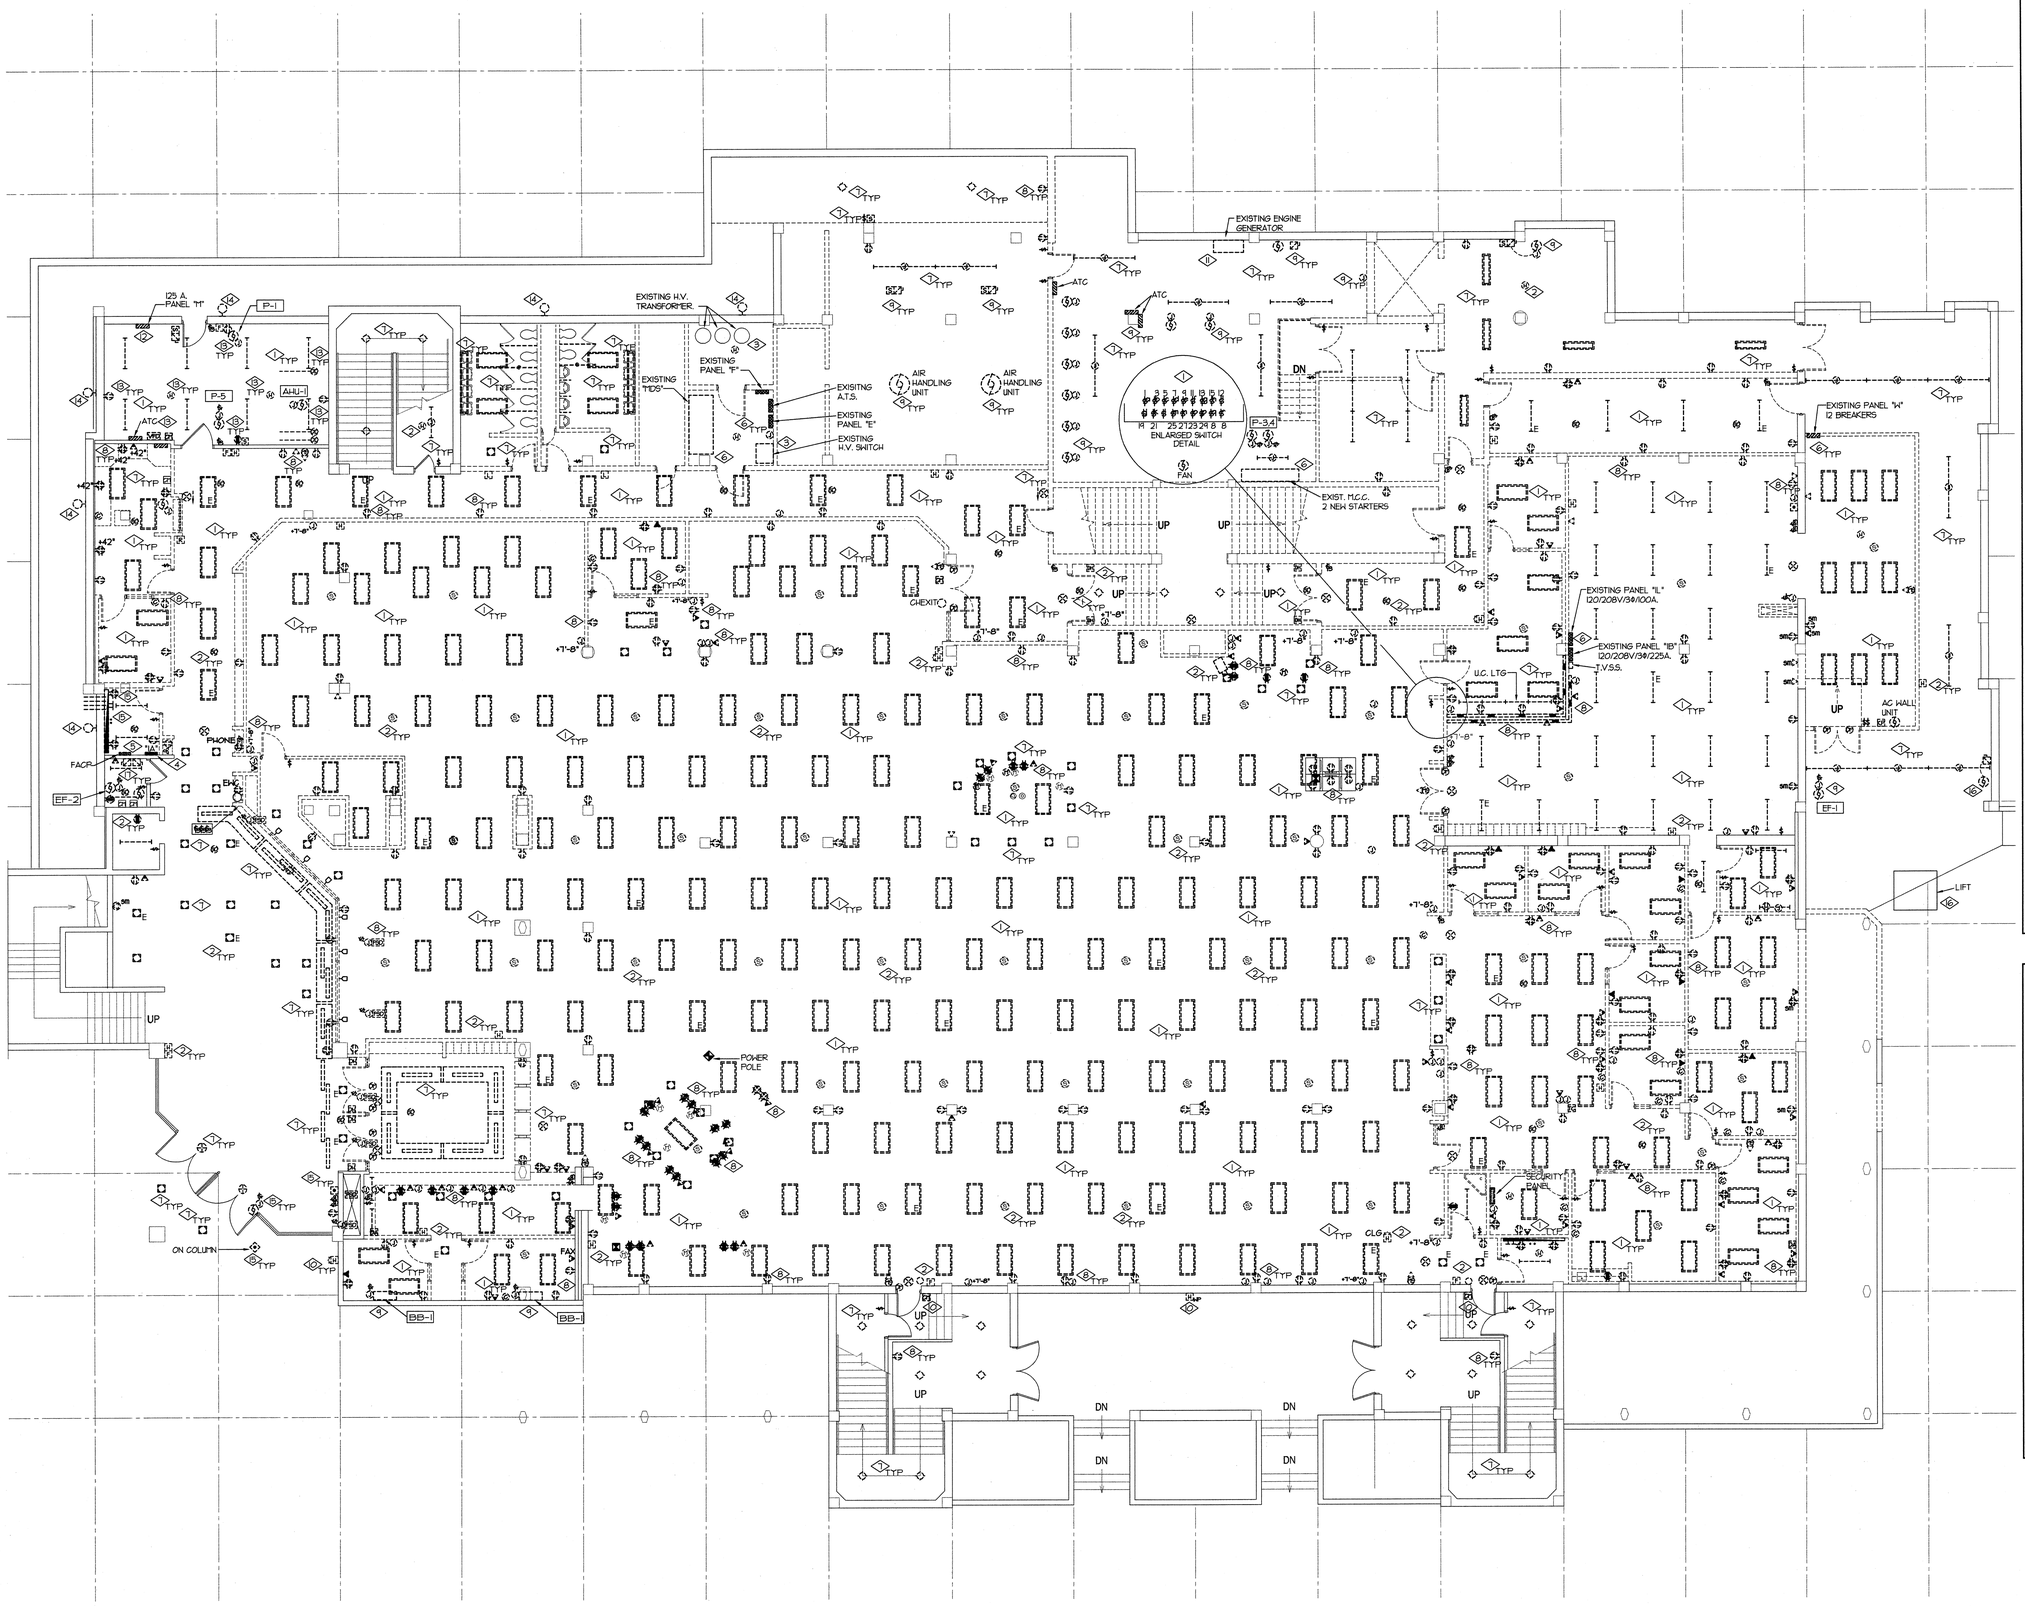

N 1ST LEVEL DEMO FLOOR PLAN – A+B – ELECTRICAL

SCALE: 1/8" = 1'-0"

REFERENCE NOTES:

1. REMOVE EXISTING 2'X4' FLUORESCENT LIGHT FIXTURES IN THE BOOKSTORE AND 4' STRIP LIGHT IN STORAGE SPACE AND MECHANICAL ROOM AND STORE THEM AT THE SITE FOR REUSE. PROTECT THESE FIXTURES FROM PHYSICAL DAMAGE AND DUST. COORDINATE THIS WORK WITH GENERAL CONTRACTOR. ANY DAMAGE DONE TO THESE FIXTURES WILL BE CONTRACTOR RESPONSIBILITY.
2. EXISTING FIRE ALARM DEVICES, CAMERAS, SPEAKERS, ETC. WILL BE REMOVED BY WSU. ANY DEVICES LEFT IN PLACE MUST BE REMOVED BY DEMOLITION CONTRACTOR. REMOVE ASSOCIATED CONDUIT, CABLE, J-BOXES, ETC.
3. REMOVE EXISTING H.V. TRANSFORMERS, H.V. SWITCH, ASSOCIATED CONDUIT, CONDUCTORS, ETC.
4. EXISTING PANEL "IA" TO REMAIN. REMOVE FEEDER CONDUIT AND CONDUCTORS. THIS PANEL WILL BE SERVED BY NEW ELECTRICAL DISTRIBUTION SYSTEM.
5. EXISTING FIRE ALARM CONTROL PANEL IS TO BE RELOCATED TO THE FIRST FLOOR OF EAST BUILDING BY MOUNTAIN ALARM. EXISTING FIRE ALARM DEVICES IN THE EAST BUILDING ARE TO BE TIED BACK, TEMPORARILY, TO THE EXISTING FACP UNTIL PHASE TWO OF DEMOLITION WORK STARTS. MOUNTAIN ALARM IS TO COORDINATE THIS WORK CLOSELY WITH WEBER STATE FIRE MARSHALL.
6. REMOVE EXISTING SWITCHBOARD, PANELBOARD, MOTOR CONTROL CENTER, ASSOCIATED CONDUIT, CONDUCTORS, ETC., WHETHER OR NOT SHOWN ON THE DEMO PLANS.
7. REMOVE ALL EXISTING LIGHT FIXTURES, LIGHT SWITCHES, EXIT SIGNS, ETC., WHETHER OR NOT SHOWN ON THE DRAWINGS. REMOVE EXISTING CONDUCTORS ALL THE WAY BACK TO THEIR ORIGINATION POINTS. REMOVE ALL CONDUITS, CONDUCTORS, J-BOXES, ETC., ALL THE WAY BACK TO PANELBOARDS. REMOVE EMERGENCY CIRCUITS ALL THE WAY BACK TO EMERGENCY PANEL..
8. REMOVE EXISTING DUPLEX OUTLETS, WIRE MOLD, VOICE/DATA CABLES, CLOCK OUTLETS, J-BOXES, CONDUIT, CONDUCTORS, ETC., IN THE REMODEL SPACE WHETHER OR NOT SHOWN ON THE DEMOLITION PLANS. REMOVE CONDUIT AND CONDUCTORS ALL THE WAY BACK TO PANELBOARDS. CUT THE CONDUIT IN MASONRY WALL FLUSH WITH MASONRY WALL SURFACES AND LEAVE THE J-BOXES IN PLACE. PROVIDE BLANK COVERPLATE IF THE WALLS ARE NOT FURRED OUT OR J-BOXES ARE NOT GOING TO BE USED FOR NEW DEVICES.
9. REMOVE ALL DISCONNECTS, CONDUIT, CONDUCTORS, J-BOXES, ETC., WHICH ARE TIED TO MECHANICAL EQUIPMENT SUCH AS FANS, PUMPS, HEATERS, ETC. REFER TO MECHANICAL DEMOLITION PLAN FOR MORE INFORMATION.
10. EXISTING BOX AND CONDUIT IN CONCRETE WALL OR BRICK ARE TO REMAIN. THESE WILL BE UTILIZED FOR NEW DEVICES.
11. REMOVE EXISTING EMERGENCY GENERATOR, ASSOCIATED CONDUIT, CONDUCTORS, DISCONNECTS, TRANSFER SWITCH, ETC.
12. EXISTING PANEL "IT" IS TO REMAIN. LEAVE EXISTING CONDUIT AND CONDUCTORS WHICH POWER THE DEVICES, LIGHTS, FIXTURES, FAN, PUMP, ATC PANEL, ETC. IN THE MECHANICAL ROOM. REMOVE THE FEEDER CONDUIT TO THE EDGE OF THE ROOM. REMOVE CONDUCTORS ALL THE WAY BACK TO ORIGINATION POINTS.
13. EXISTING VFD, DUPLEX OUTLETS, PUMPS, FANS, DUCT DETECTORS, HEAT DETECTORS, PULL STATION, LIGHT SWITCH, LIGHT FIXTURES, ETC. IN MECHANICAL ROOM ARE TO REMAIN.
14. REMOVE EXISTING LIGHT FIXTURE IN THE TUNNEL. EXISTING CONDUCTORS, CONDUIT AND J-BOXS WILL BE UTILIZED FOR NEW LIGHT FIXTURES.
15. EXISTING HANDICAP DOOR OPENER AND CONTROL BUTTONS ARE TO REMAIN. EXISTING PANEL WILL BE TIED TO NEW ELECTRICAL DISTRIBUTION SYSTEM. REMOVE FEEDER CONDUIT AND CONDUCTORS TO THEIR ORIGINATION POINTS.
16. EXISTING LIFT IS TO REMAIN. REMOVE CONDUIT AND CONDUCTOR FROM DISCONNECT ALL THE WAY BACK TO PANELBOARD. NEW FEEDER WILL BE INSTALL IN THE FUTURE.
17. EXISTING ELEVATOR EQUIPMENT AND EXHAUST FAN ARE TO REMAIN. REMOVE EXISTING FEEDER CONDUIT AND CONDUCTOR FROM THE DISCONNECTS ALL THE WAY BACK TO PANELBOARDS. EXISTING DISCONNECTS WILL BE TIED TO NEW DISTRIBUTION PANELBOARD IN THE FUTURE. REMOVE CONDUIT AND CABLE TIED TO EXISTING FIRE ALARM CONTROL PANEL.

GENERAL DEMOLITION NOTES:

1. UNDER DEMOLITION THE INTENT OF ELECTRICAL WORK IS TO REMOVE ALL ELECTRICAL DEVICES, LIGHT FIXTURES, CONDUIT, CONDUCTORS, J-BOXES, FIRE ALARM DEVICES, CAMERAS, BELLS, SPEAKERS, PANELBOARD, VOICE/DATA CABLING, VOICE/DATA OUTLETS, ETC.. CONDUITS AND J-BOXES IN CONCRETE, MASONRY, AND BLOCK WALLS CAN BE LEFT IN THE WALLS AND REUSED FOR NEW DEVICES AS POSSIBLE. ALL ELECTRICAL EQUIPMENT INCLUDING LIGHT FIXTURES, PANELBOARDS, ETC., WILL BE NEW. BUILDING SHALL BE STRIPPED OF ALL MATERIALS.

2. ALL MATERIAL MUST BE REMOVED AND DISPOSED OF BY DEMOLITION CONTRACTOR, UNLESS INDICATED OTHERWISE ON DEMOLITION PLANS.

3. EXISTING DEMOLITION MATERIALS CAN NOT BE REUSED UNLESS INDICATED OTHERWISE.

4. ELECTRICAL CONTRACTOR IS TO PROVIDE TEMPORARY LIGHTING AND POWER FOR OTHER TRADES DURING DEMOLITION WORK. COORDINATE THIS WORK WITH THE GENERAL CONTRACTOR.

5. DEMOLITION CONTRACTOR IS TO REMOVE ALL THE ELECTRICAL DEVICES, FIRE ALARM HEADS, TELEPHONE JACKS, DATA LINES, LIGHT FIXTURES, EXIT SIGNS, ETC., IN THE ENTIRE REMODEL SPACE UNLESS IS INDICATED OTHERWISE. REMOVE ALL CONDUIT, CONDUCTORS, J-BOXES, ETC. CONDUIT AND J-BOXES EMBEDDED IN BLOCK OR CONCRETE WALLS ARE TO REMAIN. CUT THE CONDUIT FLUSH WITH THE WALL OR CEILING AND REMOVE ALL THE CONDUCTORS.

6. DEMOLITION CONTRACTOR IS TO REMOVE ALL ELECTRICAL CONNECTIONS AND CONTROL WIRING TO ALL THE EXISTING MECHANICAL EQUIPMENT IN THE REMODEL AREA, ETC. REMOVE ALL CONDUIT AND CONDUCTORS ALL THE WAY BACK TO PANELBOARDS. COORDINATE THIS WORK WITH MECHANICAL CONTRACTOR.

7. DEMOLITION CONTRACTOR MUST REMOVE THE PANELBOARDS IN THE BRICK, BLOCK OR CONCRETE WALLS TO ALLOW GENERAL CONTRACTOR TO PATCH THE WALLS.

8. ALL MATERIALS TO BE REMOVED FROM THE PREMISES BY THE DEMOLITION CONTRACTOR.

9. PRIOR TO SUBMITTING A BID THE DEMOLITION CONTRACTOR SHALL INSPECT THE SITE AND INCLUDED IN HIS BID PACKAGE ALL CHARGES DUE TO EXISTING CONDITIONS.



MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

E.C.E. INC.
939 So. West Temple
Salt Lake City, Utah 84101
Telephone (801) 521-8007
Telefax (801) 521-8057

SHEPHERD BUILDING REMODEL
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00

ECE PROJECT NO. 2954
DRAWN BY: KB CHECKED BY: AM

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	DEMOLITION

REVISIONS:

NO.	DATE	DESCRIPTION

1ST LEVEL DEMO FLOOR PLAN - ELECTRICAL

DEMOLITION

SHEET NUMBER

ED101A+B

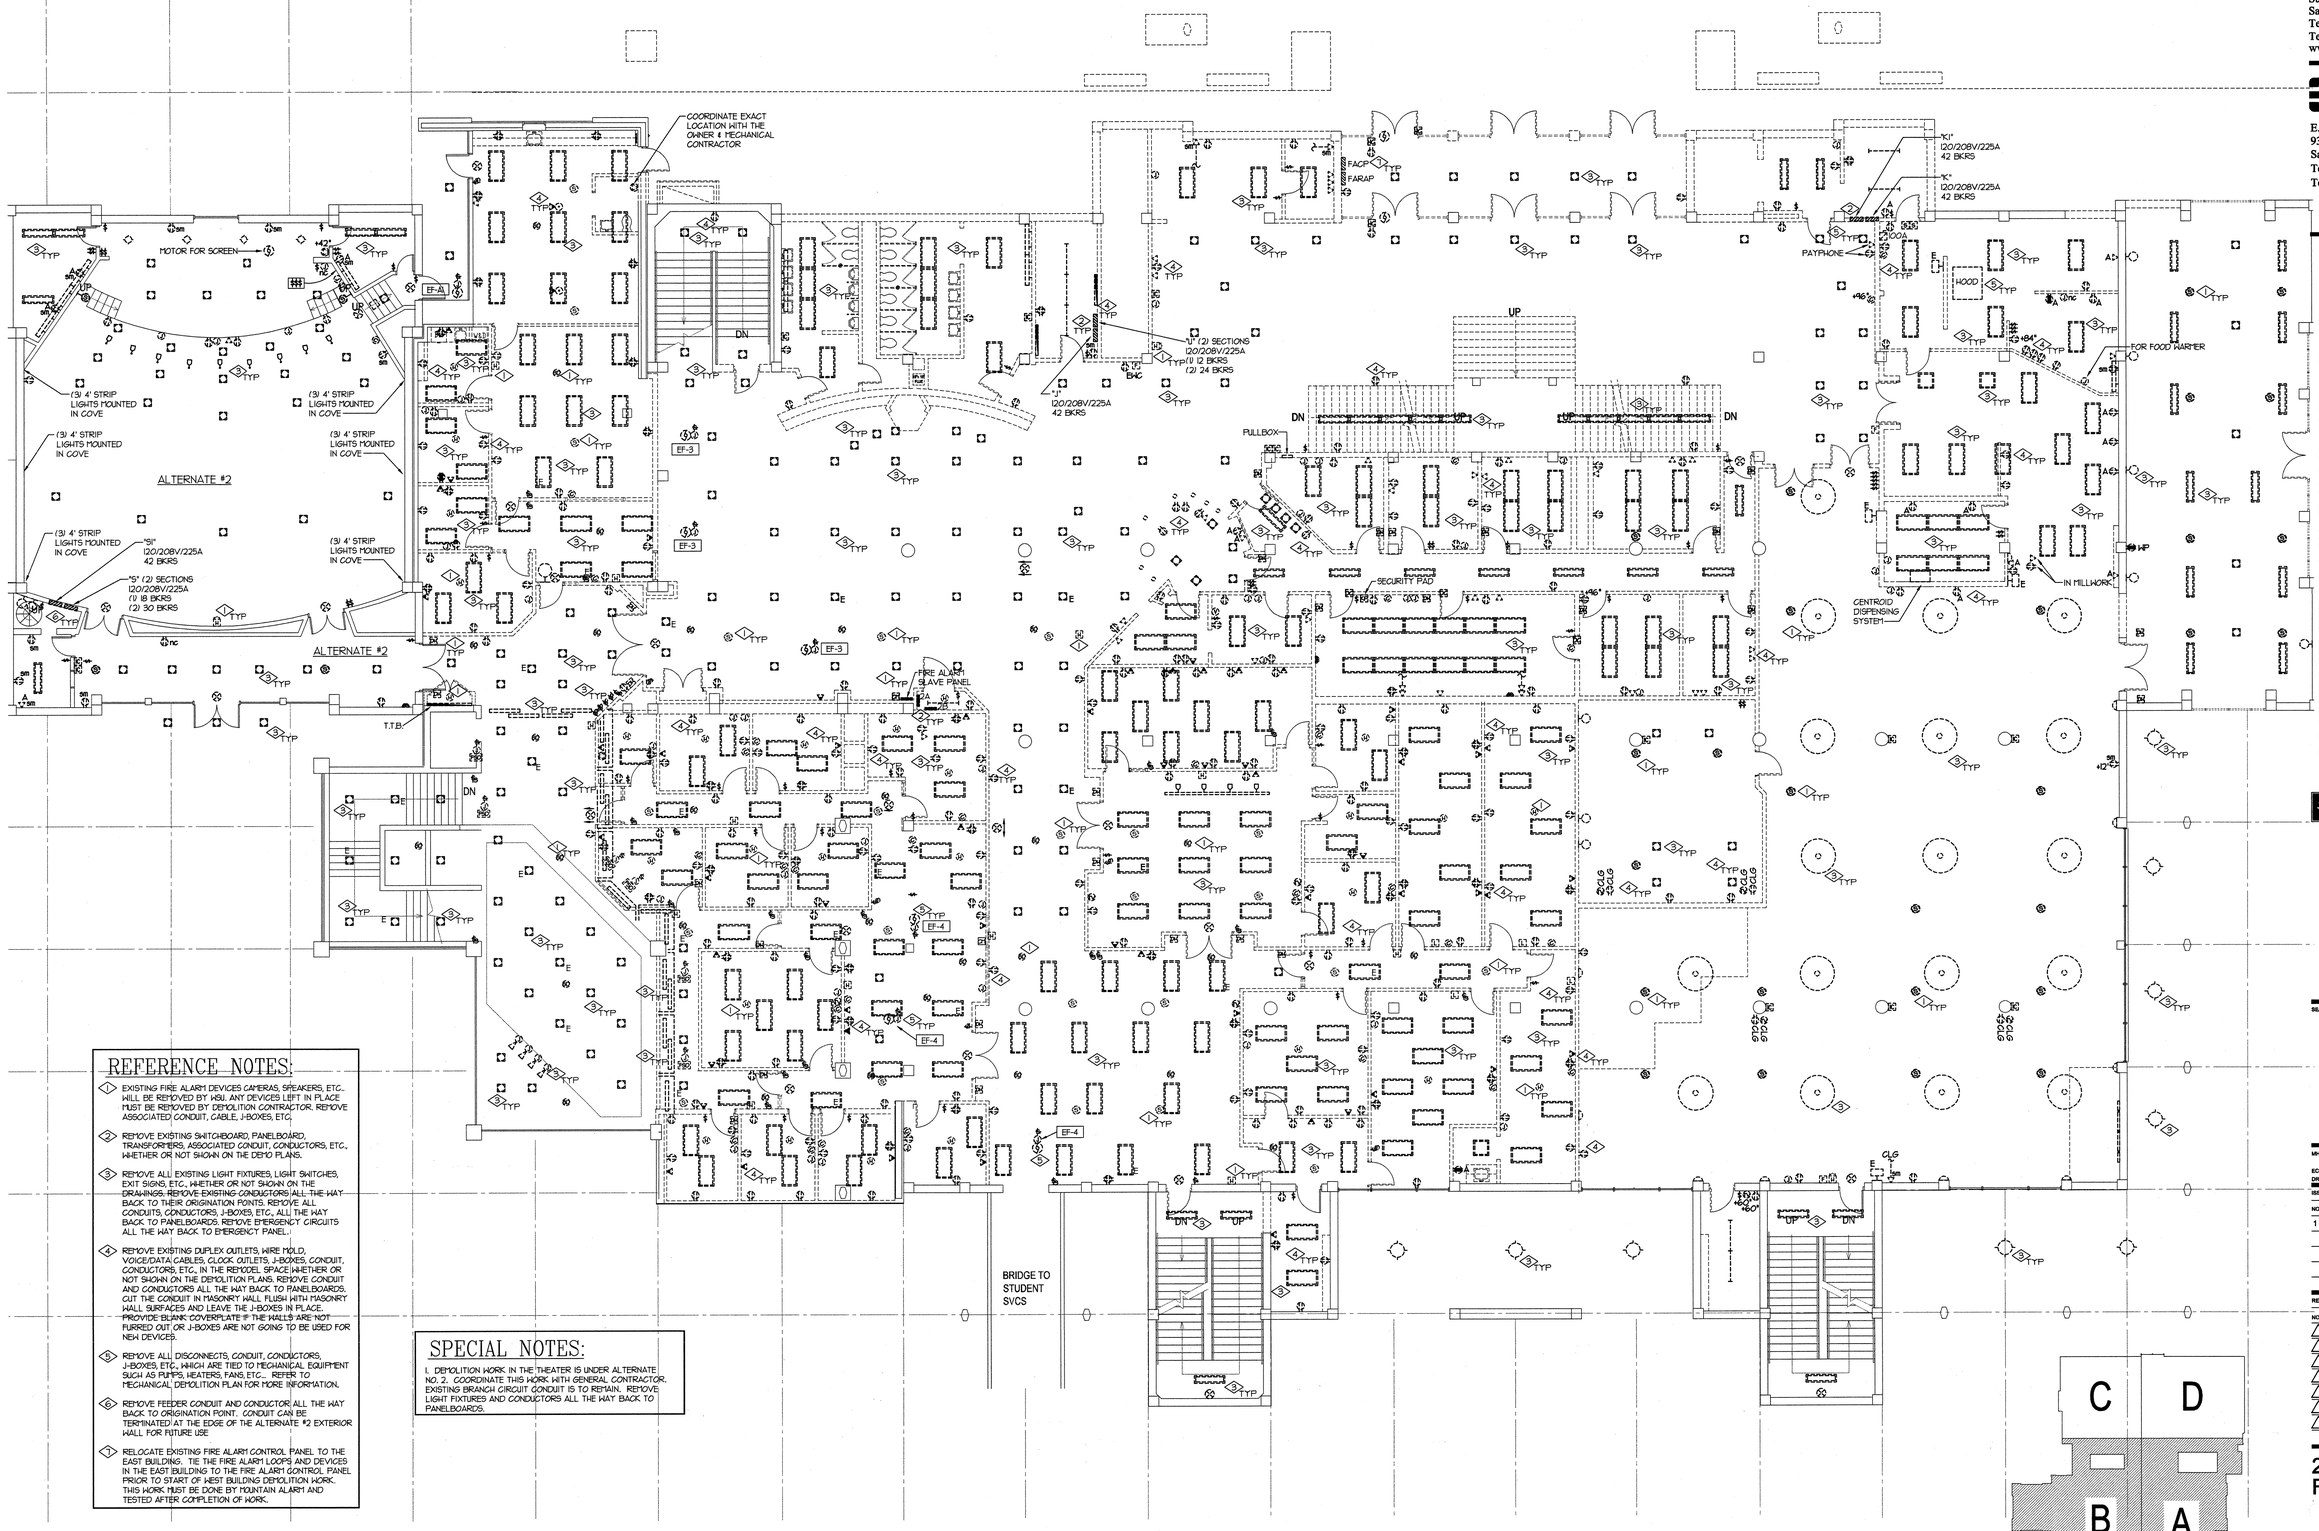

REFERENCE NOTES:

1. EXISTING FIRE ALARM DEVICES (CAMERAS, SPEAKERS, ETC.. WILL BE REMOVED BY HSU. ANY DEVICES LEFT IN PLACE MUST BE REMOVED BY DEMOLITION CONTRACTOR. REMOVE ASSOCIATED CONDUIT, CABLE, J-BOXES, ETC.
2. REMOVE EXISTING SWITCHBOARD, PANELBOARD, TRANSFORMERS, ASSOCIATED CONDUIT, CONDUCTORS, ETC., WHETHER OR NOT SHOWN ON THE DEMO PLANS.
3. REMOVE ALL EXISTING LIGHT FIXTURES, LIGHT SWITCHES, EXIT SIGNS, ETC., WHETHER OR NOT SHOWN ON THE DRAWINGS. REMOVE EXISTING CONDUCTORS ALL THE WAY BACK TO THEIR ORIGINATION POINTS. REMOVE ALL CONDUITS, CONDUCTORS, J-BOXES, ETC., ALL THE WAY BACK TO PANELBOARDS. REMOVE EMERGENCY CIRCUITS ALL THE WAY BACK TO EMERGENCY PANEL.
4. REMOVE EXISTING DUPLEX OUTLETS, WIRE MOLD, VOICE/DATA CABLES, CLOCK OUTLETS, J-BOXES, CONDUIT, CONDUCTORS, ETC., IN THE REMODEL SPACE WHETHER OR NOT SHOWN ON THE DEMOLITION PLANS. REMOVE CONDUIT AND CONDUCTORS ALL THE WAY BACK TO PANELBOARDS. CUT THE CONDUIT IN MASONRY WALL FLUSH WITH MASONRY WALL SURFACES AND LEAVE THE J-BOXES IN PLACE. PROVIDE BLANK COVERPLATE @ THE WALLS ARE NOT FURRED OUT OR J-BOXES ARE NOT GOING TO BE USED FOR NEW DEVICES.
5. REMOVE ALL DISCONNECTS, CONDUIT, CONDUCTORS, J-BOXES, ETC., WHICH ARE TIED TO MECHANICAL EQUIPMENT SUCH AS PUMPS, HEATERS, FANS, ETC.. REFER TO MECHANICAL DEMOLITION PLAN FOR MORE INFORMATION.
6. REMOVE FEEDER CONDUIT AND CONDUCTOR ALL THE WAY BACK TO ORIGINATION POINT. CONDUIT CAN BE TERMINATED AT THE EDGE OF THE ALTERNATE #2 EXTERIOR WALL FOR FUTURE USE.
7. RELOCATE EXISTING FIRE ALARM CONTROL PANEL TO THE EAST BUILDING. TIE THE FIRE ALARM LOOPS AND DEVICES IN THE EAST BUILDING TO THE FIRE ALARM CONTROL PANEL PRIOR TO START OF WEST BUILDING DEMOLITION WORK. THIS WORK MUST BE DONE BY MOUNTAIN ALARM AND TESTED AFTER COMPLETION OF WORK.

SPECIAL NOTES:

1. DEMOLITION WORK IN THE THEATER IS UNDER ALTERNATE NO. 2. COORDINATE THIS WORK WITH GENERAL CONTRACTOR. EXISTING BRANCH CIRCUIT CONDUIT IS TO REMAIN. REMOVE LIGHT FIXTURES AND CONDUCTORS ALL THE WAY BACK TO PANELBOARDS.

N

2ND LEVEL DEMO FLOOR PLAN – A+B – ELECTRICAL

SCALE: 1/8" = 1'-0"



MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

E.C.E. INC.
939 So. West Temple
Salt Lake City, Utah 84101
Telephone (801) 521-8007
Telefax (801) 521-8057

SHEPHERD BUILDING REMODEL
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 20055556.00
ECE PROJECT NO. 2954
DRAWN BY: KB CHECKED BY: AM

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	DEMOLITION

REVISIONS:

NO.	DATE	DESCRIPTION

2ND LEVEL FLOOR PLAN - ELECTRICAL

DEMOLITION

SHEET NUMBER

ED102A+B

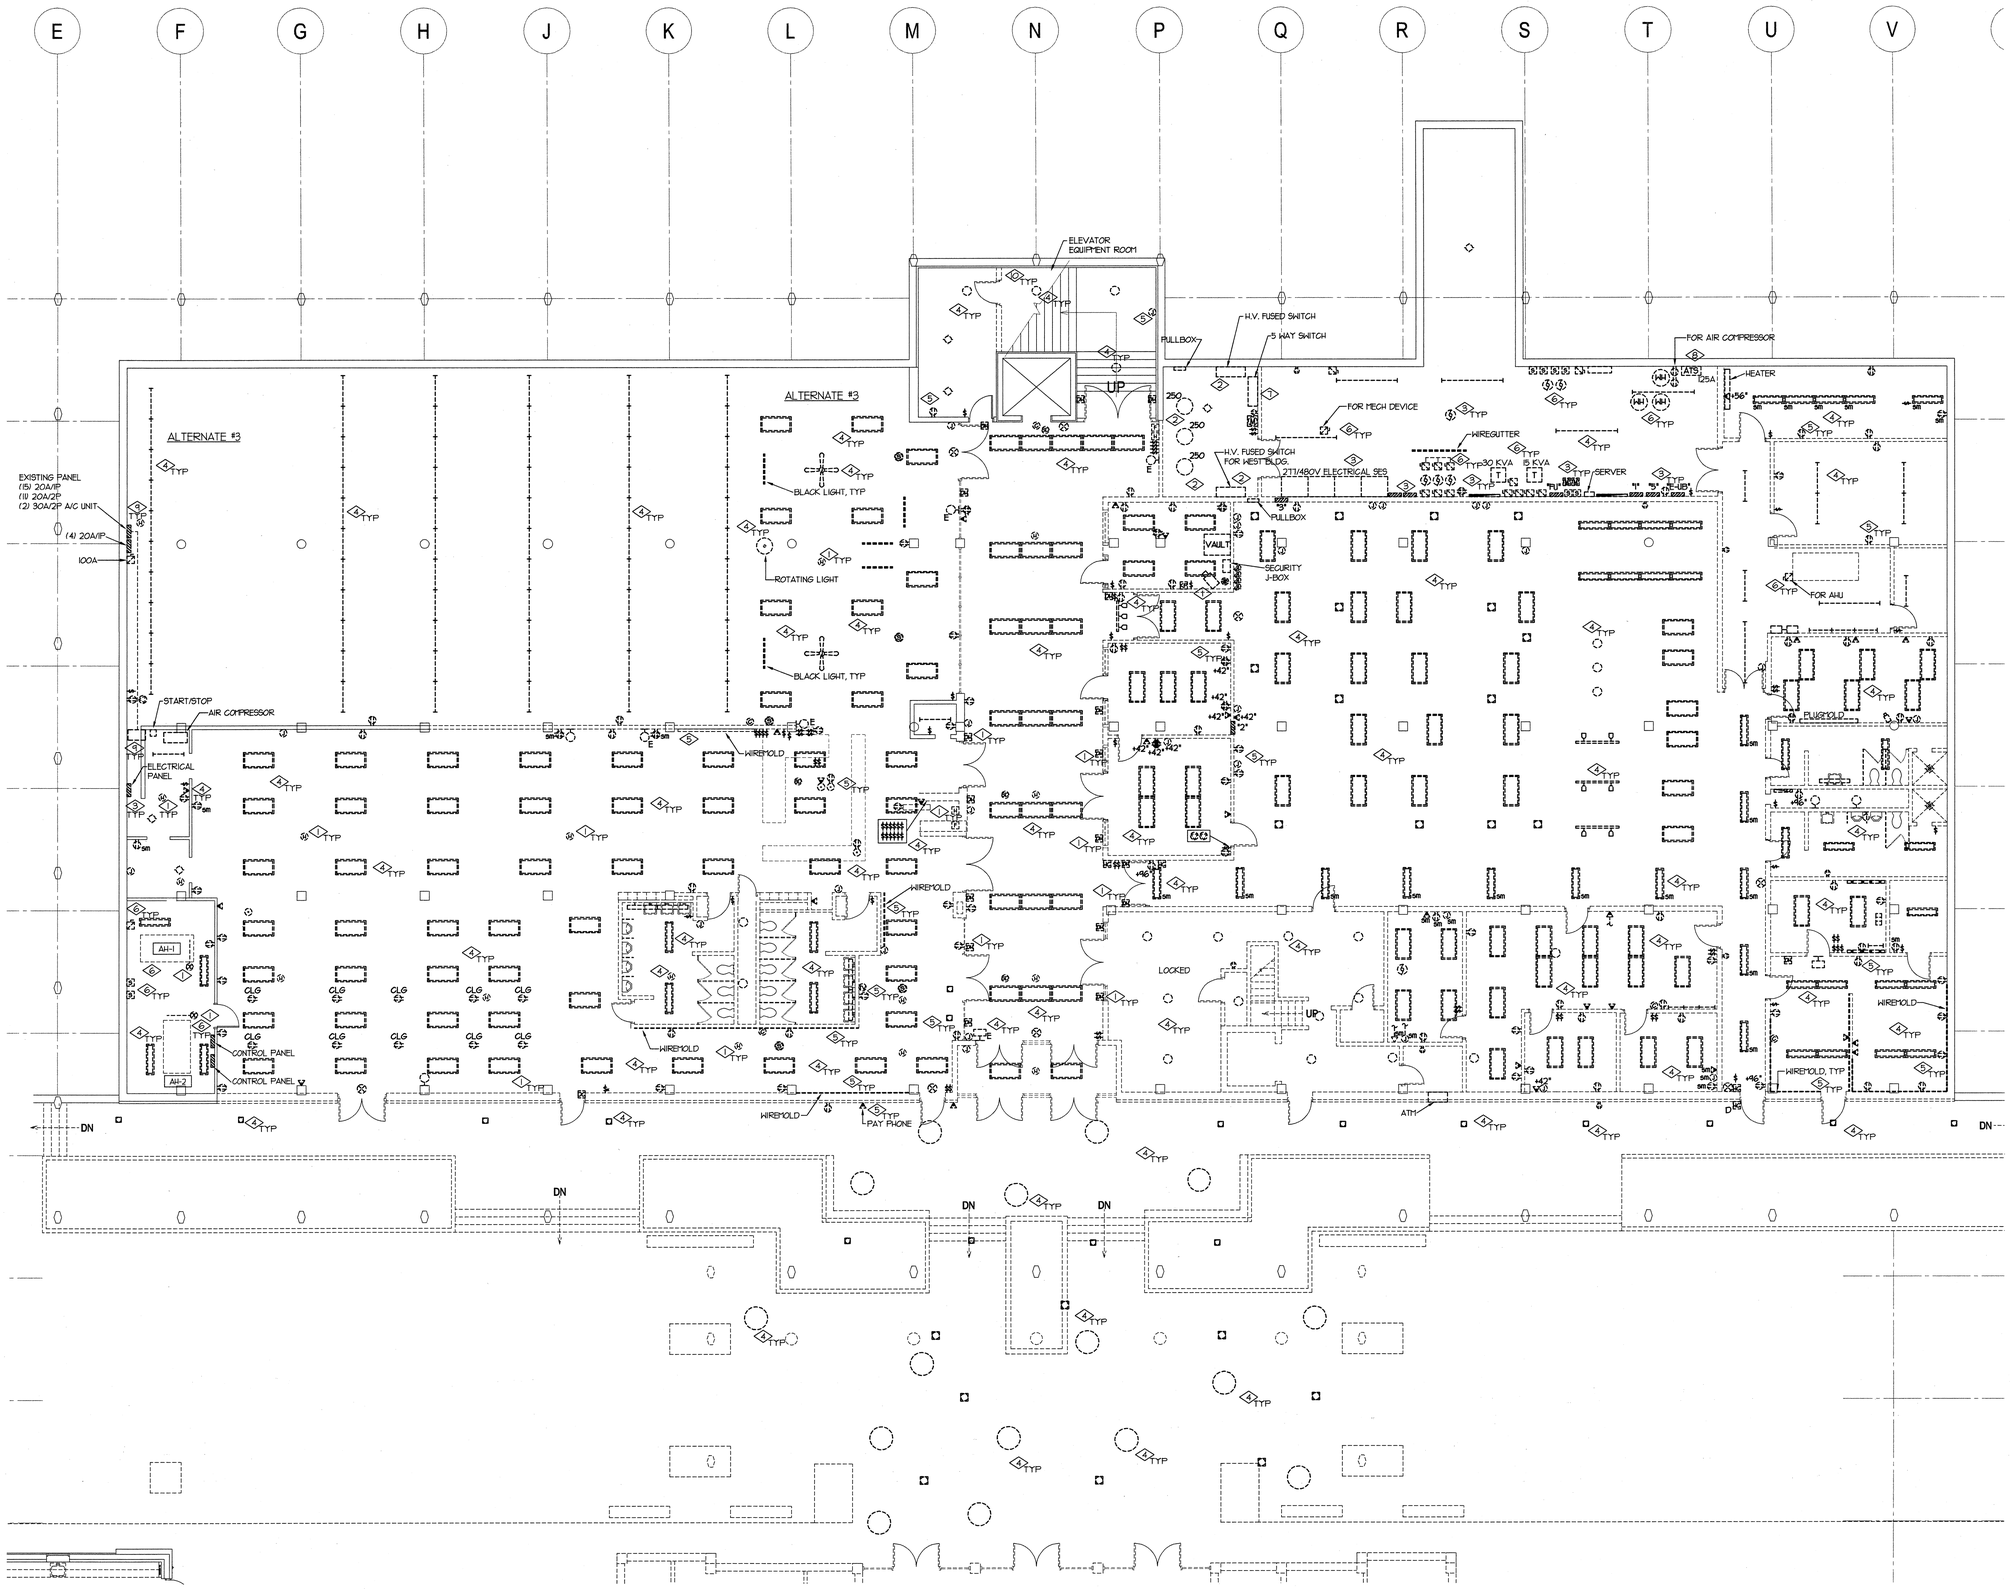

N 2ND LEVEL DEMO FLOOR PLAN - C+D - ELECTRICAL

SCALE: 1/8" = 1'-0"

REFERENCE NOTES:

1. EXISTING FIRE ALARM DEVICES CAMERAS, ETC., WILL BE REMOVED BY WSU. ANY DEVICES LEFT IN PLACE MUST BE REMOVED BY DEMOLITION CONTRACTOR. REMOVE ASSOCIATED CONDUIT, CABLE, J-BOXES, ETC.
2. REMOVE EXISTING H.V. TRANSFORMERS, H.V. SWITCH ASSOCIATED CONDUIT, CONDUCTORS, ETC.
3. REMOVE EXISTING SWITCHBOARD, PANELBOARD, TRANSFORMERS, ASSOCIATED CONDUIT, CONDUCTORS, ETC., WHETHER OR NOT SHOWN ON THE DEMO PLANS.
4. REMOVE ALL EXISTING LIGHT FIXTURES, LIGHT SWITCHES, EXIT SIGNS, ETC., WHETHER OR NOT SHOWN ON THE DRAWINGS. REMOVE EXISTING CONDUCTORS ALL THE WAY BACK TO THEIR ORIGINATION POINTS. REMOVE ALL CONDUITS, CONDUCTORS, J-BOXES, ETC., ALL THE WAY BACK TO PANELBOARDS. REMOVE EMERGENCY CIRCUITS ALL THE WAY BACK TO EMERGENCY PANEL.
5. REMOVE EXISTING DUPLEX OUTLETS, WIRE MOLD, VOICE/DATA CABLES, CLOCK OUTLETS, J-BOXES, CONDUIT, CONDUCTORS, ETC., IN THE REMODEL SPACE WHETHER OR NOT SHOWN ON THE DEMOLITION PLANS. REMOVE CONDUIT AND CONDUCTORS ALL THE WAY BACK TO PANELBOARDS. CUT THE CONDUIT IN MASONRY WALL FLUSH WITH MASONRY WALL SURFACES AND LEAVE THE J-BOXES IN PLACE. PROVIDE BLANK COVERPLATE IF THE WALLS ARE NOT FURRED OUT OR J-BOXES ARE NOT GOING TO BE USED FOR NEW DEVICES.
6. REMOVE ALL DISCONNECTS, CONDUIT, CONDUCTORS, J-BOXES, ETC., WHICH ARE TIED TO MECHANICAL EQUIPMENT SUCH AS PUMPS, HEATERS, FANS, ETC. REFER TO MECHANICAL DEMOLITION PLAN FOR MORE INFORMATION.
7. REMOVE EXISTING 5-WAY H.V. SWITCH AFTER ALL THE CIRCUITS ARE MOVED TO NEW PAD MOUNTED SWITCH ON GRADE OUTSIDE OF BUILDING.
8. REMOVE EXISTING AUTOMATIC TRANSFER SWITCH AND RETURN TO OWNER. REMOVE THE FEEDER CONDUIT TO THE EDGE OF THE TUNNEL AND PROVIDE A TAG FOR IT. PULL THE FEEDER CONDUCTORS OUT ALL WAY TO THE EMERGENCY SWITCHBOARD LOCATED SOUTH OF LAMPROS HALL. LEAVE CONDUIT IN PLACE.
9. UNDER ALTERNATE #3 THE EXISTING PANEL BOARDS IN BOWLING ALLEY ARE TO BE REMOVED. REMOVE EXISTING FEEDER AND BRANCH CIRCUITS CONDUIT AND CONDUCTORS ALL THE WAY TO THEIR POINT OF ORIGINATION. UNDER BASE BID REMOVE EXISTING FEEDER CONDUIT AND CONDUCTORS ONLY.
10. EXISTING ELEVATOR EQUIPMENT WITH ASSOCIATED DISCONNECT ARE TO REMAIN. REMOVE FEEDER CONDUIT AND CONDUCTORS FROM THE DISCONNECT ALL THE WAY BACK TO ORIGINATION POINT. COORDINATE WITH GENERAL CONTRACTOR. REMOVE FIRE ALARM CONNECTIONS (CONDUIT, CABLES, ETC).

SPECIAL NOTE:

1. DEMOLITION WORK IN THE BOWLING ALLY IS UNDER ALTERNATE #3. COORDINATE THIS WORK WITH GENERAL CONTRACTOR.

MHTN ARCHITECTS, INC.
420 East South Temple
Suite 100
Salt Lake City, Utah 84111
Telephone (801) 595-6700
Telefax (801) 595-6717
www.mhtn.com

E.C.E. INC.
939 So. West Temple
Salt Lake City, Utah 84101
Telephone (801) 521-8007
Telefax (801) 521-8057

SHEPHERD BUILDING REMODEL
WEBER STATE UNIVERSITY
OGDEN CAMPUS OGDEN, UTAH

UTAH STATE DIVISION OF FACILITIES CONSTRUCTION & MANAGEMENT
DFCM PROJECT NO. 03215810

SEAL

MHTN PROJECT NO. 2005556.00
ECE PROJECT NO. 2954
DRAWN BY: KB CHECKED BY: AM

ISSUED:

NO.	DATE	DESCRIPTION
1	2/15/06	DEMOLITION

REVISIONS:

NO.	DATE	DESCRIPTION



2ND LEVEL DEMO FLOOR PLAN - ELECTRICAL

DEMOLITION

SHEET NUMBER

ED102C+D