



State of Utah

JON M. HUNTSMAN, JR.
Governor

GARY R. HERBERT
Lieutenant Governor

Department of Administrative Services

RICHARD K. ELLIS
Executive Director

Division of Facilities Construction and Management

F. KEITH STEPAN
Director

ADDENDUM # 1

Date: 07-17-2006

To: Contractors

From: Craig Wessman, Project Manager, DFCM

Reference: Computer Center Electrical & AC Upgrades
Weber State University
DFCM Project No. 06167810


Subject: **Addendum No. 1**

Pages: Addendum Cover 1 Page
Specification and Drawing Modifications 4 Pages
5 Pages

Note: This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

1.1 See Attached pages.

End of Addendum



HFS ARCHITECTS

1484 South State Street
Salt Lake City, Utah 84115
801-596-0691 • Fax: 596-0693 • www.hfsa.com

Addendum No. 01

Project:	Computer Center Electrical & AC Upgrades	Date:	17 July 2006
Address:	Tech Ed Building, WSU	Project No.:	0612.01
City, State:	Ogden, Utah	Owner No.:	06167810
Owner:	DFCM	Agency:	Weber State University

To all Bidders of Record:

This addendum forms a part of the contract documents and modifies the original specifications and drawings as noted below. Items of general information are included without reference to the plans and specifications. Revisions to the specifications are referenced by page number and paragraph heading on that page. Revisions to the drawings are reference by the drawing number. Unless otherwise stated, any changes herein offset only the specific drawings, words, or paragraphs mentioned, and the balance of the drawings and specifications remain in full force. Acknowledge receipt of this addendum in the space provided on the Bid form. Failure to do so will subject the Bidder to disqualification.

ARCHITECTURAL ADDENDUM

Item No.	Section or Sheet No.	Description
----------	----------------------	-------------

General Items:

1 -1	Demolition	Remove security bars from behind the east windows, as shown in the picture below, six (6) sets total.
------	------------	---



Specifications Items:

1 -2 None.

Drawing Items:

1 -3 None.

Prior Approvals:

1 -4 None.

Attachments:

1 -5 Electrical Addendum, 1 page

1 -6 Computer Rooms Grounding Plan Drawing, 1 page

COMPUTER CENTER AIR CONDITIONING & ELECTRICAL UPGRADES

WEBER STATE UNIVERSITY
OGDEN, UTAH


DFCM PROJECT NO. 06167810

ELECTRICAL ADDENDUM ITEMS

1. ADD COMPUTER ROOM GROUNDING SYSTEM:

- A. Change ground conductor shown on First Floor Electrical Reference Plan A1/E-101 from #8 Gnd, 3/4" Conduit to #2 Gnd, 1" Conduit.
- B. Terminate the new #2 Ground conductor on new ground bus in IT Computer Room 212 and connect to new weatherhead mast, existing computer equipment, existing cable tray, existing UPS feeder ground, existing fire sprinkler riser, etc., as shown on attached Drawing ESD-1.
- C. Upon completion of all work in the Computer Rooms, measure amperage draw on each branch circuit and feeder to Panels 'A1', 'A2', 'A3', and 'A4'. Include measurement of all phase, neutral, and ground conductors.
 - 1) Make amperage measurements during times when computer room is in normal operation, to be coordinated with Owner.
 - 2) Record all measurements in a neat tabulated form to be approved by Architect prior to making measurements.

Attachments: Drawing ESD-1, Computer Rooms Grounding Plan

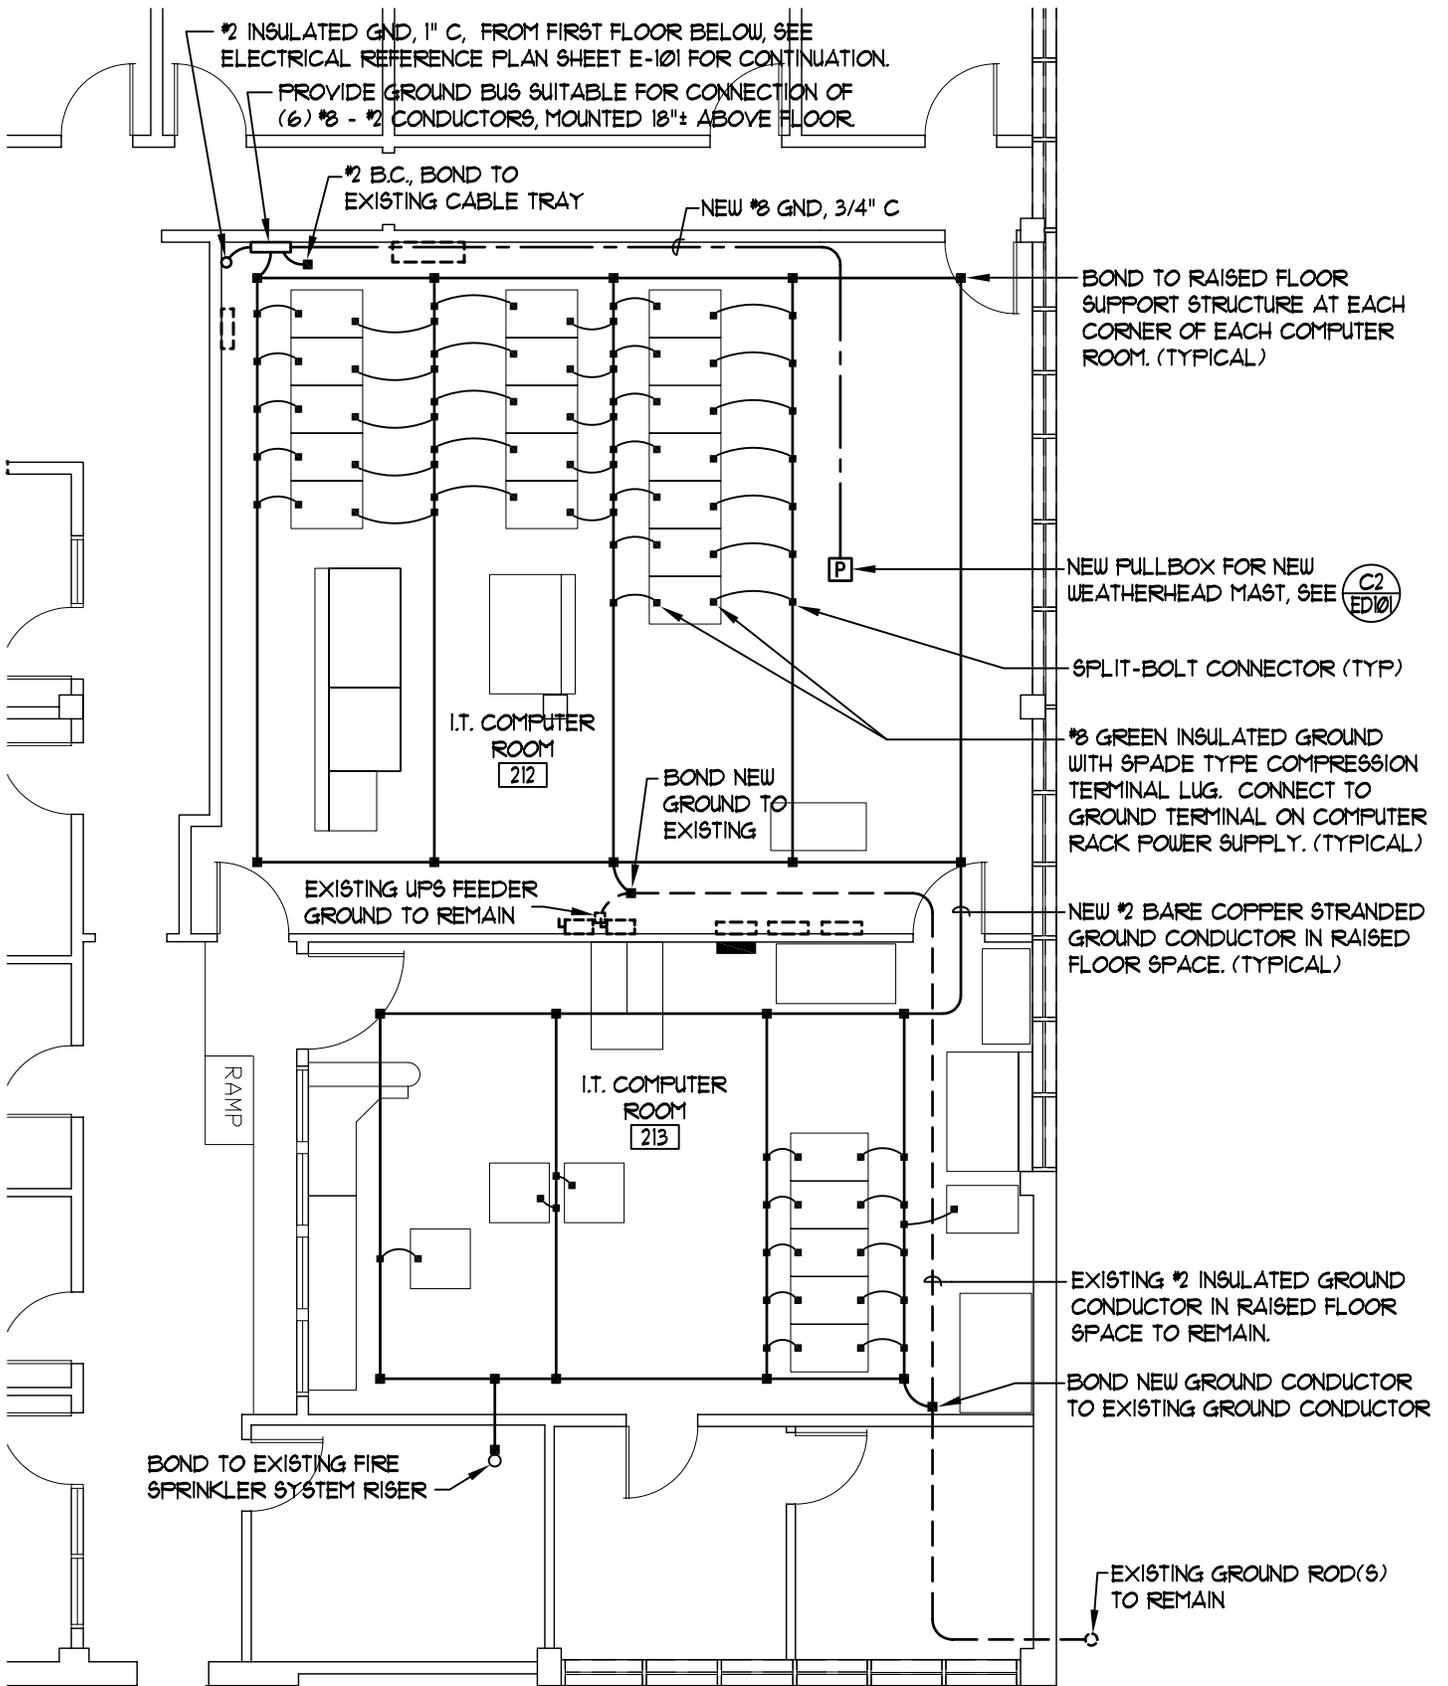

A1

COMPUTER ROOMS GROUNDING PLAN

SCALE: 1/8" = 1'-0"

0 4' 8' 16'



NORTH