



State of Utah

JON M. HUNTSMAN, JR.
Governor

GARY R. HERBERT
Lieutenant Governor

Department of Administrative Services

KIMBERLY K. HOOD
Executive Director

Division of Facilities Construction and Management

DAVID G. BUXTON
Director

ADDENDUM #1

Date: 12 May 2008

To: Interested Parties

From: Jim Russell, Project Manager

Reference: Department of Alcoholic Beverage Control
Taylorsville Liquor Store Remodel & Addition
DFCM Project No. 06306030

Subject: **Addendum No. 1**

Pages	Addendum	1	page
	<u>Architectural Specs & Drawings</u>	<u>14</u>	<u>pages</u>
	Total	15	pages

Note: *This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum.*

While we contend that SB220 should only be potentially applicable to a contract issued after the effective date of said bill, this is to clarify that for purposes of this contract, regardless of the execution or effective dates of this contract, the status of Utah Law and remedies available to the State of Utah and DFCM, as it relates to any matter referred to or affected by said SB220, shall be the Utah law in effect at the time of the issuance of this Addendum.

- 1.1 **SCHEDULE CHANGES** – There are no changes to the Project Schedule.
- 1.2 **GENERAL ITEMS** – See attached architectural specifications and drawings. Issued Monday, May 12, 2008. Frank N. Murdock Jr. Architect & Associates Addendum consists of seven (7) 8 1/2" x 11" sheets, seven (7) 30" x 42" revised drawings (G001r, AS102r, A101r, A104r, S201 and P2.1r).

End of Addendum #1

Department of Alcoholic Beverage Control
Taylorsville Liquor Store Remodel & Addition
Addendum A01

Addendum No. A01

Issued Monday, May 12, 2008

PROJECT

**Department of Alcoholic Beverage Control
Taylorsville Liquor Store Remodel & Addition - DFCM Project No. 06306030**

ARCHITECT

**Frank N. Murdock Jr. Architect & Associates
975 East 100 South
Salt Lake City, Utah 84102
(801) 532-4441**

The original Contract Documents issued for the above noted projects are amended as noted in this Addendum. It shall be the sole responsibility of the bidder to appropriately disseminate this data to all concerned, prior to the assigned bid time and date.

Receipt of this Addendum shall be acknowledged by inserting its number and date in the appropriate space provided on the bid form. This Addendum consists of seven (7) 8 1 / 2" x 11" sheets, seven (7) 30" x 42" revised drawings (G001r, AS101r, AS102r, A101r, A104r, S201 and P2.1r).

DRAWINGS:

- a. SHEET G001: Replace Sheet G001 with Sheet G001r. Correct project address is noted on revised sheet.
- b. SHEET AS101: Replace Sheet AS101 with Sheet AS101r. Key Note D deleted, Key Note G revised, Site Plan modified to show concrete paving in new parking area in lieu of asphalt paving, scales on title blocks revised.
- c. SHEET AS102: Replace Sheet AS102 with Sheet AS102r. Roof drains tied to sumps, invert elevations noted and scales on title blocks revised.
- c. SHEET A101: Replace Sheet A101 with Sheet A101r. Demolition Note 7 revised, wainscot on masonry walls in dock area removed on Enlarged Plan 2/A101r.
- d. SHEET A104: Replace Sheet A104 with Sheet A104r. Detail 21/A104 revised to reference rubber base on the storage side of the base. Detail 22/A104 revised to require four (4) display cases to be provided on this project. Details 13/A104, 24/A104 and 25 A/104 revised to show carpet tiles in lieu of VCT as the floor covering in the office and carpet in lieu of VCT on the stairs to the office.
- e. SHEET P2.1r: Replace Sheet P2.1 with Sheet P2.1r. Locations of existing roof drains revised and related plumbing lines revised.
- f. SHEET S201: Revised to include Details D-2, E-3, E-4, E-5 and E-6, which detail

the new office platform. Provide "X" brace at three (3) locations.

- g. See attached Water Details Sheet TBID-1 as provided by Taylorsville-Bennion Improvement District.

CLARIFICATIONS & REQUIREMENTS:

1. Contractor shall remove and seal existing scuppers on the existing roof to provide proper tie-in with new roofing system. Provide new primary and secondary roof drains in accordance with mechanical drawings.

SPECIFICATIONS:

1. Specification Section 09680-Carpet is added. Also add this section to the table of contents under "DIVISION 9 - FINISHES" and the index page "DIVISION 9 - FINISHES".
2. Specification Section 11160 - change Paragraph 2.2., A. to read, "Type: Double Tier lockers, 15" wide by 15" deep, with sloped hoods and "Z" type metal base.

END OF DOCUMENT



State of Utah—Department of Administrative Services

DIVISION OF FACILITIES CONSTRUCTION
AND MANAGEMENT

4110 State Office Building/Salt Lake City, Utah 84114/538-3018

TAYLORSVILLE ABC STORE - REMODEL AND EXPANSION

DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL

3905 WEST 5400 SOUTH, TAYLORSVILLE, UTAH

DFCM PROJECT NO. 06306030



APRIL 2008

CONSTRUCTION DRAWINGS

SITE INFORMATION


PARKING STALLS	27 STALLS
ACCESSIBLE STALLS	2 STALLS
PARKING TOTALS	29 STALLS

SITE DRAWINGS

SEE SHEET AS101 FOR GENERAL SITE INFORMATION AND DIMENSIONS
 SEE SHEET AS102 FOR SITE GRADING AND STORM SEWER INFORMATION
 SEE SHEET AS103 FOR SITE UTILITY INFORMATION
 SEE SHEET AS501 FOR SITE DETAIL INFORMATION

SITE PLAN LEGEND

- CATCH BASIN
- ⊗ STORM DRAIN MAN HOLE
- ⊕ POWER POLE
- ⊕ WATER VALVE
- ⊕ ELECTRIC BOX
- ⊕ FIRE HYDRANT
- ⊕ SANITARY SEWER MAN HOLE
- ⊕ LIGHT POST
- ⊕ STREET LIGHT BOX
- ⊕ GAS METER
- ⊕ TELEPHONE BOX
- PL PROPERTY LINE
- L LANDSCAPE AREA
- SW SIDEWALK
- OVERHEAD TRANSMISSION LINE
- UNDERGROUND POWER
- SS SANITARY SEWER
- W WATER LINE
- T TELEPHONE LINE
- G GAS LINE
- C CABLE T.V.
- PARKING STALLS
- x FENCE
- 4434 EXISTING GRADE CONTOUR
- ① NEW GRADE CONTOUR
- CENTER LINE OF ROAD
- x-x NEW SECURITY FENCE - SEE 22/AS501
- ⓐ SIGN TYPES - SEE 2/AS501
- NEW CONCRETE PAVING AND SIDEWALKS
- ROADWAY, SERVICE AND DOCK AREA (CONCRETE)
- 2 - 4" PVC PIPE SLEEVE
- T.O.G TOP OF GRADE
- I.E. INVERT ELEVATION
- T.O.SW TOP OS SIDEWALK
- T.O.PV TOP OF PAVEMENT
- T.O.C. TOP OF CONCRETE

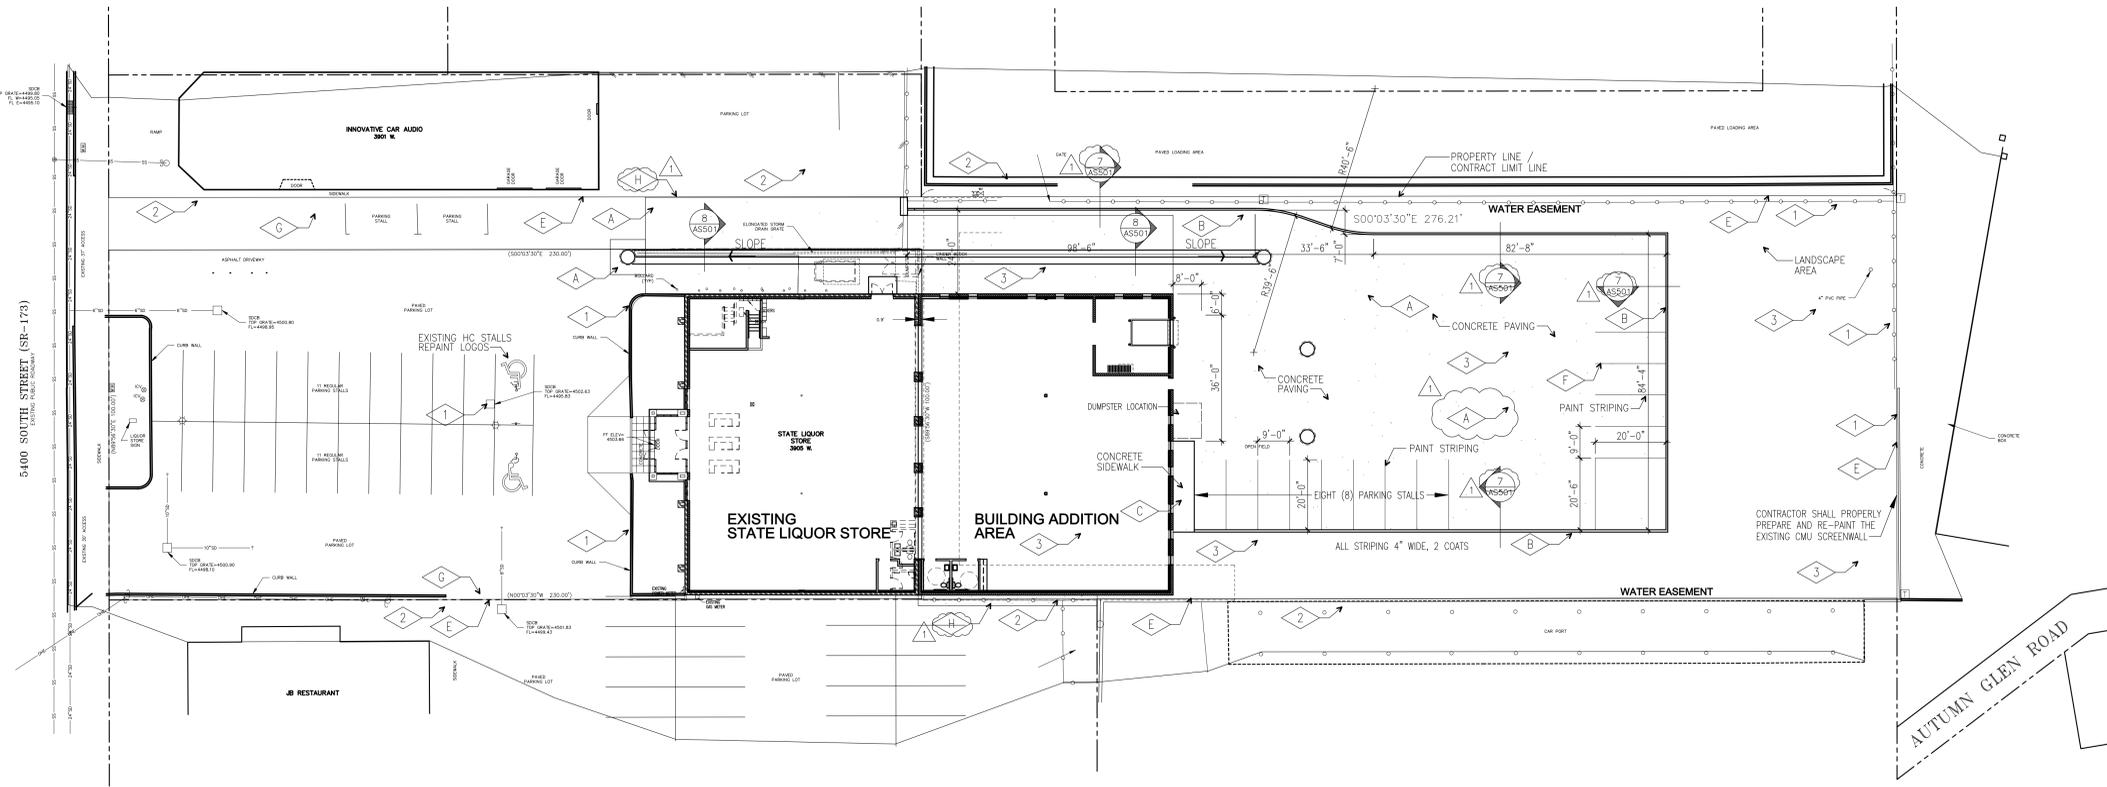

SITE PLAN
 SCALE: 1" = 20'-0"
 0 10' 20' 40'

GENERAL NOTES


- REFER TO SITE DEVELOPMENT, LANDSCAPE, MECHANICAL AND ELECTRICAL DRAWINGS FOR DIMENSIONS AND ADDITIONAL SITE INFORMATION.
- CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS. NOTIFY ARCHITECT OF ANY DISCREPANCIES TO THE CONTRACT DOCUMENTS.
- PROVIDE POSITIVE DRAINAGE AWAY FROM BUILDINGS AT ALL POINTS.
- CONTRACTOR SHALL NOT PARK, STORE EQUIPMENT, OR USE THE EXISTING ROAD FOR ANY PURPOSE OTHER THAN ACCESS TO THE PROJECT SITE. CONTRACTOR SHALL NOT DISTURB OR USE ANY AREA OUTSIDE CONTRACT LIMIT LINE TO PARK OR STORE EQUIPMENT.
- CONTRACTOR WILL MAINTAIN AND PROTECT ALL EXISTING UTILITIES DURING CONSTRUCTION.
- ALL CUTTING, PATCHING, EXCAVATION AND BACKFILL DONE IN STREET SHALL BE DONE IN ACCORDANCE WITH UTAH DEPARTMENT OF TRANSPORTATION SPECIFICATIONS.
- PROVIDE PIPE SLEEVES WHERE SPRINKLER LINES PASS UNDER ASPHALT PAVEMENT OR RETAINING WALLS.
- PROTECT ANY EXISTING STORM DRAINS FROM MUD AND DEBRIS DURING CONSTRUCTION.

REFERENCE NOTES

- ① MAINTAIN AND PROTECT EXISTING SITE ELEMENTS TO REMAIN INCLUDING EXISTING LANDSCAPING, SIDEWALKS, STORM DRAIN BASIN, ASPHALT AND CURBS & GUTTERS. MAINTAIN AND PROTECT EXISTING LANDSCAPING TO REMAIN DURING CONSTRUCTION.
- ② MAINTAIN AND PROTECT EXISTING SITE ELEMENTS ON ADJACENT PROPERTIES. IMMEDIATELY REPAIR OR REPLACE ANY DAMAGE TO ADJACENT PROPERTY CAUSED BY WORK ASSOCIATED WITH THIS CONTRACT.
- ③ REMOVE AND PROPERLY DISPOSE OF EXISTING LANDSCAPING INCLUDING ALL TREES AND SHRUBS ON SITE. SEE SOILS REPORT FOR THE DEPTH OF GRUBBING IN THIS AREA.
- ④ SAW CUT, REMOVE AND PROPERLY DISPOSE OF EXISTING CONCRETE CURB AND CURB WALLS AND PREPARE FOR NEW PAVING.
- ⑤ REMOVE AND PROPERLY DISPOSE OF ANY ASPHALT CONCRETE PAVING. REQUIRED FOR THE INSTALLATION OF NEW CONSTRUCTION. SAW CUT ALL EDGES.


KEY NOTES

- A NEW CONCRETE PAVING. SEE DETAIL 10/AS501 FOR PAVEMENT SECTION. SEE SOILS REPORT FOR DEPTH OF FILL AND COMPACTION REQUIREMENTS IN THIS AREA.
- B NEW CONCRETE CURB & GUTTER. SEE DETAIL 6/AS501
- C NEW 4" THICK CONCRETE SIDEWALK. SEE DETAILS 11, 12 & 13 SHEET AS501 ALIGN WITH EDGES, WIDTH AND ELEVATIONS OF EXISTING SIDEWALKS WHERE NEW AND EXISTING SIDEWALKS MEET. JOINTS AS NOTED BELOW TYPICAL UNLESS NOTED OTHERWISE. CONTROL JOINT IN CONCRETE SIDEWALK. EXPANSION JOINT IN CONCRETE SIDEWALK @ 5'-0" O.C. - SEE DETAIL 12/AS501 @ 20'-0" O.C. - SEE DETAIL 13/AS501.
- D NEW CONCRETE PAVING. SEE DETAIL 10/AS501 FOR PAVEMENT SECTION. SEE SOILS REPORT FOR DEPTH OF FILL AND COMPACTION REQUIREMENTS IN THIS AREA.
- E PROPERTY LINE
- F NEW PARKING STRIPING SEE DETAIL 3/AS501
- G EXISTING ASPHALT ROADWAY. MAINTAIN AND PROTECT. KEEP CLEAR OF MUD AND DEBRIS FROM WORK UNDER THIS CONTRACT
- H SAW CUT EXISTING ASPHALT TO ALLOW FOR NEW CONSTRUCTION. INSTALL NEW ASPHALT PAVING TO MATCH EXISTING ASPHALT GRADES

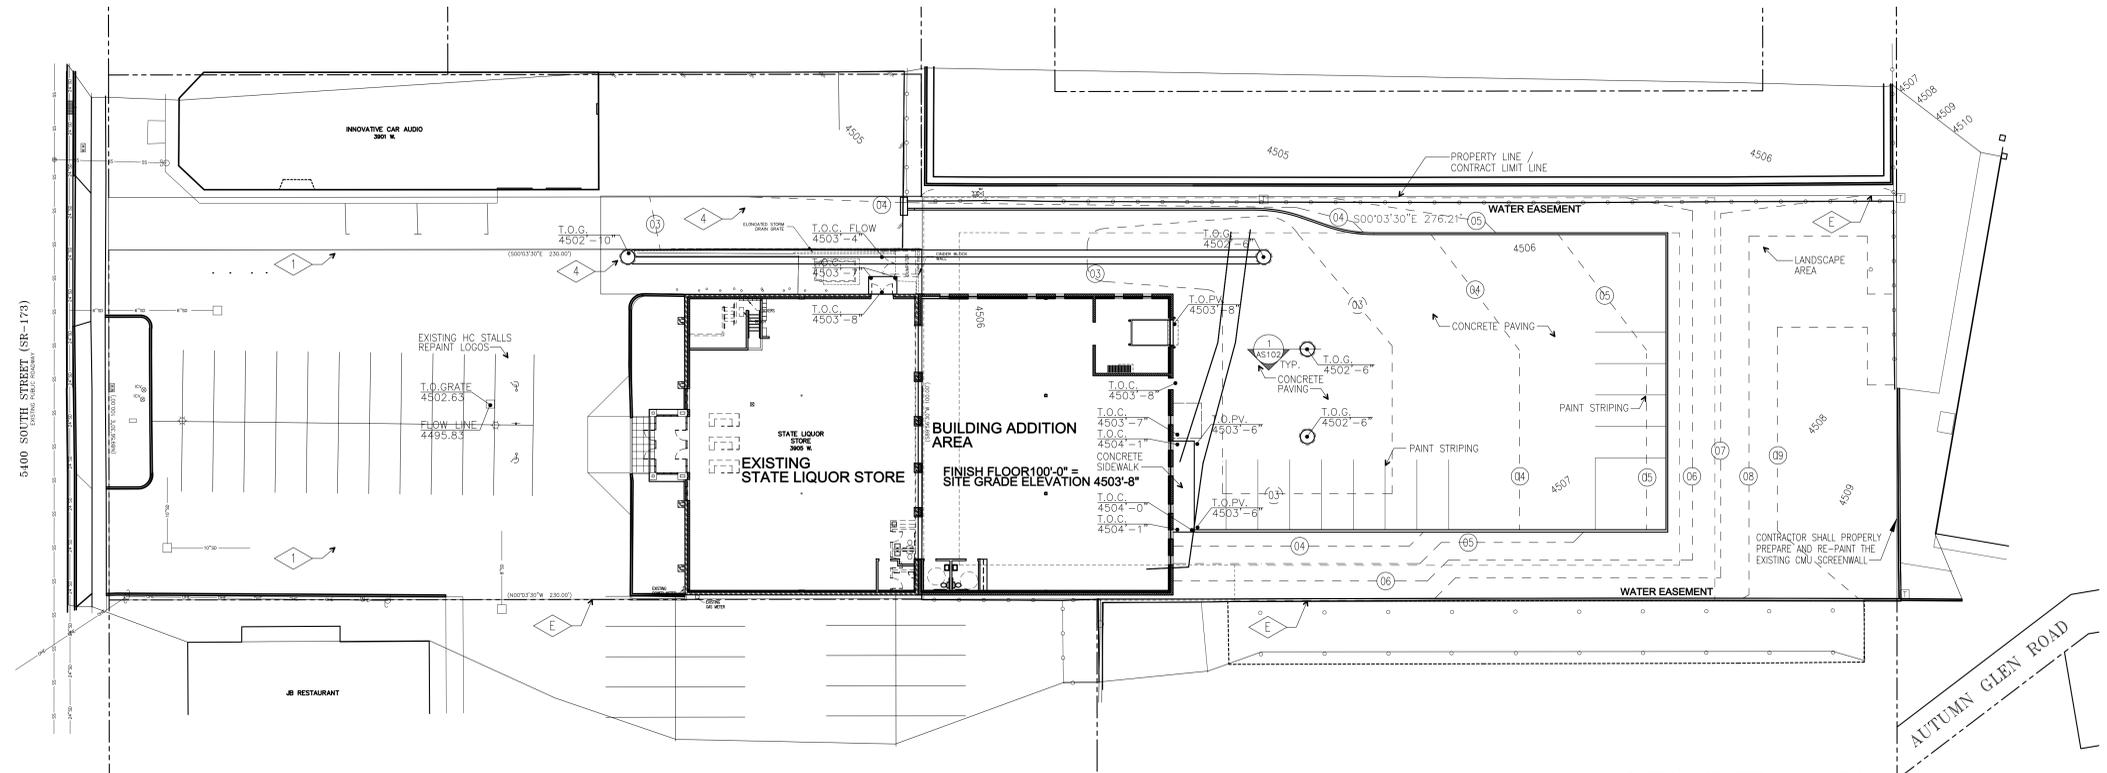

SITE GRADING PLAN
 SCALE: 1" = 20'-0"
 0 10' 20' 40'

KEY NOTE "D" HAS BEEN DELETED AND ALL KEY NOTE "D" REFERENCES HAVE BEEN CHANGED TO KEY NOTE "A".
 THE ENTIRE PARKING AND MANEUVERING AREA SOUTH OF THE BUILDING WILL BE 2" THICK CONCRETE.
 THE SCALES ON THE SITE PLAN TITLE BLOCK AND THE SITE GRADING PLAN TITLE BLOCK HAVE BEEN REVISED TO SHOW A SCALE OF 1"=20'-0".
 CURB & GUTTER CHANGED TO STANDING CURB DETAIL 7/AS501. DUPLICATE NOTE "C" CHANGED TO NOTE "H"



TAYLORSVILLE LIQUOR STORE REMODEL & ADDITION

DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
 3905 WEST 5400 SOUTH, TAYLORSVILLE, UTAH 84118

FRANK N MURDOCK JR. Architect & Associates
 975 East 100 South, Suite 100, Salt Lake City, Utah 84102. TEL: (801) 532-4441 FAX: (801) 532-4220

SITE PLAN AND SITE GRADING PLAN

REVISION # DATE:
 5/12/08

DFCM PROJECT NO.:
06306030

CONST DOC
 FILE NAME: ABCV-AS101
 PLOT SCALE: 1:240
 DRAWN BY: STAFF
 CHECKED BY: FMN
 DATE: APRIL 2008

AS 101r

SITE INFORMATION

PARKING:	
PARKING STALLS	27 STALLS
ACCESSIBLE STALLS	2 STALLS
PARKING TOTALS	29 STALLS

SITE DRAWINGS

SEE SHEET AS101 FOR GENERAL SITE INFORMATION AND DIMENSIONS
SEE SHEET AS102 FOR SITE GRADING AND STORM SEWER INFORMATION
SEE SHEET AS103 FOR SITE UTILITY INFORMATION
SEE SHEET AS501 FOR SITE DETAIL INFORMATION

SITE PLAN LEGEND

	CATCH BASIN
	STORM DRAIN MAN HOLE
	POWER POLE
	WATER VALVE
	ELECTRIC BOX
	FIRE HYDRANT
	SANITARY SEWER MAN HOLE
	LIGHT POST
	STREET LIGHT BOX
	GAS METER
	TELEPHONE BOX
	PROPERTY LINE
	LANDSCAPE AREA
	SIDEWALK
	OVERHEAD TRANSMISSION LINE
	UNDERGROUND POWER
	SANITARY SEWER
	WATER LINE
	TELEPHONE LINE
	GAS LINE
	CABLE T.V.
	PARKING STALLS
	FENCE
	4434 EXISTING GRADE CONTOUR
	NEW GRADE CONTOUR
	CENTER LINE OF ROAD
	NEW SECURITY FENCE - SEE 22/SD-4
	SIGN TYPES - SEE 2/SD-4
	NEW CONCRETE PAVING AND SIDEWALKS
	ROADWAY, SERVICE AND DOCK AREA (ASPHALT)
	2 - 4" PVC PIPE SLEEVE
	T.O.G TOP OF GRATE
	I.E. INVERT ELEVATION
	T.O.SW TOP OS SIDEWALK
	T.O.PV TOP OF PAVEMENT
	T.O.C. TOP OF CONCRETE

GENERAL NOTES

- REFER TO SITE DEVELOPMENT, LANDSCAPE, MECHANICAL AND ELECTRICAL DRAWINGS FOR DIMENSIONS AND ADDITIONAL SITE INFORMATION.
- CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS. NOTIFY ARCHITECT OF ANY DISCREPANCIES TO THE CONTRACT DOCUMENTS.
- PROVIDE POSITIVE DRAINAGE AWAY FROM BUILDING AT ALL POINTS.
- CONTRACTOR SHALL NOT PARK, STORE EQUIPMENT, OR USE THE EXISTING ROAD FOR ANY PURPOSE OTHER THAN ACCESS TO THE PROJECT SITE. CONTRACTOR SHALL NOT DISTURB OR USE ANY AREA OUTSIDE CONTRACT LIMIT LINE TO PARK OR STORE EQUIPMENT. UNLESS OTHERWISE NOTED, THE PROPERTY LINE SHALL FORM THE BOUNDARY OF THE CONTRACT LIMIT LINE.
- CONTRACTOR WILL MAINTAIN AND PROTECT ALL EXISTING UTILITIES DURING CONSTRUCTION.
- ALL CUTTING, PATCHING, EXCAVATION AND BACKFILL DONE IN STREET SHALL BE DONE IN ACCORDANCE WITH UTAH DEPARTMENT OF TRANSPORTATION SPECIFICATIONS.
- PROVIDE PIPE SLEEVES WHERE SPRINKLER LINES PASS UNDER ASPHALT PAVEMENT OR RETAINING WALLS.
- PROTECT ANY EXISTING STORM DRAINS FROM MUD AND DEBRIS DURING CONSTRUCTION.

UTILITY FEES


- THE OWNER SHALL BE RESPONSIBLE FOR ALL UTILITY CONNECTION AND PERMIT FEES. CHARGES FOR IMPACT FEES BY UTILITIES OR MUNICIPALITIES ARE NOT TO BE CHARGED TO OR PAID BY THE CONTRACTOR OR THE STATE OF UTAH FOR STATE FACILITIES.

LANDSCAPE SPRINKLING CONNECTION

- PROVIDE 3/4" WATER LINE FROM EXISTING BUILDING WATER SERVICE TO THE SOUTH WEST CORNER OF THE ADDITION FOR USE BY THE LANDSCAPE SPRINKLING SYSTEM. PROVIDE SHUTOFF VALVE TO LINE INSIDE THE BUILDING.

WATER LINE RELOCATION

- ALL WORK SHALL BE COORDINATED WITH THE TAYLORSVILLE BENNION IMPROVEMENT DISTRICT. ALL WORK SHALL BE CONSTRUCTED IN COMPLIANCE WITH THE TAYLORSVILLE BENNION IMPROVEMENT DISTRICT STANDARDS AND WILL BE SUBJECT TO REVIEW BY THE TAYLORSVILLE BENNION IMPROVEMENT DISTRICT.

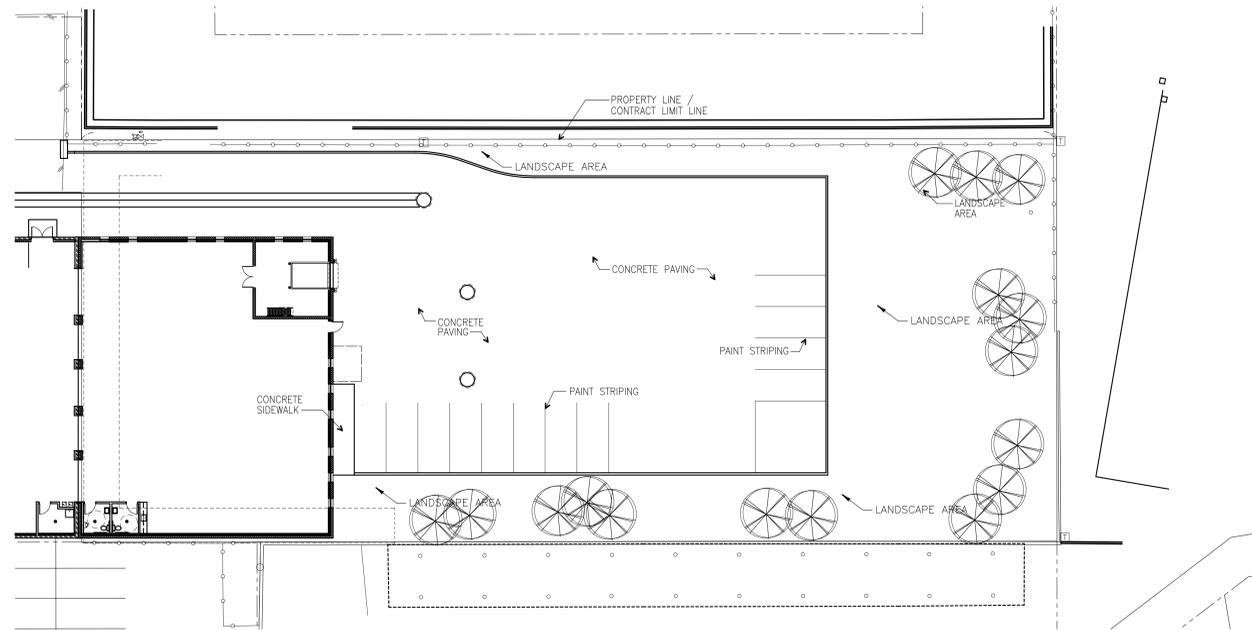

LANDSCAPE PLAN

SCALE: 1" = 20'-0"

11 ADDITIONAL PARKING STALLS


LANDSCAPING PLAN GENERAL NOTES

- ALL AREAS NOTED AS "SOD" (GRASS) OR "LANDSCAPED AREA", SHALL BE PROVIDED WITH A LANDSCAPE IRRIGATION SYSTEM. SLEEVES SHALL BE PROVIDED UNDER PAVED AREAS TO FACILITATE THE IRRIGATION SYSTEM. SEE SPECIFICATIONS FOR REQUIREMENTS.
- LANDSCAPE CONTRACTOR IS RESPONSIBLE FOR SLEEVES UNDER PAVED AREAS. WORK SHALL BE COORDINATED WITH PAVING CONTRACTOR.
- INSTALL A MINIMUM OF 4" OF IMPORTED TOP SOIL AT ALL LANDSCAPED AREAS.
- PROVIDE AND INSTALL COMPLETE AUTOMATIC LANDSCAPE SPRINKLING SYSTEM TO ALL LAWN AND LANDSCAPED AREAS. SEE SPECIFICATIONS FOR DETAILED SYSTEM REQUIREMENTS.
- LANDSCAPING SHALL NOT BE CONSIDERED TO BE COMPLETE UNTIL AFTER 90 DAYS OF HEALTHY GROWTH. CONTRACTOR SHALL BE RESPONSIBLE TO REPLACE ALL UNHEALTHY OR DEAD LANDSCAPING. CONTRACTOR SHALL REMAIN RESPONSIBLE FOR ALL REPLACED LANDSCAPING WITH THE 90 DAY HEALTHY GROWTH REQUIREMENT BEING APPLICABLE TO ALL REPLACED LANDSCAPING.
- MINIMUM EXCAVATION FOR TREES SHALL BE A DIAMETER OF 2'-0" GREATER THAN THE ROOT BALL, AND 6" DEEPER THAN THE ROOT BALL. BACKFILL HOLE WITH TOPSOIL. COVER AREA INSIDE EDGING WITH BARK CHIPS (3" DEEP).
- COMPLETELY COVER AREA AROUND SHRUB, TREE, AND GROUND COVER PLANTINGS WITH A 4" THICK LAYER OF BARK CHIPS OVER LANDSCAPE FABRIC.
- STAKE AND GUY SUPPORT ALL TREES. PROVIDE TREE TRUNK PROTECTION PLASTIC SLEEVES AT ALL TREES NOT PLANTED WITH SHRUBS AROUND THEIR BASE.
- PROVIDE FLEXIBLE EDGING AND BARK CHIPS AT ALL TREES IN LAWN AREAS. PROVIDE 4" DIAMETER EDGING CIRCLE, AT TREES IN LAWN AREAS, WHERE NO EDGING IS OTHERWISE NOTED.
- CONSTRUCT A 4" HIGH EARTHEN BERM AROUND ALL TREES AND SHRUBS. BERM TO BE SAME DIAMETER AS EXCAVATION FOR ROOT BALL PLANTING PIT.

LANDSCAPING PLAN LEGEND

GRASS


SOD = BLUEGRASS VARIETIES
SEED = BLUE GAMA GRASS
BOUTELOUA GRACILIS

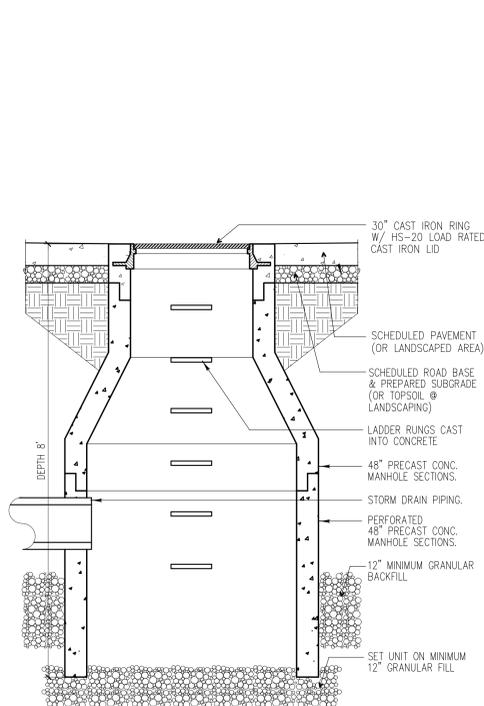

NOTE: DRY SUMP MUST BE INSTALLED IN AN AREA WITH SOIL OF GOOD PERCOLATION. COORDINATE DEPTH OF DRY SUMP w/ SOIL CONDITIONS AND FREE DRAINING SOIL STRATA.

DRY SUMP SECTION

SCALE: 3/4" = 1'-0"

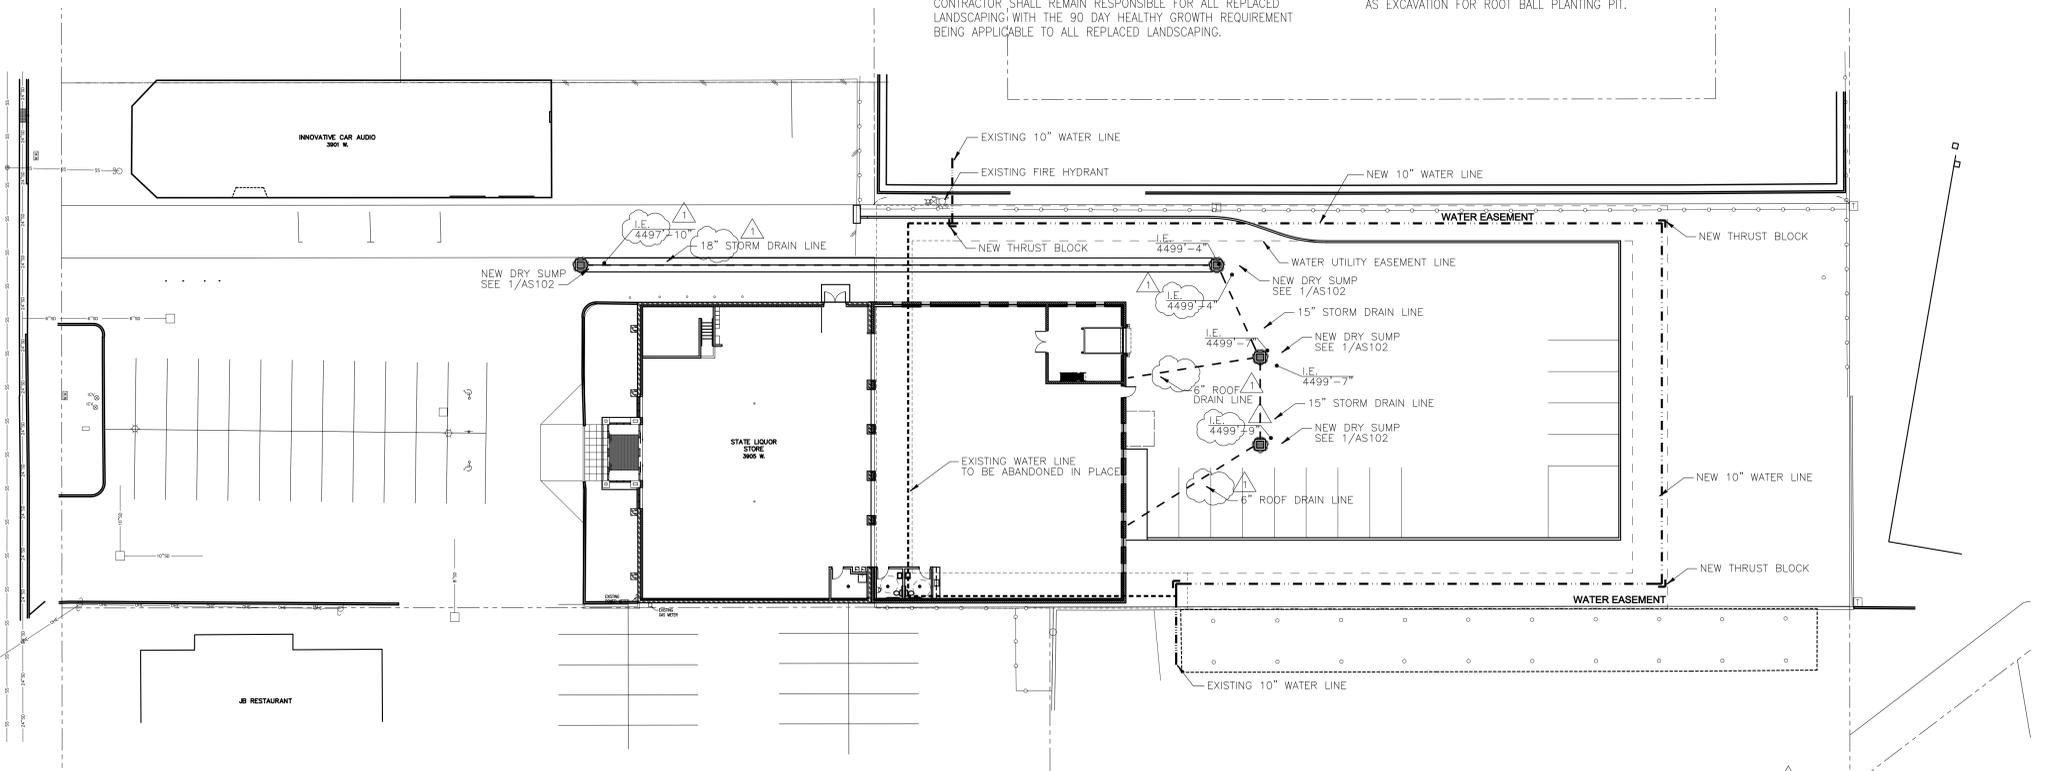


SITE UTILITY PLAN

SCALE: 1" = 20'-0"

11 ADDITIONAL PARKING STALLS

INVERT ELEVATIONS ADDED AT STORM DRAIN LINES.
EAST STORM DRAIN LINE CHANGED FROM 15" TO 18".
ROOF DRAIN LINES HAVE BEEN CONNECTED TO THE DRY SUMPS.
THE SCALES ON THE SITE UTILITY PLAN TITLE BLOCK AND THE LANDSCAPE PLAN TITLE BLOCK HAVE BEEN REVISED TO SHOW A SCALE OF 1"=20'-0".

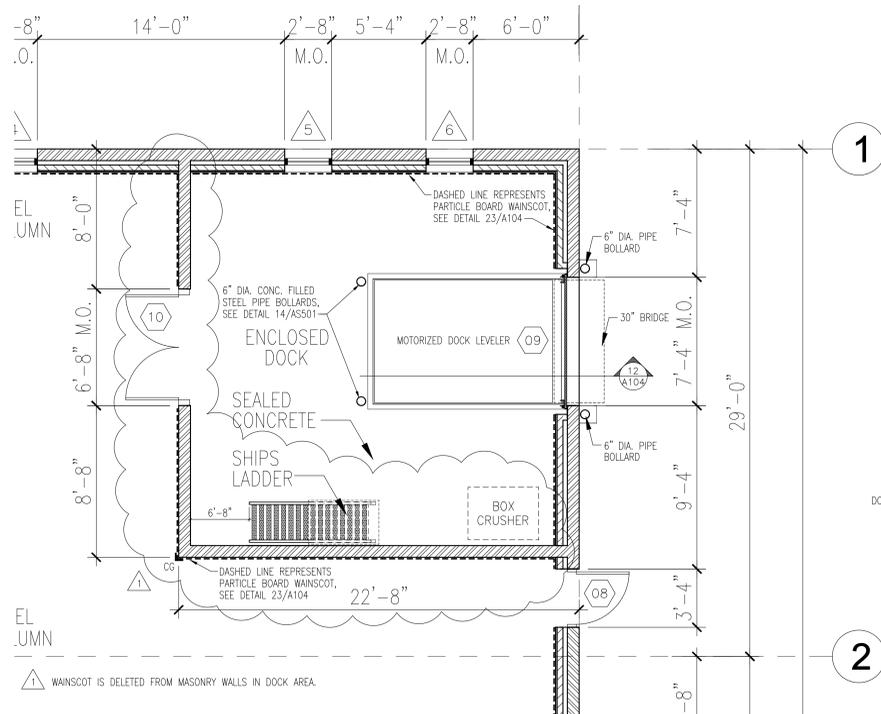

PHASING

IT IS THE INTENT OF THE OWNER THAT THE EXISTING FACILITY REMAIN OPEN FOR AS LONG AS POSSIBLE DURING CONSTRUCTION. THE CONTRACTOR IS TO COMPLETE THE CONSTRUCTION OF THE NEW BUILDING SHELL INCLUDING THE CONCRETE FOOTINGS, FOUNDATIONS AND FLOOR SLAB, MASONRY WALLS, STEEL ROOF JOIST AND DECK AND ROUGH HVAC AND ELECTRICAL PRIOR TO BREACHING THE WALL INTO THE EXISTING FACILITY. UPON COMPLETION OF THIS WORK AND WITH A MINIMUM TWO WEEK NOTICE, THE EXISTING FACILITY WILL BE CLOSED AND ALL PRODUCT REMOVED FROM THE STORE. THE CONTRACTOR WILL THEN HAVE FULL ACCESS TO THE EXISTING BUILDING UNTIL THE REMAINDER OF THE WORK IS COMPLETE.

NOTES

1. PROVIDE SIGNAGE ABOVE ENTRY DOORS STATING "THESE DOORS TO REMAIN UNLOCKED DURING BUSINESS HOURS".

2. PROVIDE SIGNAGE DESIGNATING "PUBLIC RESTROOMS" AT LOCATION TO BE DETERMINED BY ARCHITECT.

3. CONTRACTOR TO PROVIDE AND INSTALL 25 L.F. OF CHAIR RAIL (NPRO CORP., NORTHERN HARDWOODS CR2 OR EQUAL) IN LOCATIONS AND AT HEIGHTS TO BE DETERMINED BY THE ARCHITECT.

WALL TYPE

1. BRACE TO ROOF DECK @ 4' O.C.

2. 3 5/8" STUD INTERIOR PARTITION WALL: PAINTED 5/8" GYP. BD. BOTH SIDES OF 3 5/8" METAL STUDS @ 16" ON CENTER, FROM FLOOR TO ROOF DECK OR TO 6" ABOVE CEILING WHERE CEILING OCCURS. PROVIDE DIAGONAL BRACING TO ROOF DECK @ 4' O.C. WHERE CEILING OCCURS. GYP BD @ WALL TO STOP @ GYP BD CEILING WHERE OCCURS. PROVIDE TILE WAINSCOT AS SHOWN ON PLANS. INSTALL WATER-RESISTANT GYP BD @ ALL TOILET ROOMS. PROVIDE PROTECTIVE PARTICLE BOARD WAINSCOT AS SHOWN ON FLOOR PLANS, DETAIL 23/A104.

DEMOLITION NOTES

1. REMOVE FOUR (4) EXISTING SWINGING ENTRANCE DOORS, FRAMES AND STOREFRONT SYSTEM.

2. REMOVE AND DISPOSE OF EXISTING CHECK-OUT COUNTERS.

3. REMOVE AND DISPOSE OF EXISTING FLOOR TILE.

4. REMOVE AND DISPOSE OF EXISTING WALLS, CEILINGS, CABINETS AND PLUMBING FIXTURES AND ACCESSORIES. TERMINATE ALL ELECTRICAL AND HVAC EQUIPMENT.

5. REMOVE AND DISPOSE OF EXISTING SINK AND WALL AND BASE COUNTER UNITS IN BREAK AREA. TERMINATE ALL UTILITIES PER PLUMBING AND ELECTRICAL DRAWINGS.

6. REMOVE AND DISPOSE OF EXISTING CEILING MATERIALS AND WALLS AND DOORS.

7. SAW CUT AND REMOVE EXISTING CONCRETE SLAB (SHOWN HATCHED) AND 2" OF EXISTING GRAVEL BASE (MAY BE RE-USED). PREPARE SUB-SURFACE FOR NEW 5" THICK CONCRETE SLAB OVER 4" GRAVEL WITH 2" RECESS FOR NEW TILE SET TILE.

8. REMOVE AND DISPOSE OF EXISTING DOUBLE DOORS. MAINTAIN AND PROTECT EXISTING HOLLOW METAL DOOR FRAME.

9. REMOVE EXISTING ELEVATED OFFICE WALLS, FLOOR, STAIRWAY AND HANDRAILS.


10. REMOVE EXISTING PERSONNEL LOCKERS AND BENCH, OWNER TO RETAIN.

11. REMOVE AND DISPOSE OF EXISTING GYPBOARD AND FURRING TO EXPOSE EXISTING CMU WALL.

12. REMOVE SECTION OF EXISTING CMU WALL AND FOUNDATION TO CREATE OPENING INTO NEW ADDITION. SEE STRUCTURAL SHEETS.

13. REMOVE EXISTING SCISSOR LIFT, OWNER TO RETAIN.


14. REMOVE AND DISPOSE OF EXISTING DUMPSTER ENCLOSURE.

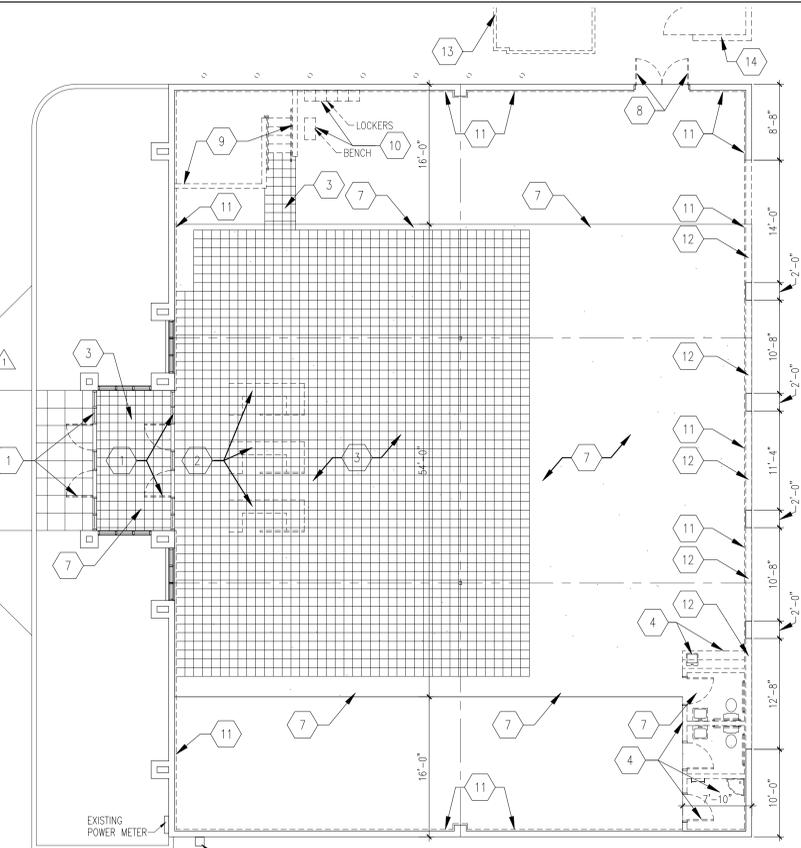


2 ENLARGED FLOOR PLAN AT ENCLOSED DOCK
SCALE: 1/4" = 1'-0"

3 ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

4 DEMOLITION FLOOR PLAN
SCALE: 1/8" = 1'-0"

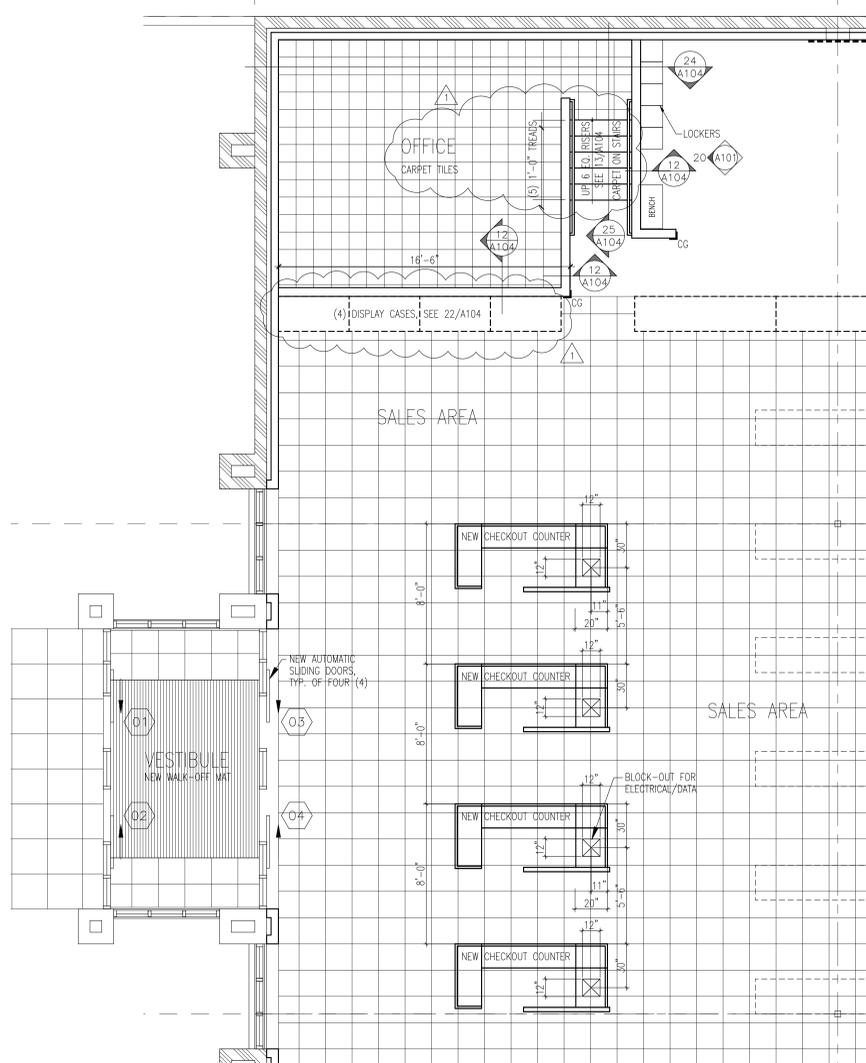


1 ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

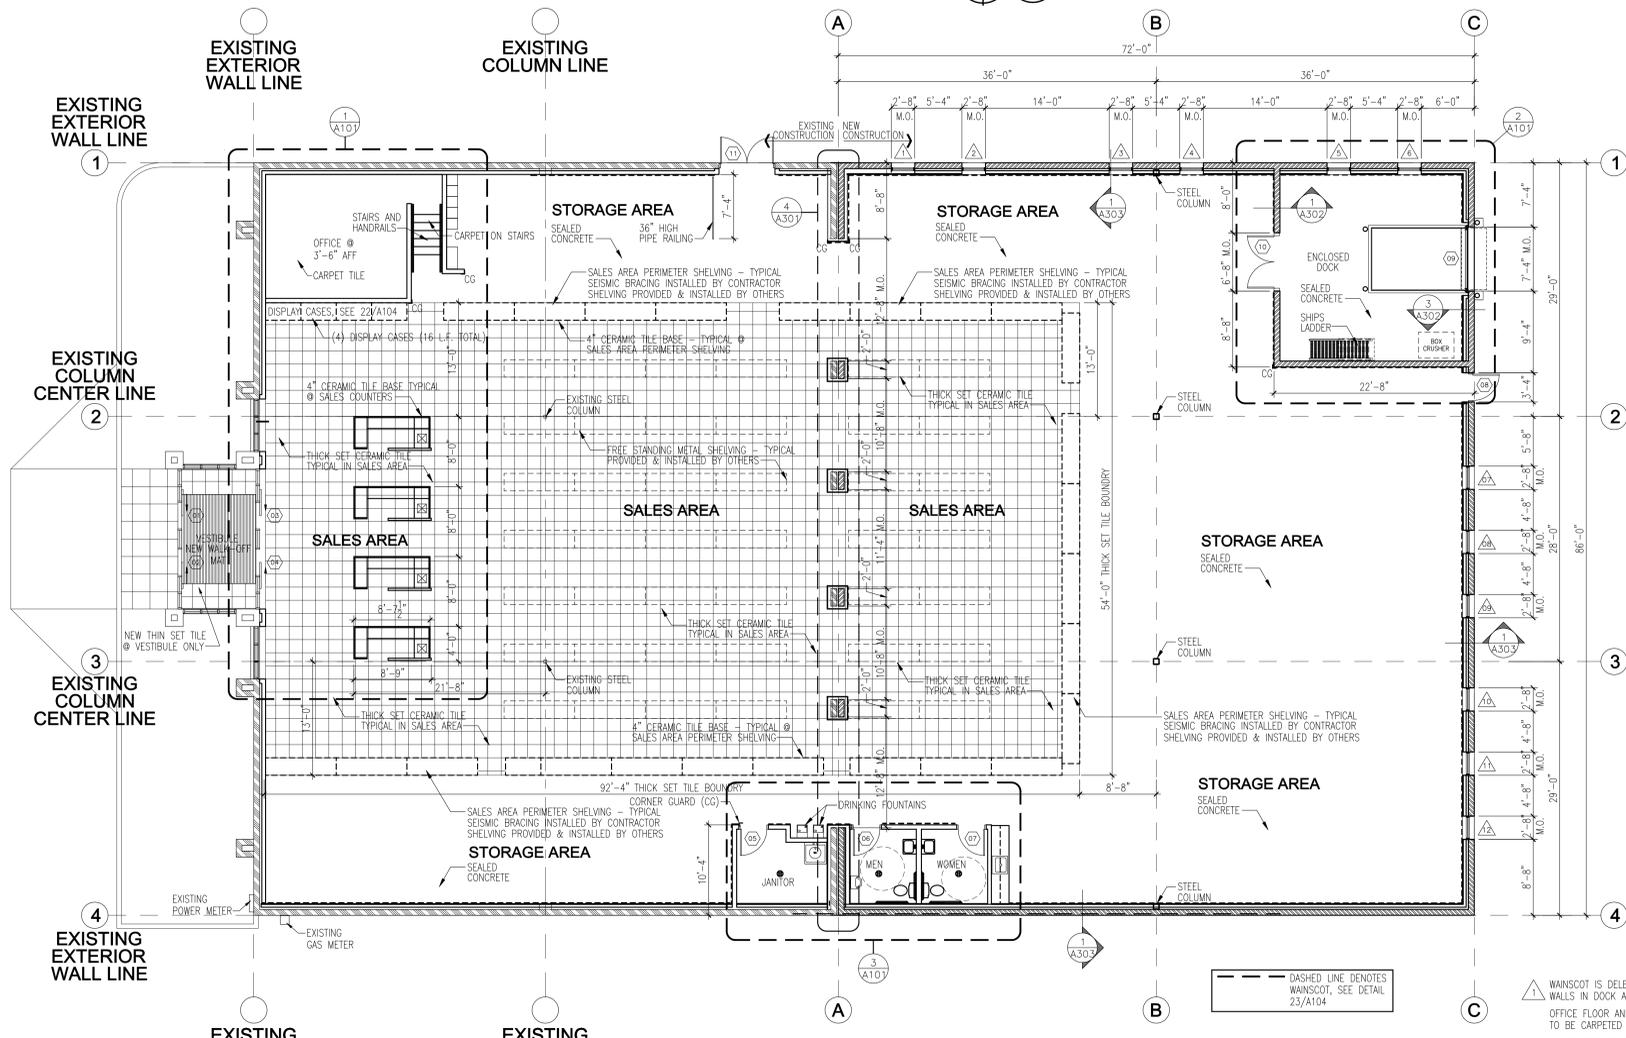


FLOOR PLAN - 12,030 GROSS S.F.
SCALE: 1/8" = 1'-0"

NOTE: OWNER TO PROVIDE AND INSTALL ALL SOAP DISPENSERS, SANITARY NAPKIN DISPOSAL UNIT, PAPER TOWEL DISPENSER AND WASTE UNITS AND TOILET PAPER DISPENSERS.


SECTION 21/A104 HAS BEEN MODIFIED TO REFERENCE THE RUBBER BASE TO BE INSTALLED ON THE NON-PUBLIC SIDE OF THE SHELVING.
 SECTION 22/A104 HAS BEEN MODIFIED TO PROVIDE FOR THE INSTALLATION OF FOUR (4) DISPLAY CASES.
 SECTION 25/A104 HAS BEEN MODIFIED TO PROVIDE FOR THE INSTALLATION OF CARPET ON THE STAIR TREADS.
 SECTION 26/A104 HAS BEEN MODIFIED TO PROVIDE FOR THE INSTALLATION OF CARPET ON THE OFFICE FLOOR.

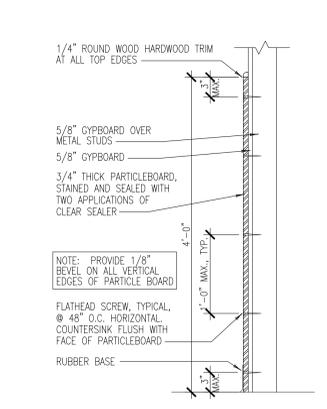


23 SECTION AT WAINSCOT
 SCALE: NOT TO SCALE

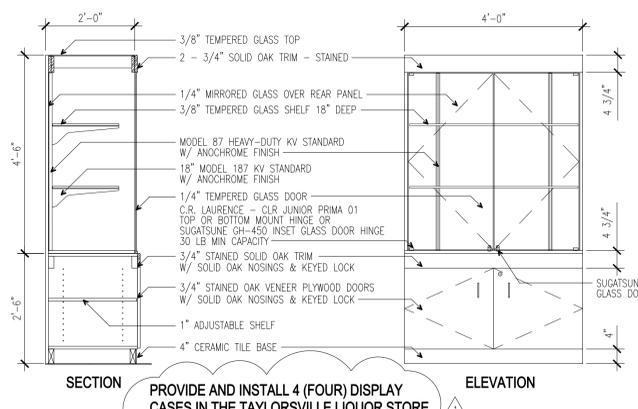


22 DISPLAY CASE ELEVATION AND SECTION
 SCALE: NOT TO SCALE

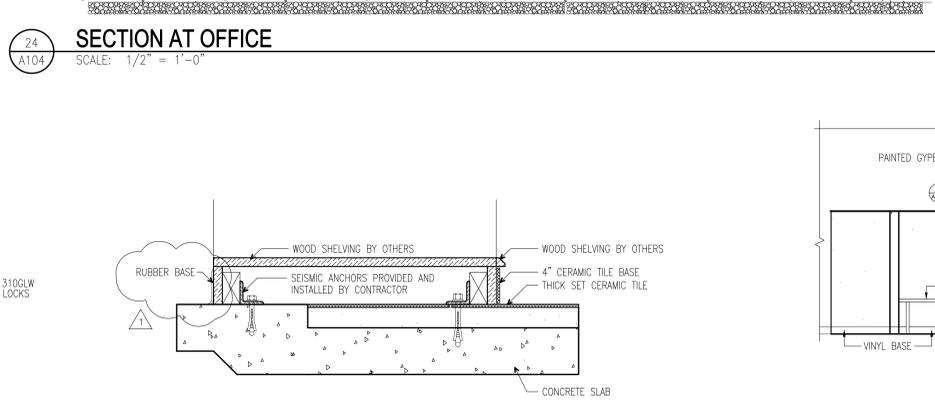


24 SECTION AT OFFICE
 SCALE: 1/2" = 1'-0"

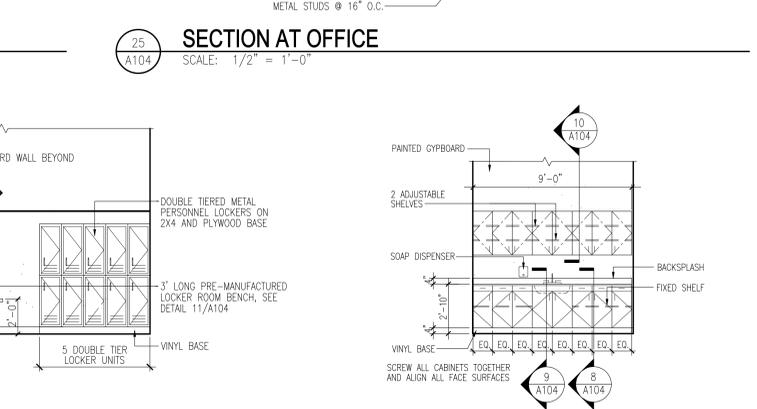


25 SECTION AT OFFICE
 SCALE: 1/2" = 1'-0"

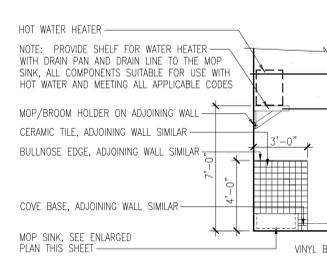


18 ELEVATION AT UTILITY ROOM
 SCALE: 1/4" = 1'-0"

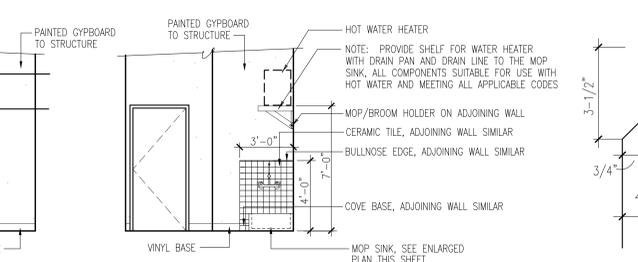


17 ELEVATION AT UTILITY ROOM
 SCALE: 1/4" = 1'-0"

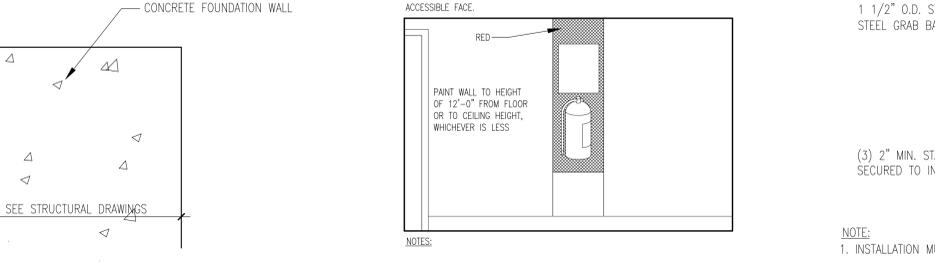


16 CONCRETE REVEAL
 SCALE: NONE

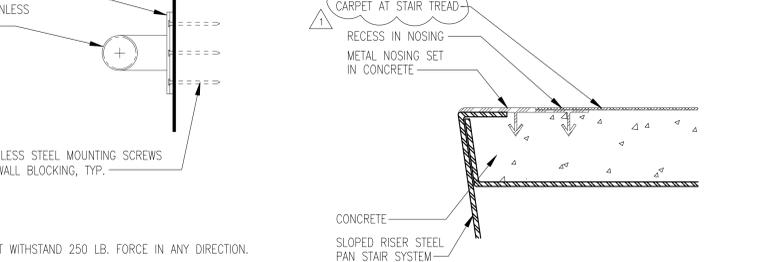


14 GRAB BAR DETAIL
 SCALE: NOT TO SCALE

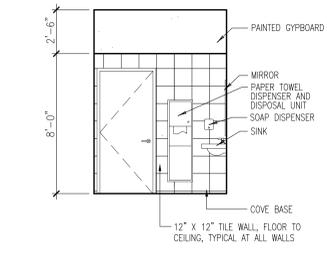


7 ELEV. AT MEN'S RESTROOM
 SCALE: 1/4" = 1'-0"

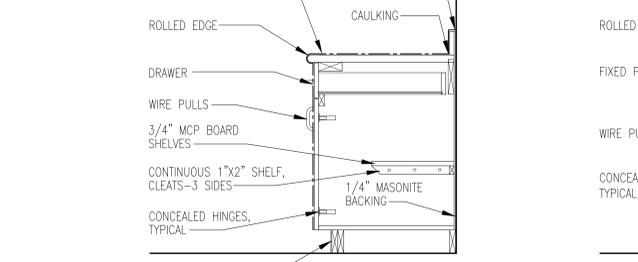


8 BASE CABINET SECTION
 SCALE: NOT TO SCALE

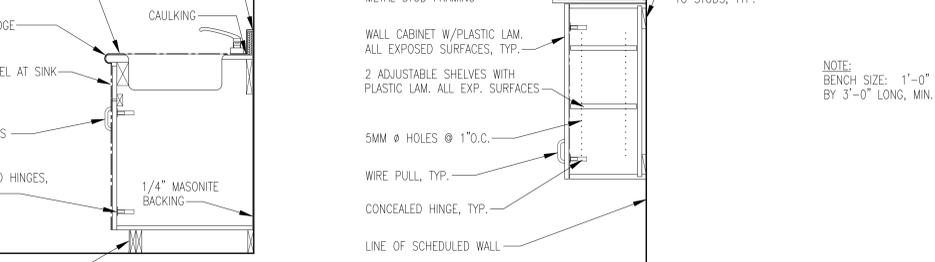


9 SINK CABINET SECTION
 SCALE: NOT TO SCALE

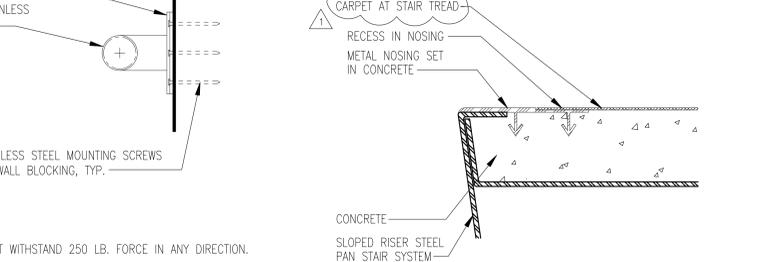


13 STAIR NOSING DETAIL
 SCALE: NOT TO SCALE

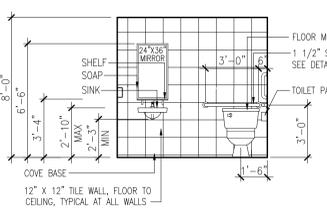


6 ELEV. AT MEN'S RESTROOM
 SCALE: 1/4" = 1'-0"

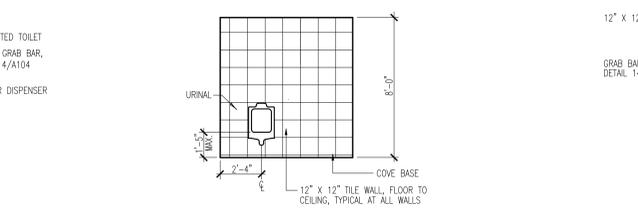


5 ELEV. AT MEN'S RESTROOM
 SCALE: 1/4" = 1'-0"

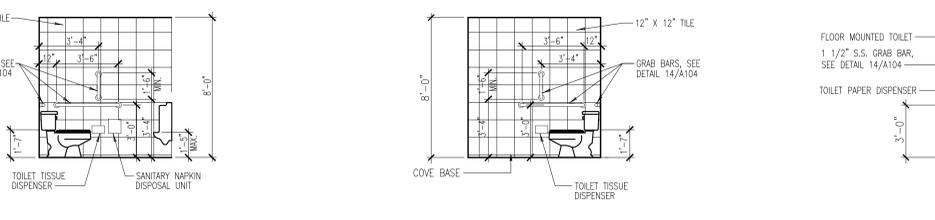

4 ELEV. AT WOMEN'S RESTROOM
 SCALE: 1/4" = 1'-0"

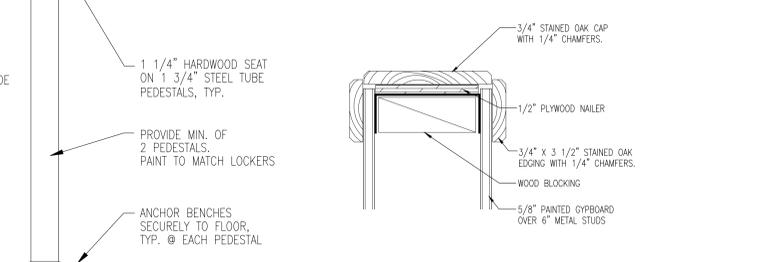

11 LOCKER ROOM BENCH
 SCALE: NOT TO SCALE

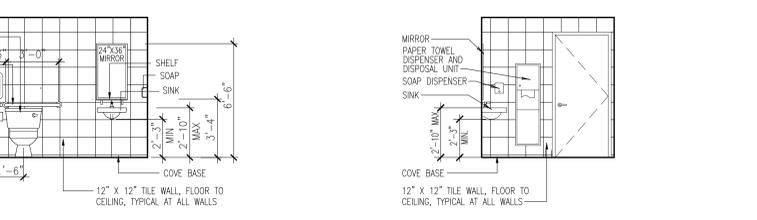

12 SECTION AT WALL CAP
 SCALE: NOT TO SCALE




3 ELEV. AT WOMEN'S RESTROOM
 SCALE: 1/4" = 1'-0"




2 ELEV. AT WOMEN'S RESTROOM
 SCALE: 1/4" = 1'-0"



1 ELEV. AT WOMEN'S RESTROOM
 SCALE: 1/4" = 1'-0"

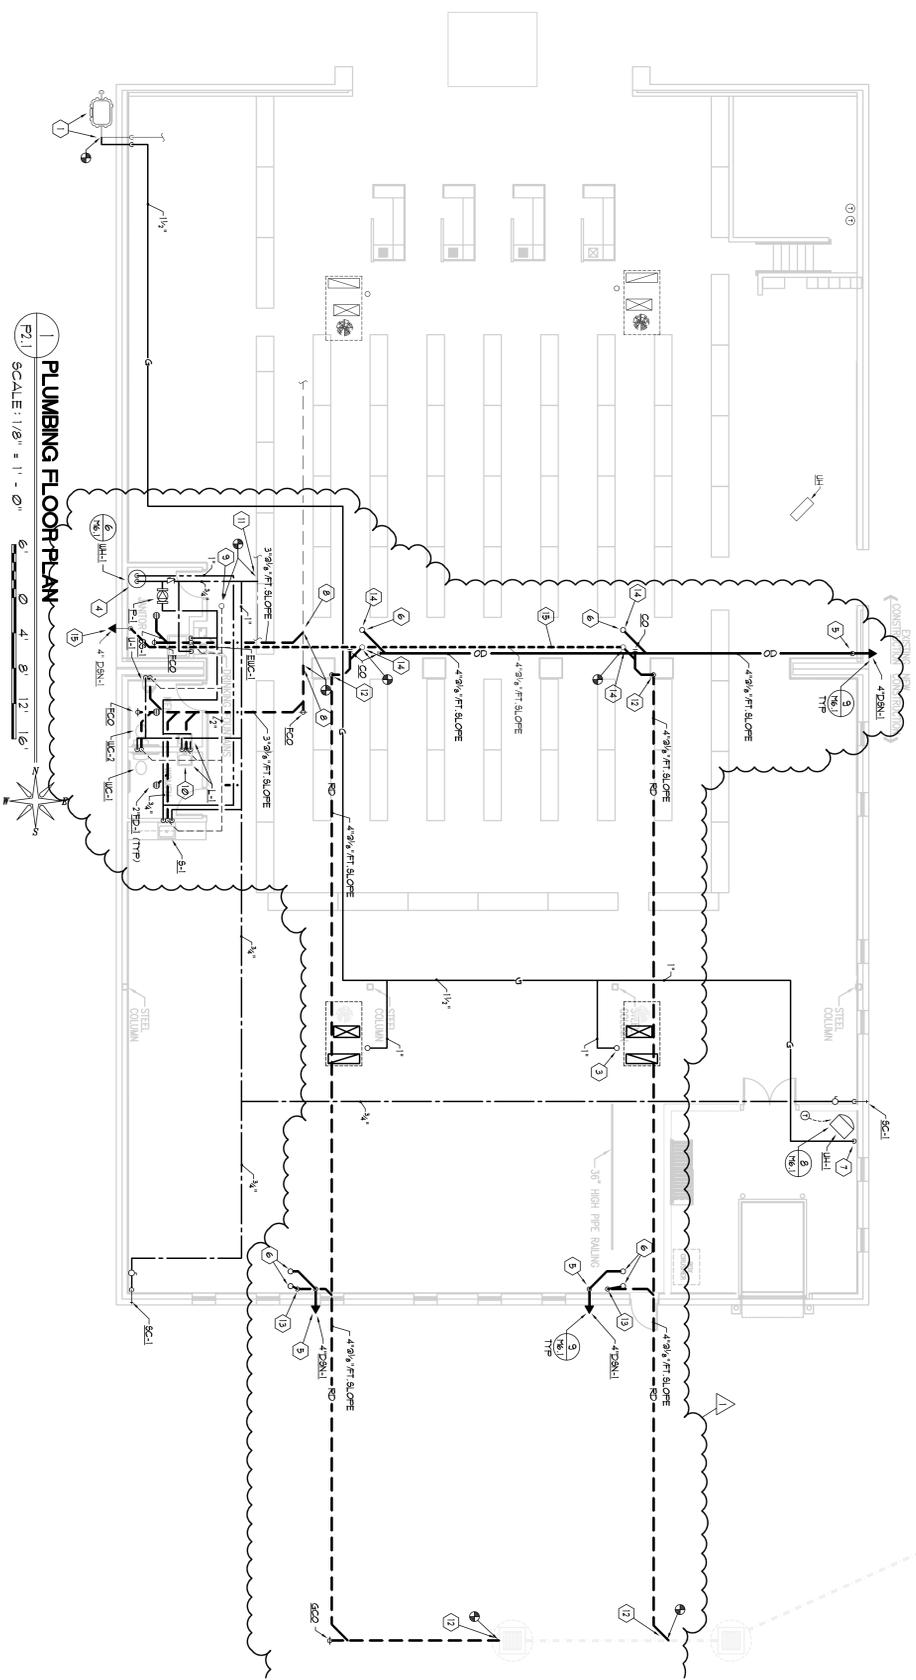

1 PLUMBING FLOOR PLAN
SCALE: 1/8" = 1' - 0"

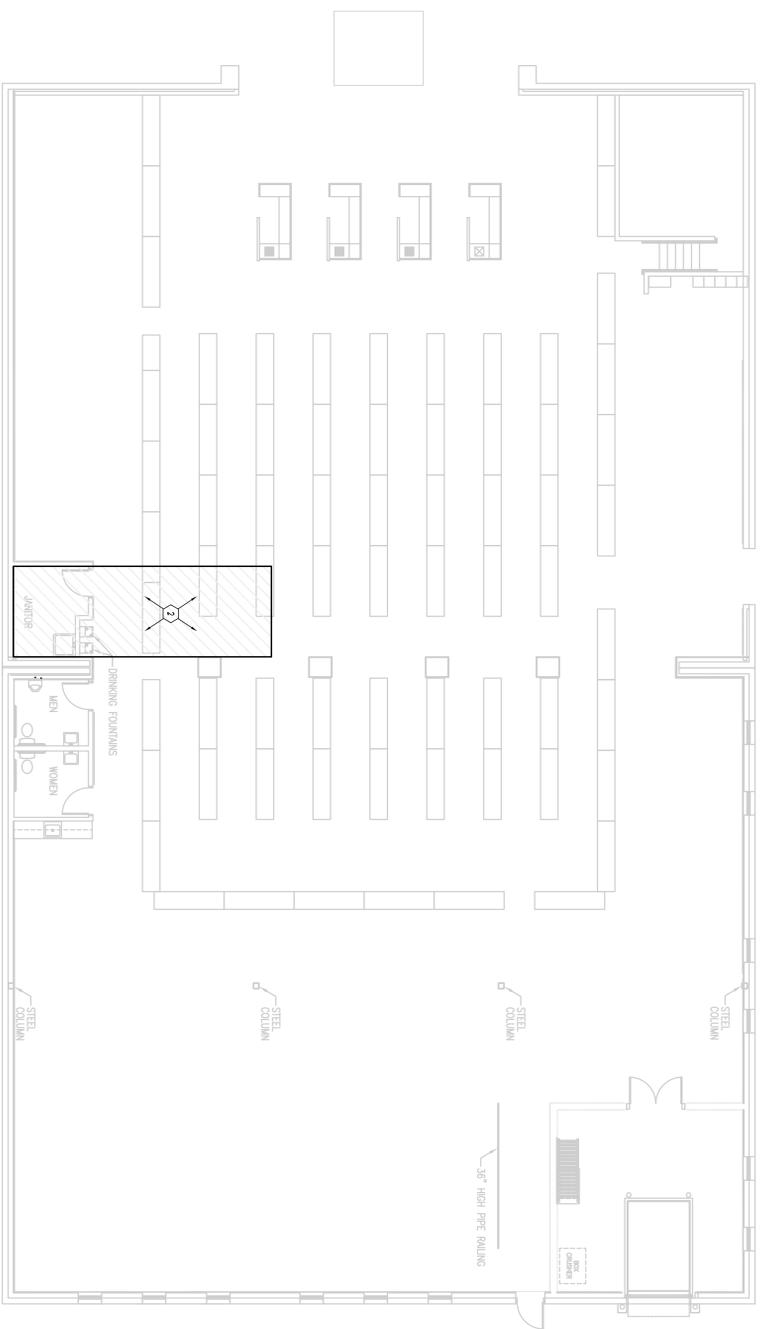

2 PLUMBING DEMO PLAN
SCALE: 1/8" = 1' - 0"

- KEYED NOTES:**
1. QUESTION TO VERIFY EXISTING VENTER SIZE AND REPAIR/REPLACE AS REQUIRED TO ROUTE NEW GAS PIPING THROUGH WALL AND CONNECT AT VENTER AS SHOWN. NEW PRESURE: 1.0 R. + 200'
 2. ALL EXISTING PIPING IN THIS AREA TO BE CHECKED BACK TO MAINS AND CAPPED.
 3. GAS PIPING RISER UP THRU ROOF TO R/U.
 4. WATER HEATER TO BE HOISTED UP HIGH ROOF SKYL. TO ALLOW SIGHT FROM WITHIN ROOF. ALL PIPING TO BE INSTALLED WITH CLASITY FIBERGLASS ONLY. SEE DETAIL 6/96.1
 5. DROP OVER-ROOF ROOF DRAIN PIPING DOWN TIGHT ALONG WALL AS SHOWN. TERMINATE DOWN FRONT NOZZLES AT ELEVATION SHOWN. (TYPICAL)
 6. 4" RISERS TO DRAINS ON ROOF. SEE DETAIL 5/96.1. (TYPICAL)
 7. PROVIDE FINAL CONNECTION TO INT. HEATER AS REQUIRED.
 8. N.C. TO FIELD VERIFY EXACT LOCATION AND INVERT OF EXISTING WATER PIPING. RELOCATE NEW WATER PIPING IN INVERT 9 SLOPE. SAW CUT FLOOR AS REQUIRED TO ROUTE NEW PIPING.
 9. CONNECT NEW VENT PIPING TO EXISTING VENT THROUGH ROOF.
 10. N.C. TO INSTALL HOSE BIBB UNDER LAVS.
 11. CONNECT NEW WATER RISER TO BEARING FINISH OF BOLLER OR GREYER SET.
 12. DROP NEW ROOF DRAIN PIPING DOWN IN CONDUIT TO STORM DRAIN PIPING AT SOUTH END. SEE CIVIL PLANS FOR EXACT LOCATION.
 13. DROP ROOF DRAIN PIPING DOWN ALONG INSIDE OF WALL.
 14. N.C. TO PROVIDE NEW OVER-ROOF DRAIN PIPING FOR EXISTING ROOF DRAIN. AS NEW SKYL. FIELD VERIFY EXISTING PIPING.
 15. N.C. TO REMOVE ALL UNUSED ROOF DRAIN PIPING. (TYPICAL)

GENERAL NOTES:

1. GREET AND REVISION ALL DUCTWORK AND PIPING AS REQUIRED.
2. ALL VALVES SHALL BE LOCATED ABOVE ACCESSIBLE DELTAS.
3. PROVIDE ACCESS PANELS AS REQUIRED.
4. CONTRACTOR TO COORDINATE ALL INSTALLATIONS WITH OTHER TRADES.
5. CONTRACTOR TO COORDINATE ROUTE PIPING OVER ELECTRICAL EQUIPMENT.
6. ALL PIPING SHALL BE HELD TIGHT TO BOTTOM OF STRUCTURE.
7. PROVIDE 4" DEEP SEAL TRAYS WITH TRAP PRINTERS ON ALL FLOOR DRAINS & FLOOR SINKS.
8. ALL FINE PROTECTION PIPING SHALL BE SIZED BY FINE PROTECTION CONNECTION.
9. ALL WASTE PIPING TO BE SLOPED AS REQUIRED BY CODE.

TAYLORSVILLE LIQUOR STORE EXPANSION AND REMODEL

DEPT. OF ALCOHOLIC BEVERAGE CONTROL
3905 WEST 5400 SOUTH, TAYLORSVILLE, UTAH 84118

FRANK N MURDOCK JR ■ Architect & Associates
975 East 100 South Suite 100, Salt Lake City, Utah 84102 TEL: (801) 532-4441 FAX: (801) 532-4220




REVISION # DATE:

PROJECT NO.: 7227 00.01
CONS'T. DOC. FILE NAME: See Plans
PLOT SCALE: See Plans
DRAWN BY: ASG
CHECKED BY: MMS
DATE: 05/05/2008







90 South 400 West, Suite 340
Salt Lake City, UT 84101
Phone: (801) 350-3158
Fax: (801) 521-4114

P2.1r

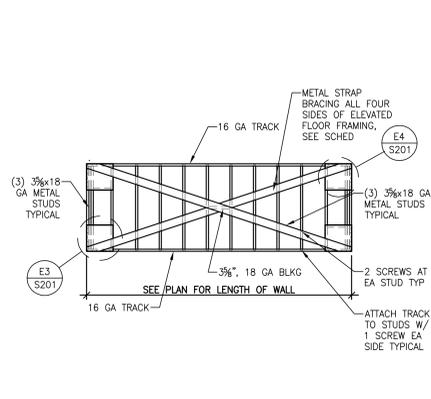


STRAP BRACE SCHEDULE	
STRAP	FASTENERS (SEE DETAILS)
	NO 12x $\frac{5}{8}$ MIN SELF DRILLING SCREWS
(A) STRAP TO GUSSET	(B) GUSSET TO EA END STUD
(C) GUSSET TO CONT TRACK	
4"x12 GA	10 8

NOTE: $\frac{1}{8}$ " FILLET WELDS MAY BE SUBSTITUTED FOR SCREWS. PROVIDE 1 $\frac{1}{4}$ " FILLET WELD FOR EACH SCREW.

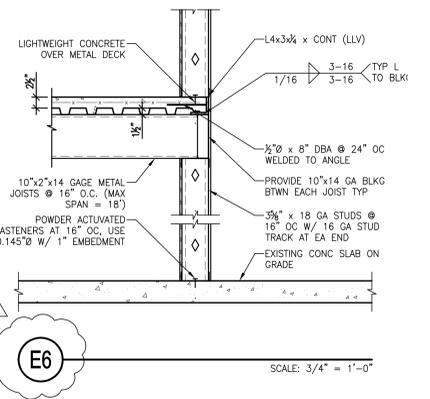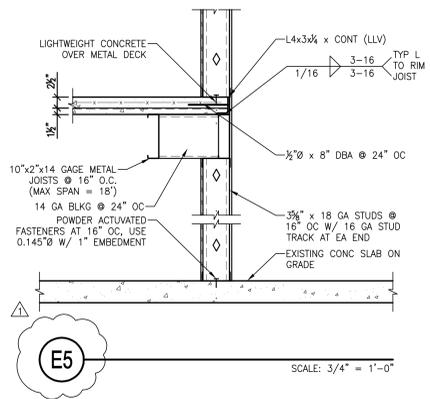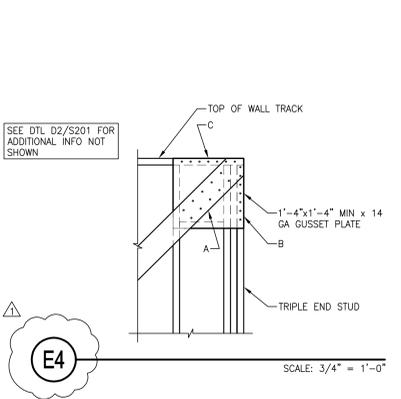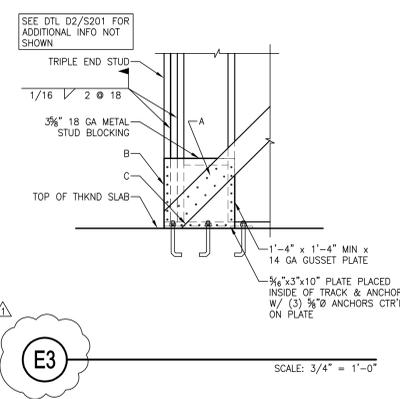

MARK	LENGTH	WIDTH	REINFORCEMENT		TYPE
			VERTICAL	HORIZONTAL TIES	
MC-1	16"	WALL	(4) #5		1
MC-2	24"	WALL	(4) #5	#3 @ 8" OC	2


- MASONRY COLUMN NOTES:
- HORIZONTAL WALL REINFORCEMENT SHALL RUN CONTINUOUS THROUGH MASONRY COLUMNS.
 - GROUT ALL REINFORCED CELLS AND VOIDS SOLID.
 - MASONRY COLUMNS REINFORCING SHALL EXTEND FULL HEIGHT FROM ROOF DOWN TO FOUNDATION. DOWEL VERT REINF INTO FOUNDATIONS.
 - SEE ARCHITECTURAL DRAWINGS FOR SPECIAL COURSING ARRANGEMENTS.



D5 MASONRY COLUMN SCHEDULE
5310.00 SCALE: NONE

BAR SIZE	MASONRY REBAR SPlice SCHEDULE										
	#3	#4	#5	#6	#7	#8	#9	#10	#11		
MASONRY SINGLE MAT	1'-7"	2'-1"	2'-7"	4'-4"	5'-1"	6'-2"	7'-10"	MECH	MECH		
MASONRY DOUBLE MAT	1'-7"	2'-4"	3'-6"	6'-10"	9'-1"	12'-5"	15'-4"	MECH	MECH		



- MASONRY REBAR SPlice NOTES:
- MECH = MECHANICAL SPlice REQUIRED.
 - USE #6 BAR IN 10" OR LARGER WALLS ONLY.
 - f'm = 1500 PSI, f_y = 60,000 PSI
 - DOUBLE MAT REINFORCEMENT SHALL HAVE 2" CLEARANCE BETWEEN FACE OF WALL AND EDGE OF VERTICAL BAR.



C5 MASONRY REBAR SPlice SCHEDULE
SCALE: NONE


BAR SIZE	REINFORCING LAP LENGTH SPlice SCHEDULE															
	f_c=3000psi				f_c=4000psi				f_c=5000psi				f_c=6000psi			
	REGULAR CLASS		TOP CLASS		REGULAR CLASS		TOP CLASS		REGULAR CLASS		TOP CLASS		REGULAR CLASS		TOP CLASS	
#3	17"	22"	22"	28"	15"	19"	19"	24"	13"	17"	17"	22"	12"	16"	16"	21"
#4	22"	29"	29"	38"	18"	25"	26"	33"	17"	22"	23"	30"	16"	20"	21"	27"
#5	28"	36"	37"	48"	24"	31"	32"	42"	21"	28"	24"	37"	20"	25"	26"	34"
#6	33"	43"	43"	58"	29"	37"	39"	50"	26"	33"	35"	45"	24"	30"	32"	41"
#7	48"	63"	63"	82"	42"	55"	55"	71"	37"	48"	49"	62"	34"	45"	45"	58"
#8	55"	72"	72"	93"	48"	63"	63"	81"	42"	55"	55"	71"	39"	51"	51"	66"
#9	62"	81"	81"	105"	54"	71"	71"	92"	48"	62"	62"	80"	44"	57"	57"	74"
#10	70"	91"	91"	118"	61"	79"	79"	103"	54"	70"	70"	90"	50"	65"	65"	84"
#11	78"	101"	101"	131"	68"	88"	88"	114"	60"	77"	77"	100"	55"	72"	72"	93"

- NOTES:
- THE SCHEDULE SHOWN APPLIES TO REG WT CONCRETE WITH 60ksi GRADE REINFORCING BARS.
 - TOP BARS ARE HORIZONTAL BARS WITH 12" (OR MORE), OF FRESH CONCRETE CAST BELOW THE BARS.
 - CLASS "A" SPlices SHALL BE USED WHEN 50% (OR LESS) OF BARS SPliced WITHIN LAP.
 - CLASS "B" SPlices SHALL BE USED FOR ALL ELSE, TYPICALLY WITH SHEARWALLS, COLUMNS, BEAMS & SLABS.
 - FOR EPOXY COATED BARS, INCREASE LAP LENGTHS AS FOLLOWS:
TOP BARS: L_d x 1.7
REGULAR BARS: L_d x 1.5
 - FOR BUNDLED BARS, INCREASE LAP LENGTHS AS FOLLOWS:
BUNDLED BARS, THREE OR LESS: L_d x 1.2
BUNDLED BARS, FOUR OR MORE: L_d x 1.33
INDIVIDUAL BAR SPlices WITHIN A BUNDLE SHALL NOT OVERLAP.
 - LAP SPlices ARE NOT ALLOWED FOR TIES AND STIRRUPS.

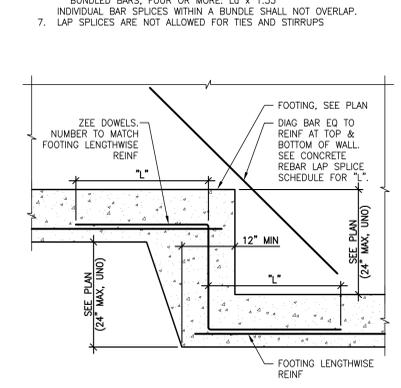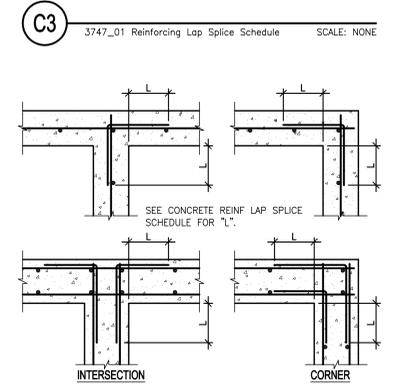


B3 WALL INTERSECTION DOWELS
3200.02 SCALE: NONE




B4 FOOTING STEP (CONC FDTN)
3231.02 SCALE: NONE

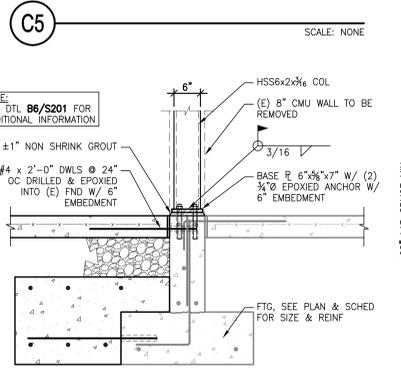


B5 FOOTING STEP (CONC FDTN)
SCALE: 3/4" = 1'-0"

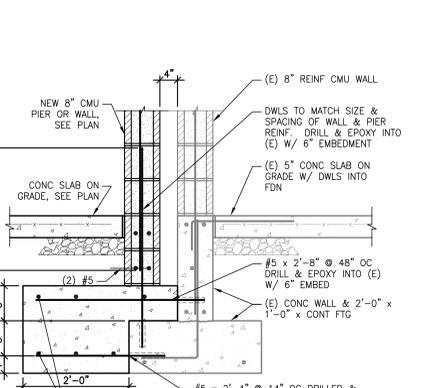


B6 FOOTING STEP (CONC FDTN)
SCALE: 3/4" = 1'-0"

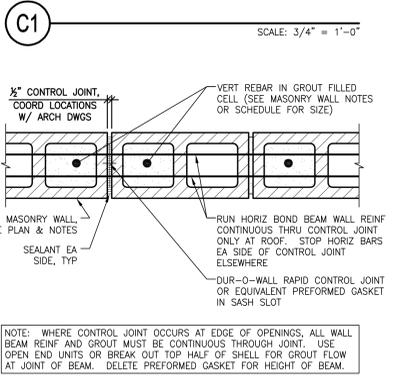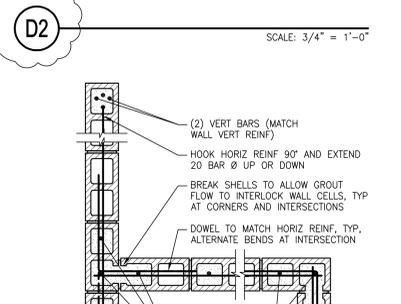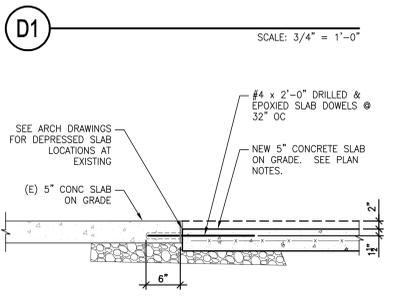


B1 TYP MASONRY CONTROL JOINT
5257.01 SCALE: NONE

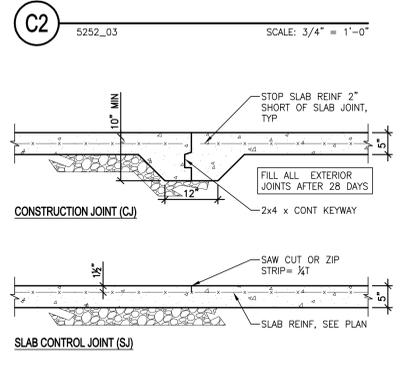


B2 TYPICAL SLAB JOINT DETAILS
3600.02 SCALE: NONE




A1 SLAB STEP DETAIL
3677.05 C-SLBSTP SCALE: 3/4" = 1'-0"

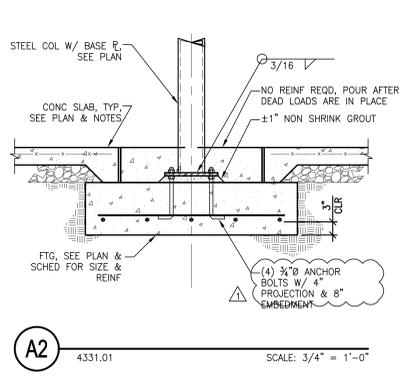


A2 SLAB STEP DETAIL
4331.01 SCALE: 3/4" = 1'-0"

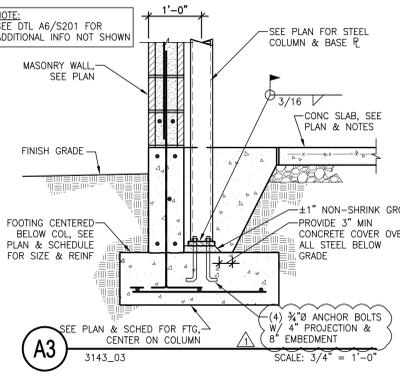


A3 SLAB STEP DETAIL
3143.03 SCALE: 3/4" = 1'-0"

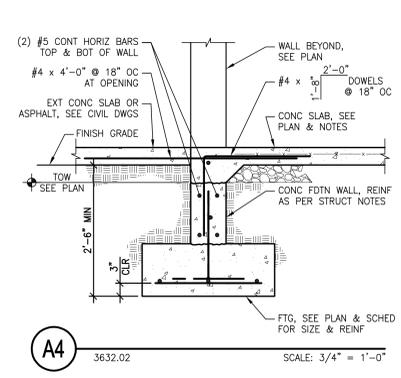

A4 SLAB STEP DETAIL
3632.02 SCALE: 3/4" = 1'-0"

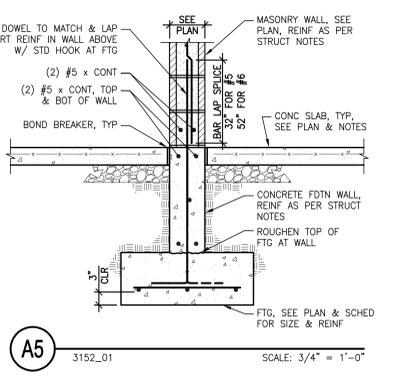

A5 SLAB STEP DETAIL
3152.01 SCALE: 3/4" = 1'-0"

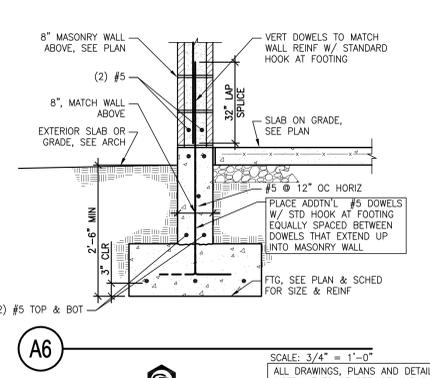


A6 SLAB STEP DETAIL
SCALE: 3/4" = 1'-0"

TAYLORSVILLE LIQUOR STORE REMODEL & ADDITION
 DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
 3305 WEST 5400 SOUTH, TAYLORSVILLE, UTAH 84118
 FRANK N MURDOCK JR. Architect & Associates
 975 East 100 South Suite 100, Salt Lake City, Utah 84102 TEL: (801) 532-4441 FAX: (801) 532-4220


REVISION # DATE:
 ADDENDUM 05/12/2008
 PERMIT DRAWINGS
 FILE NAME: S201
 PLOT SCALE: 3/4"=1'-0"
 DRAWN BY: JRS
 CHECKED BY: SP
 DATE: 03/18/08

S201


CALDER RICHARDS
 CONSULTING ENGINEERS
 100 WEST 100 SOUTH, SUITE 100, SALT LAKE CITY, UTAH 84111
 ALL DRAWINGS, PLANS AND DETAILS ARE INSTRUMENTS OF SERVICE AND SHALL REMAIN THE PROPERTY OF CALDER RICHARDS CONSULTING ENGINEERS AND ARE NOT SUITABLE FOR REUSE NOR INTENDED FOR ANY OTHER PROJECT.

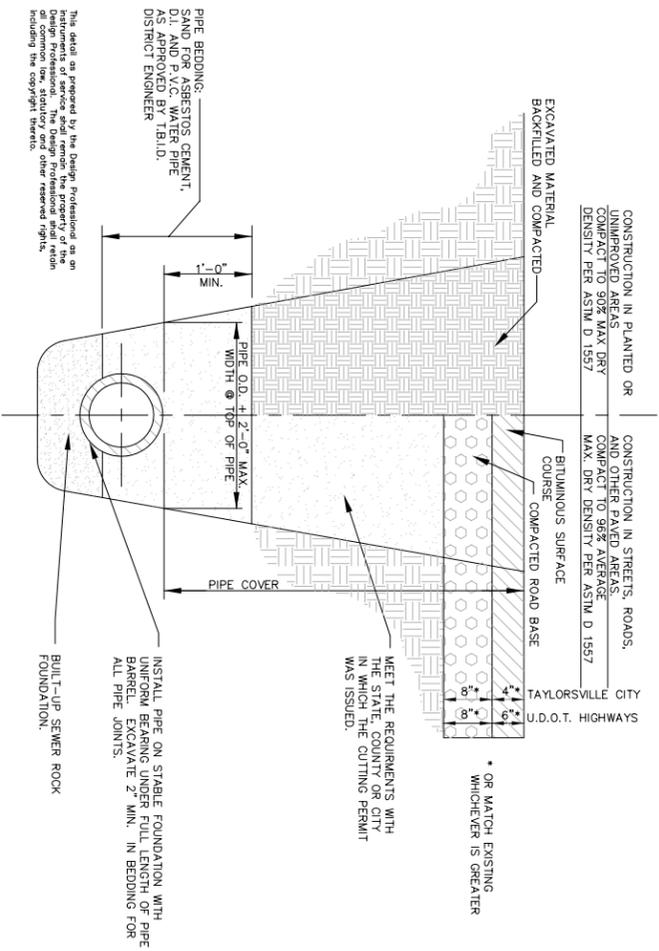


TYPICAL WATER TRENCH SECTION @ GRADE
 TB-201
 N.T.S. (A)

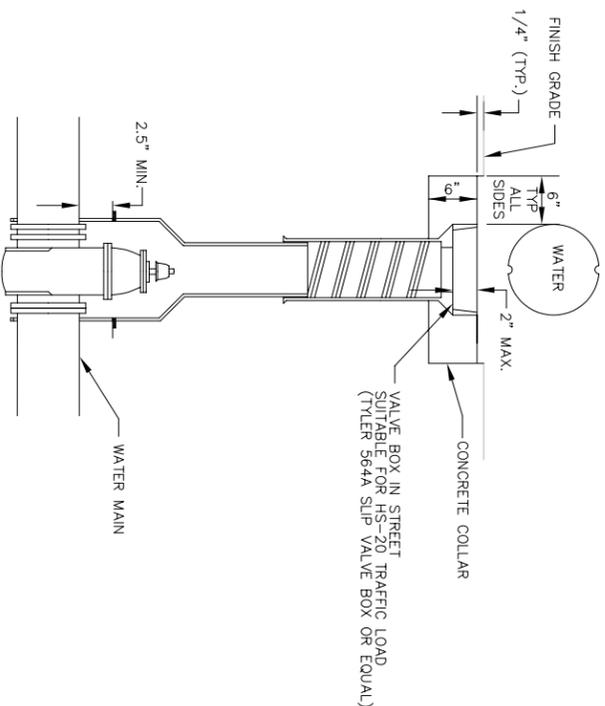

TYPICAL VALVE BOX
 TB-204
 N.T.S. (B)

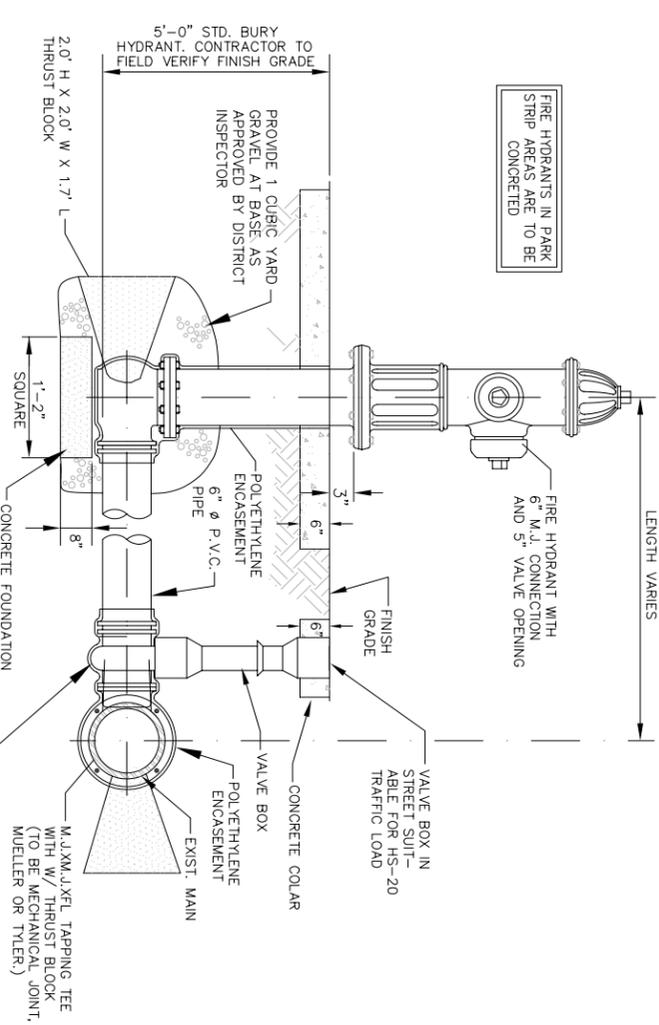

FIRE HYDRANT CONNECTION DETAIL
 TB-208
 N.T.S. (C)

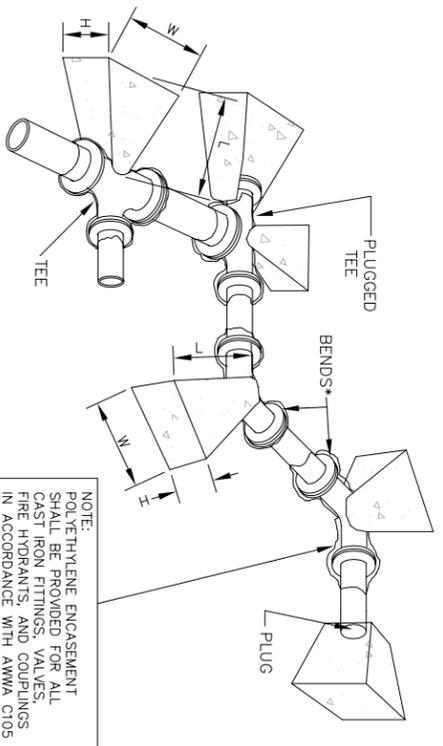

THRUST BLOCK SCHEDULE			
SOIL BEARING PRESSURE = 1,500 PSF			
TEST PRESSURE = 200 PSI			
FITTING	WIDTH	HEIGHT	LENGTH
8" 11.25' BEND	1.30'	1.30'	1.20'
8" 22.5' BEND	1.90'	1.90'	1.60'
8" 22.5' + 11.25' BEND	2.25'	2.25'	2.00'
8" 45' BEND	2.60'	2.60'	2.25'
8" 90' BEND	3.50'	3.50'	3.00'
8" TEE/DEAD	3.00'	3.00'	2.50'

THRUST BLOCKING
 TB-202
 N.T.S. (D)

This detail is prepared by the Design Professional as an instrument of service and shall remain the property of the Design Professional. The Design Professional shall retain all rights in this detail, including the copyright therein.



**DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
TAYLORSVILLE LIQUOR STORE**

- D. By beginning Work, Contractor accepts conditions and assumes responsibility for correcting unsuitable conditions encountered at no additional cost to the owner.

3.2 PREPARATION

- A. Prepare substrate for product installation in accordance with manufacturer's published instructions.
- B. Remove subfloor ridges, bumps, and other irregularities. Fill cracks, contraction joints, holes, and depressions with subfloor filler as recommended by manufacturer to achieve smooth, flat hard surface.
- C. Remove old adhesive, paint, oils, waxes, sealers and curing compounds not compatible with adhesive to be used. Avoid organic solvents.
- E. Vacuum clean substrate.

3.3 INSTALLATION

- A. General Installation:
 - 1. Install carpet in accordance with manufacturer's instruction.
 - 2. Install carpet tight and flat on subfloor, well fastened at edges, with a uniform appearance.
- B. Installation on Stairs:
 - 1. Install carpet on stairs with the run of the pile in opposite direction of anticipated traffic to avoid peaking of backing at nosings.

3.4 FIELD QUALITY CONTROL

- A. Section 01450 - Quality Control: Field inspection.
- B. Inspect carpet and base installation, seaming, pattern, layout, and attachment to substrate.

3.5 CLEANING AND PROTECTION

- A. Comply with CRI 104, Section 15 - Protection of Indoor Installation, and manufacturer's recommended cleaning procedures.
- B. Section 01700 - Execution Requirements: Cleaning and protection of installed work.
- C. Remove and dispose of debris and unusable scraps daily.
- D. Vacuum carpet using commercial machine with face-beater element. Remove spots, according to manufacturer's recommendations, and replace carpet where spots cannot be removed. Remove any protruding face yarn using sharp scissors.

END OF SECTION

**DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
TAYLORSVILLE LIQUOR STORE**

2.2 CARPET SQUARES

- A. Carpet:
1. Manufacturer: Shaw Contract Group.
 2. Style/Color: "Asteroid", number 59326 or as selected by owner.
 3. Size: 24" x 24".
 4. Construction: Loop.
 5. Dye Method: Solution and yarn dyed.
 6. Fiber Product: 55% ECO SOLUTION Q PREMIUM BRANDED NYLON – 45% YARN DYED BCF NYLON.
 7. Protective Treatments: antistatic, ssp Shaw soil protection, florsept antimicrobial.
 8. Primary Backing: Synthetic.
 9. Secondary Backing: Ecoworx.
 10. Gauge: 1/10.
 11. Face Weight: 24 oz.
 12. Stitches per inch: 09.83.
 13. Finished Pile Thickness: 0.099.
 14. Average Density: 8,727 ozs./yd.
 15. Flammability: ASTM E-648 flooring radiant panel class 1, ASTM E-662 NBS smoke chamber less than 450.
 16. Electrostatic Propensity: Less than 3.5 KV, permanent conductive filament.
 17. Warranty: Lifetime commercial limited warranty for Ecoworx tile backing system.
 18. Recommended Installation: Monolithic.
 19. Post Consumer Recycled Content: 0.
 20. Post Industrial Recycled Content: 37.4.
 21. Green Label Certification #: 59269968.
 22. Green Label Plus Certification #: GLP9968.

2.3 CARPET ACCESSORIES

- A. Adhesives: As recommended by carpet manufacturer.
- B. Metal Edge Strips: Extruded aluminum with mill finish of width shown, of height required to protect exposed edge of carpet. Use maximum lengths to minimize running joints.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Section 01700 - Execution Requirements: Verification of existing conditions before starting work.
- B. Verification of Conditions: Verify that field measurements, surfaces, substrates and conditions are as required, and ready to receive Work.
- C. Report in writing to Architect prevailing conditions that will adversely affect satisfactory execution of the Work of this Section. Do not proceed with Work until unsatisfactory conditions have been corrected.

**DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
TAYLORSVILLE LIQUOR STORE**

- C. Storage areas shall be secure and dry with temperatures maintained above 65 degrees F at all times.
- D. Remove carpet from its packaging and allow to acclimatize to area of installation 24 hours before application.

1.6 PROJECT CONDITIONS OR SITE CONDITIONS

- A. Environmental Requirements: Do not install carpet unless a constant temperature of at least 65 degrees F. is maintained for 72 hours before, during and 48 hours after application in all areas to receive carpeting.

1.7 WARRANTY

- A. Section 01700 - Closeout Submittals: Procedures for closeout submittals.
- B. Carpet Manufacturer's Warranty:
 - 1. Submit a written Warranty, signed by carpet manufacturer and carpet installer agreeing to repair or replace carpet that does not meet requirements or that fails in materials or workmanship, including, but not limited to, the following:
 - a. Delamination.
 - b. Static.
 - c. Edge ravel.
 - d. Wear.
 - e. Tuft bind.
 - 2. Warranty Period: 5 years.

1.8 MAINTENANCE

- A. Section 01700 - Closeout Submittals: Procedures for closeout submittals.
- B. Extra Materials: At completion of installation, deliver to contracting Officer.
 - 1. Usable pieces of excess of each color and pattern.
 - 2. Minimum Size: 24 inches x 24 inches.
 - 3. Securely wrapped and legibly labeled with type, color, and location installed.
- C. Maintenance Data: Maintenance procedures, recommended maintenance materials, and suggested schedule for cleaning.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. Subject to compliance with Project requirements, manufacturers offering Products which may be incorporated in the Work include the following:
 - 1. Shaw Contract Group.
- B. Section 01600 - Material and Equipment: Product options and substitutions. Substitutions: Not Permitted.

**DEPARTMENT OF ALCOHOLIC BEVERAGE CONTROL
TAYLORSVILLE LIQUOR STORE**

SECTION 09680 - CARPET

PART 1 GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Carpet.
 - 2. Accessories.
- B. Related Documents: The Contract Documents, as defined in Section 01010 - Summary of Work, apply to the Work of this Section. Additional requirements and information necessary to complete the Work of this Section may be found in other documents.

1.2 REFERENCES

- A. American Society for Testing and Materials (ASTM):
 - 1. ASTM E 648 - Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source.
- B. Carpet and Rug Institute (CRI):
 - 1. CRI 104 - Standard for Installation of Commercial Textile Floorcovering Materials.
- C. National Fire Protection Association (NFPA):
 - 1. NFPA 253 - Test for Critical Radiant Flux of Floor Covering Systems.
 - 2. NFPA 258 - Standard Research Test Method for Determining Smoke Generation of Solid Materials.

1.3 SUBMITTALS

- A. Section 01300 - Submittal Procedures: Procedures for submittals.
 - 1. Product Data: Data on specified products, describing physical characteristics and method of installation.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in installing work of this Section with minimum 5 years documented experience.
- B. Regulatory Requirements:
 - 1. NFPA 253 Critical Radiant Flux in Accordance with ASTM E 648: Class 1.
 - 2. NFPA 258 NBS Smoke Chamber: Less than 450 flaming mode.

1.5 DELIVERY, STORAGE AND HANDLING

- A. Section 01600 – Materials and Equipment: Transport, handle, store, and protect products.
- B. Deliver carpet in original mill wrappings with register number marked on each bale.