SHEET NOTES:

1. NEW 14x14 REFRIGERANT EXHAUST DUCT UP TO NEW EF-1 ON ROOF. SEE DETAIL C3/ME502. FIELD VERIFY EXACT ROUTING AND LOCATION PRIOR TO FABRICATION. COORDINATE WITH G.C. TO CUT AND PATCH ROOF FOR NEW FAN.
2. NEW 14x14 REFRIGERANT EXHAUST DUCT ROUTED DOWN TO MECHANICAL ROOM. TYPICAL 1ST AND 2ND FLOOR. FIELD VERIFY. COORDINATE WITH G.C. TO PROVIDE SHAFT ACCESS AT ALL LEVELS AS NECESSARY TO INSTALL NEW EXHAUST DUCT.

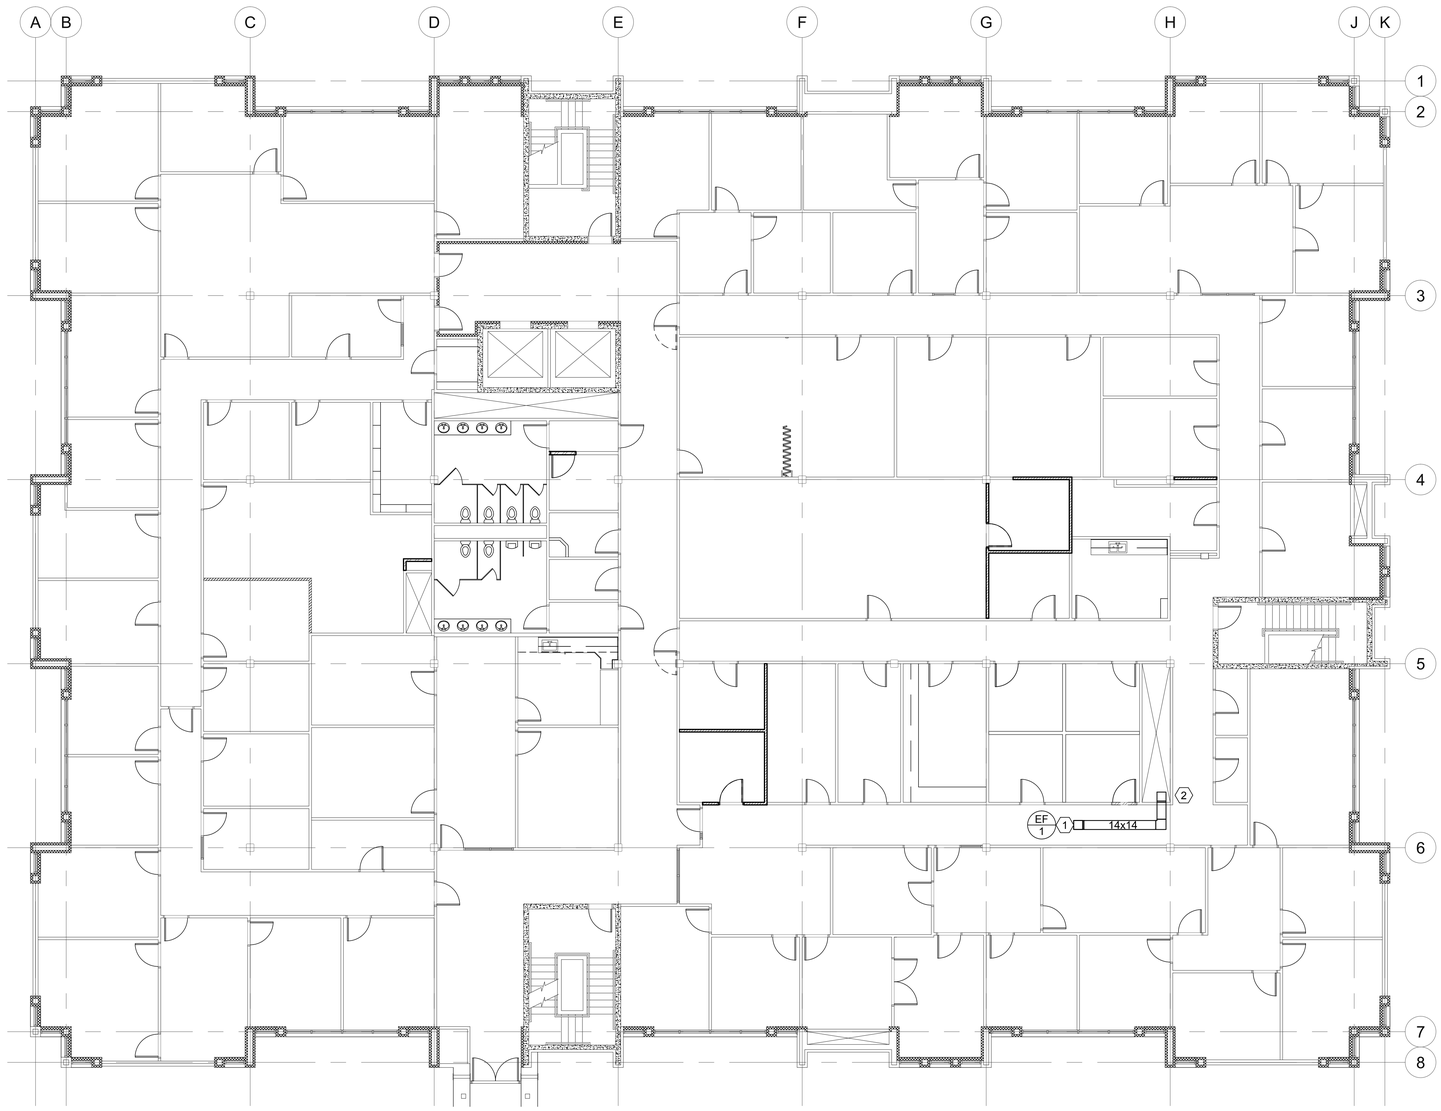


THIRD FLOOR MECHANICAL PLAN

SCALE: 1/8" = 1'-0"


HFSArchitects
ARCHITECTURE
INTERIORS
PLANNING
1484 South State Street
Salt Lake City, Utah 84115
801-596-0691/F: 596-0693
www.hfsa.com


CONSULTANT


WHW ENGINEERING INC.
PROFESSIONAL MECHANICAL ENGINEERING
1354 East 3300 South Suite 200
SALT LAKE CITY, UTAH 84106
(801)466-4021, FAX 466-8536
EMAIL: excellence@whw-engineering.com


DNR ADMIN. BLDG.
HVAC SYSTEM
RENOVATION
PHASE 2

Department of Natural Resources
1594 West North Temple
Salt Lake City, Utah 84114

| MARK | DATE | DESCRIPTION |
|---|---|---|
| | | |

| | |
|---|---|
| DATE: | 10 AUGUST 2009 |
| PROJECT NO: | 07183500 |
| HFSA PROJECT NO: | 0758.01 |
| CAD DWG FILE NO: | |
| DRAWN BY: | STAFF |
| CHECKED BY: | SW |
| DESIGNED BY: | WP |
| DWG TYPE: | MECHANICAL |
| ARCHITECTURAL PHASE: | CONSTRUCTION DOCUMENTS |

SHEET TITLE

THIRD FLOOR
MECHANICAL PLAN

ME101

SHEET 3 OF 8