



State of Utah

JON M. HUNTSMAN, JR.
Governor

GARY R. HERBERT
Lieutenant Governor

Department of Administrative Services

KIMBERLY K. HOOD
Executive Director

Division of Facilities Construction and Management

DAVID G. BUXTON
Director

ADDENDUM #2

Date: October 24, 2007

To: Contractors

From: Wayne Smith, Project Manager, DFCM

Reference: Cafeteria Rooftop Unit Replacement – Rampton Building
Department of Transportation – Taylorsville, Utah
DFCM Project No. 07237900

Subject: **Addendum No. 2**

Pages	Addendum	1	page
	<u>Engineers Addendum</u>	<u>3</u>	<u>pages</u>
	Total	4	pages

Note: This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to Disqualification.

- 1.1 **SCHEDULE CHANGES** – There are no changes to the Project Schedule.
- 1.2 **GENERAL** – WHW Engineering, Inc. – Changes/Clarifications to the drawings..

ADDENDUM

Project Name: Cal Rampton Rooftop Replacement

Addendum No.: 1

DFCM Project # 07237900

Date: 10-24-07

From: WHW Engineering Inc
1354 East 3300 South Suite 200
Salt Lake City, Utah 84106
Phone (80) 466-4021 Fax (801) 466-8536

To: All Bidders

This Addendum forms and becomes a part of the Contract Documents and modifies the original Bidding Documents dated September 2007 as noted below. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of 3 pages.

I - CHANGES TO PRIOR ADDENDA: NA

II - CHANGES TO BIDDING REQUIREMENTS: None

III - CHANGES TO AGREEMENT & OTHER CONTRACT FORMS: None

IV – CHANGES/CLARIFICATIONS TO CONDITIONS OF THE CONTRACT: None

V - CHANGES/CLARIFICATIONS TO SPECIFICATIONS:

Item V-1. Section 15732 – 1.5 add the following paragraph:
“1. Lead Time: Include equipment lead time in submittal data. Equipment with a lead time of greater than 18 weeks after receiving approved submittals will not be allowed.”

VI - CHANGES/CLARIFICATIONS TO DRAWINGS:

Item VI-1. Detail A2/ME601: The hot water piping from the roof to the coil, along with the coil connection will need to be made by this contractor. All sizes, duct locations, piping locations, etc. shall be field measured within 1 week of receiving a contract, prior to providing rooftop submittals. See attached hot water coil piping detail ME601A.

PRIOR APPROVALS

THE FOLLOWING ITEMS, AS SUBMITTED, ARE CONSIDERED, IN GENERAL AND IN NAME ONLY, AS EQUAL TO THOSE ITEMS SPECIFIED. THIS REVIEW DOES NOT RELIEVE THE CONTRACTOR OR SUPPLIER OF THE RESPONSIBILITY OF CONFORMING TO THE DRAWINGS AND SPECIFICATIONS, NOR DOES IT RELIEVE THE CONTRACTOR OF THE REQUIREMENTS OF THE SPECIFICATIONS FOR COORDINATION WITH OTHER TRADES. ALL DIMENSIONS SHALL BE CONFIRMED AND CORRELATED AT THE JOBSITE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING EXISTING CONDITIONS AND THE SUITABILITY OF “EQUAL” PRODUCTS FOR THE SPECIFIED APPLICATION.

Description

Manufacturer


15074 Vibration and Seismic

Vibration Eliminator

15732 – Packaged Central Station Outdoor Air Handling Unit

Seasons Four

END OF ADDENDUM

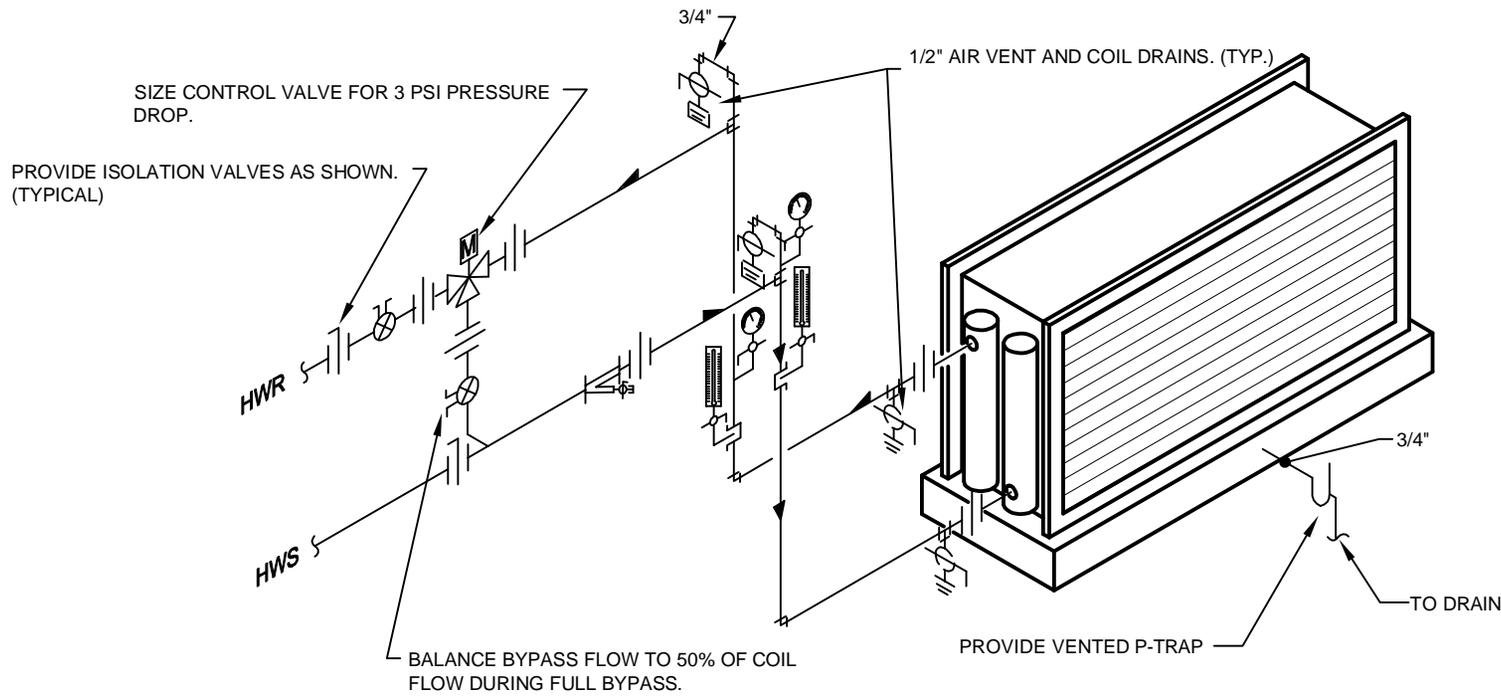

HW COIL PIPING DETAIL - ADDENDUM #1

SCALE: NONE

State of Utah
Department of Administrative Services



Division of Facilities
Construction & Management
4110 State Office Building
Salt Lake City, Utah 84114
Phone: (801) 538 - 3018
Fax: (801) 538 - 3267

Internet: <http://www.dfc.state.ut.us>



WHW
ENGINEERING INC.
PROFESSIONAL MECHANICAL ENGINEERING
1354 East 3300 South Suite 200
SALT LAKE CITY, UTAH 84106
(801) 468-4021, FAX 468-8536
EMAIL: excellence@whw-engineering.com

CAL RAMPTON
ROOFTOP
REPLACEMENT

DFCM# 07237900

ME-601A