



State of Utah

GARY R. HERBERT  
Governor

GREGORY S. BELL  
Lt. Governor

## Department of Administrative Services

KIMBERLY K. HOOD  
Executive Director

### Division of Facilities Construction and Management

DAVID G. BUXTON  
Director

# ADDENDUM NO. 2

Date: June 16, 2010

To: Short-Listed Contractors

From: Darrell Hunting - Project Manager

Reference: Recreation Rehabilitation Phase 1 – Starvation State Park  
Division of Parks and Recreation – Duchesne County, Utah  
DFCM Project No. 08085510

Subject: **Addendum No. 2**

Pages	Addendum Cover Sheet	3 pages
	<u>Drawing</u>	1 page
	Total	4 pages

**Note: This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to Disqualification.**

**While we contend that SB220 should only be potentially applicable to a contract issued after the effective date of said bill, this is to clarify that for purposes of this contract, regardless of the execution or effective dates of this contract, the status of Utah Law and remedies available to the State of Utah and DFCM, as it relates to any matter referred to or affected by said SB220, shall be the Utah law in effect at the time of the issuance of this Addendum.**

**2.1 SCHEDULE CHANGES:** There are no Project Schedule changes.


**2.2 GENERAL ITEMS:** Mandatory Site Meeting Minutes

- 2.2.1 Coordination is critical in closing the campground or day use area. Nothing can be closed prior to July 6, 2010. It is requested that we keep any areas open as long as possible, but the Contractor will have access to what ever areas they need to work in.
- 2.2.2 Contractor can camp on site. There will be no charge if they camp in the closed construction area. Camping outside construction area will be charged normal prices.
- 2.2.3 Contractor will be required to follow all reclamation safety standards.


- 2.2.4 A drawing left off issued drawings was handed out at the meeting and will be posted on project web site ASAP.
- 2.2.5 DFCM will check and see if there was a geotechnical survey performed and if this information is available to Contractors.
- 2.2.6 This project is taxable and should be bid as such.
- 2.2.7 The main road cannot be closed during the course of the project.
- 2.2.8 A seed mix needs to be determined for seeding of areas disturbed by construction activities.
- 2.2.9 The initial survey will be performed by the BOR.
- 2.2.10 The reservoir will drop approximately 12 feet by the end of September.
- 2.2.11 The curb will need to be removed at the bottom end of new loop road.
- 2.2.12 We need to determine the gradation on the sand.
- 2.2.13 Generally the beach campgrounds close around October 1 and other areas close around the end of October.
- 2.2.14 Boat parking is critical and there needs to be close coordination as to not close more boat parking that is absolutely necessary
- 2.2.15 The boat ramp will need to remain open for the duration of the project as it is the only developed ramp on the lake.
- 2.2.16 Contractors are required to provide portable restrooms.
- 2.2.17 DFCM needs to determine if there has been an asbestos survey on the restrooms. If there has not been one, we need to get one before demo starts.
- 2.2.18 Parks will remove picnic tables and any signs that they want to keep from the construction area.
- 2.2.19 Contractors should figure there is 3" of asphalt in areas to be ground.
- 2.2.20 Hard hats and safety vests, long pants and shirts are required for all employees working on site.
- 2.2.21 Contractor is to coordinate with Moon Lake Electric any needed upgrades and connections. Contractor will not be responsible for Moon Lake charges for required upgrades.
- 2.2.22 Campground power pedestal details are shown on the electrical details page.

- 2.2.23 Location of main power connection needs to be verified.
- 2.2.24 The electrical requirements in the day use restroom need to be verified. Does not appear that the drawings indicate this.
- 2.2.25 Is the day use restroom elevation changing? It appears to be in a hole.
- 2.2.26 It needs to be determined if the water heaters will be propane or electric. State Parks prefers propane. If it is determined that water heaters will be propane, then propane will need to remain on site.


ALWAYS THINK SAFETY  
U.S. DEPARTMENT OF THE INTERIOR  
BUREAU OF RECLAMATION  
CENTRAL UTAH PROJECT  
BONNEVILLE UNIT - UTAH  
**STARVATION STATE PARK**  
RECREATION REHABILITATION - PHASE I  
ACCESSIBLE WALKWAY - PLAN AND PROFILE

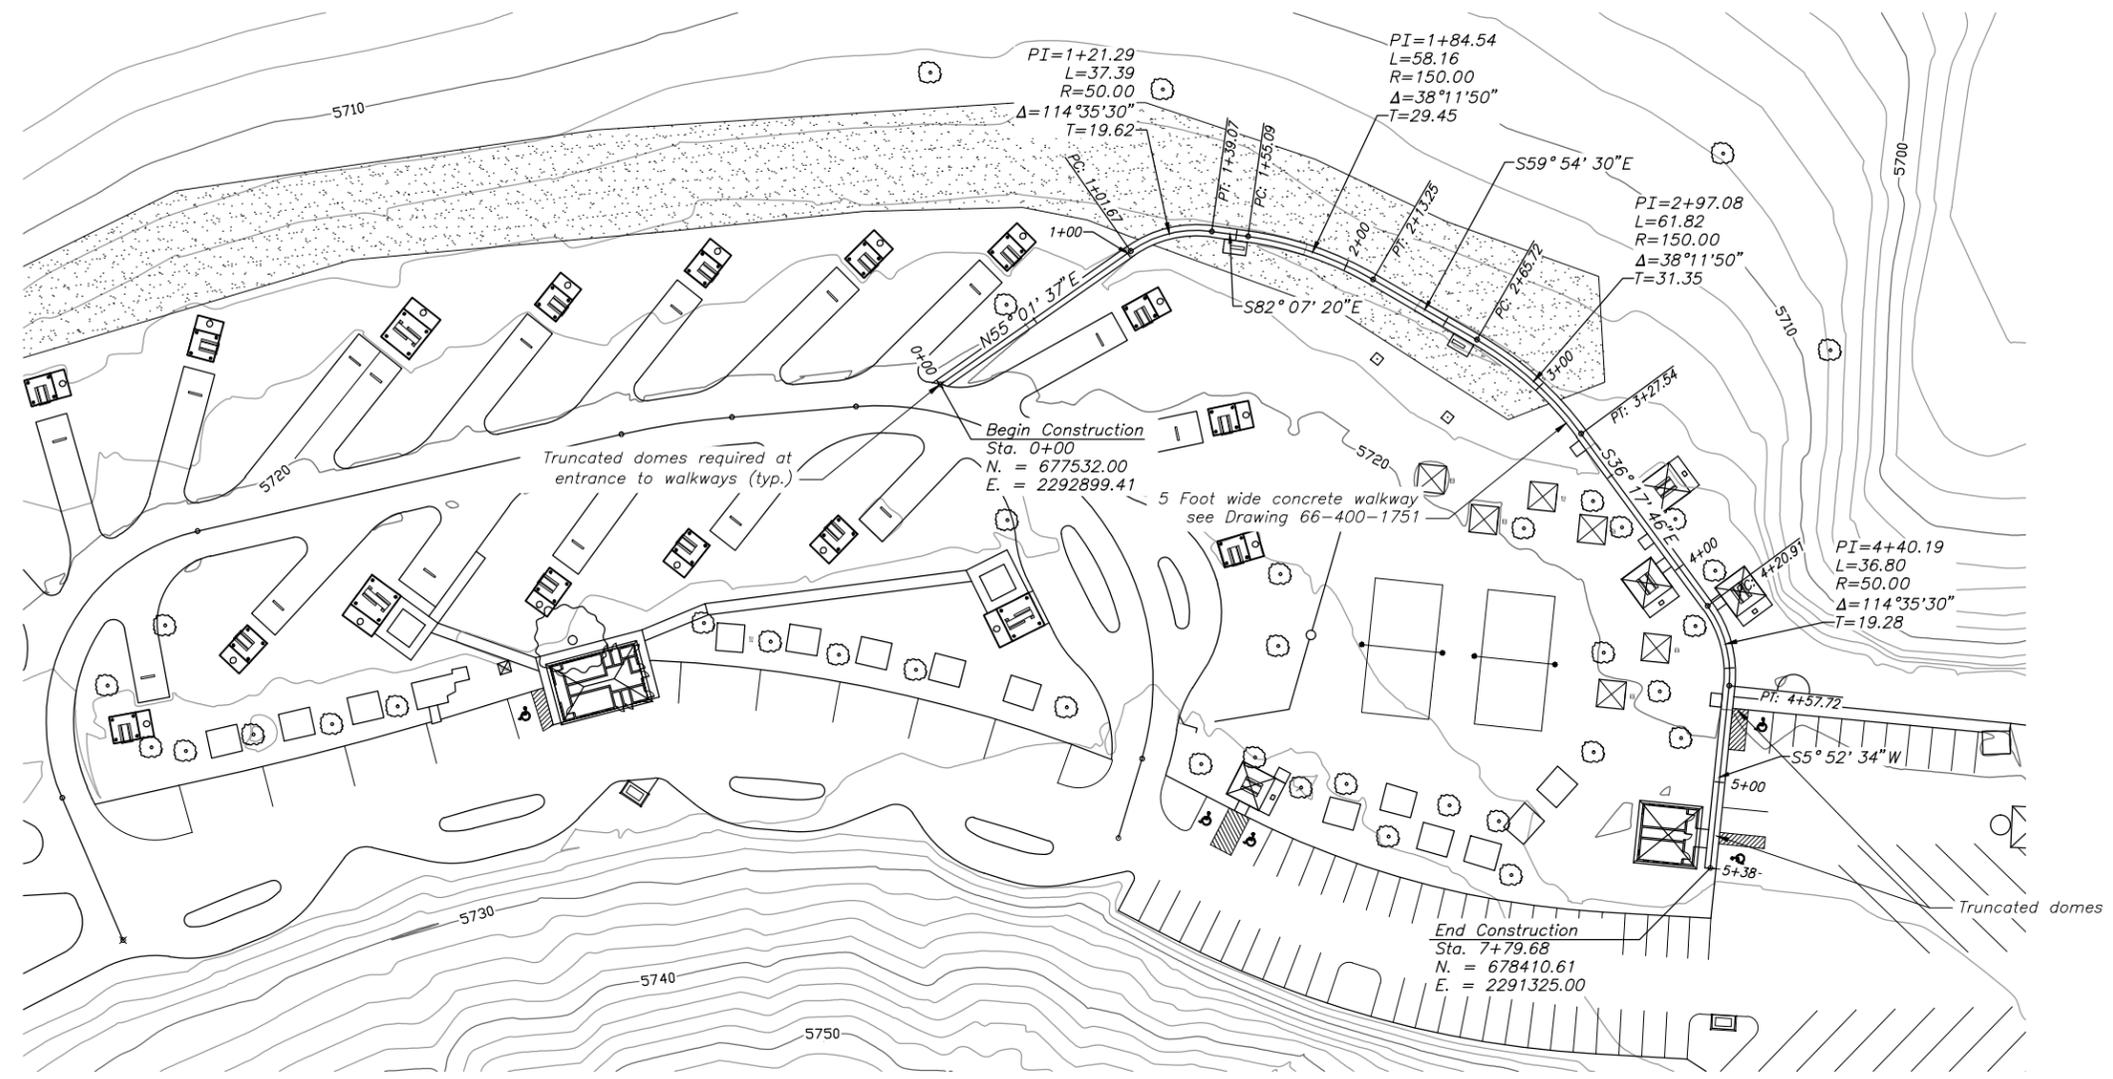

PLAN

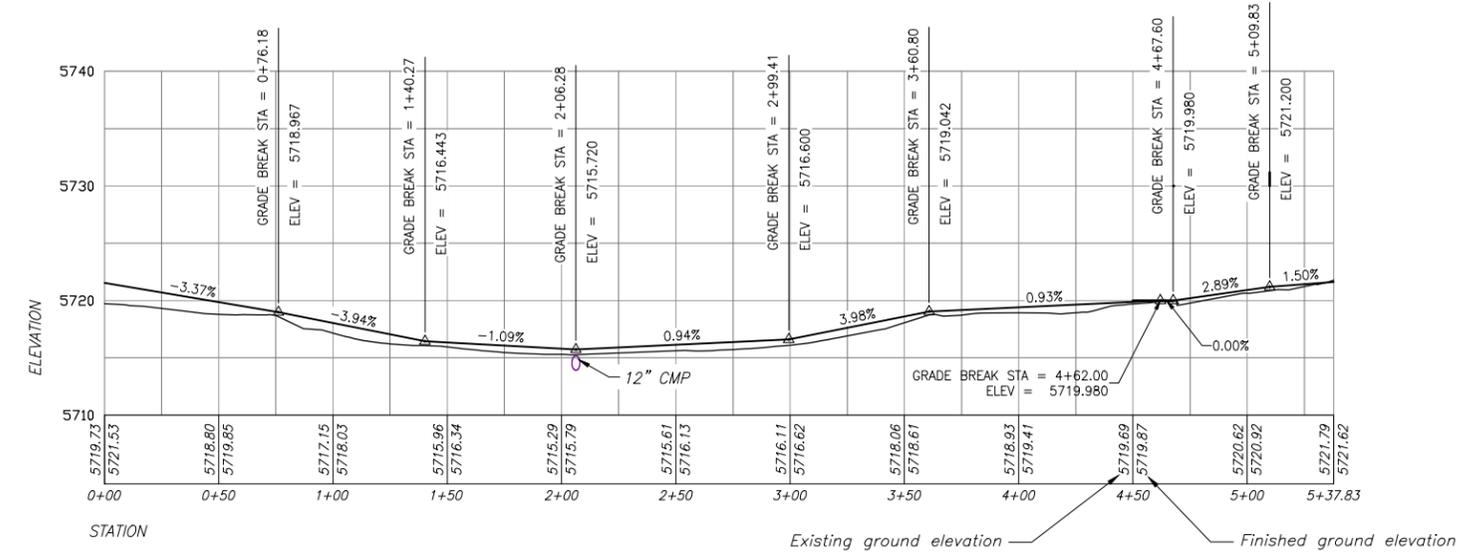

PROFILE



DATE AND TIME PLOTTED  
JUNE 14, 2010 08:43  
PLOTTED BY  
JBYTHEWAY

CAD SYSTEM  
AutoCAD Rev. 18.1s  
CAD FILENAME  
GENERAL\_3.DWG

DESIGNED  
DRAWN  
CHECKED  
TECH. APPR. JAY BYTHEWAY-P.E.  
ADMIN. APPROVAL  
MANAGER T.S.D.