



State of Utah

GARY R. HERBERT
Governor

GREGORY S. BELL
Lieutenant Governor

Department of Administrative Services

KIMBERLY K. HOOD
Executive Director

Division of Facilities Construction and Management

DAVID G. BUXTON
Director

ADDENDUM #1

Date: March 18, 2010

To: Contractors

From: Tim Parkinson, Project Manager, DFCM

Reference: Lind Lecture Hall Seating Remodel
Weber State University – Ogden, Utah
Project No.09062810

Subject: **Addendum No. 1**

Pages	Addendum	1 page
	<u>Architects Addendum</u>	<u>3 pages</u>
	Total	4 pages

Note: *This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to Disqualification.*

While we contend that SB220 should only be potentially applicable to a contract issued after the effective date of said bill, this is to clarify that for purposes of this contract, regardless of the execution or effective dates of this contract, the status of Utah Law and remedies available to the State of Utah and DFCM, as it relates to any matter referred to or affected by said SB220, shall be the Utah law in effect at the time of the issuance of this Addendum.

1.1 **SCHEDULE CHANGES** – There are no changes to the project schedule.

1.2 **GENERAL** – Richards Bott Architects, Please see attached documents.

Utah!
Where ideas connect

addendum #1

date: 03.16.10

project name: WSU - Lind Lecture Hall Seating Remodel
project designation: 0924

This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated 10.03.09 as noted below. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of 2 pages and attached drawing add1.1.

I - Changes to prior addenda: none

II - Changes to bidding requirements: none

III - Changes to agreement & other contract forms: none

IV - Changes to conditions of the contract: none

V - Changes to specifications:

Item V-1. section 06 4023 2.4 Interior Architectural Woodwork: The plastic laminate selection for the desktops shall be "Wilsonart 4810-60 Titanium EV".

Item V-2. section 06 4023 1.5 Interior Architectural Woodwork: Delete section 06 4023 1.5 B 1 from the specifications.

VI - Changes to drawings:

Item VI-1. sheet a1.1, a1.2, a1.3: Modify general note "F" to read as follows:
"All existing cast metal brackets, existing steel rails and associated hardware to remain in place shall be prepared and field painted (re: specifications)".

Item VI-2. detail a/a1.15: Modify keyed note "6" and add keyed note "23" to clarify the existing cast bottom brackets to be reused (re: attached drawing add1.1). The existing threaded cast metal bottom brackets removed from the bottom of the existing tablet arm desk brackets shall be reused at the new cast metal desk brackets. There will be surplus threaded bottom brackets that will not need to be reused. The existing non-threaded cast metal bottom brackets removed from the bottom of the existing chairs shall be reused as required at the existing riser brackets where an existing chair or tablet arm desk bracket was previously located. There will be surplus non-threaded bottom brackets that will not need to be reused. All of the existing bottom brackets that are reused shall be prepared and powdercoated as per the specifications.

addendum #1

VII - General Items:

Item VII-1. (responses to bidder questions):

Question

Regarding building the sample desk, the bid documents state not to proceed with the remainder of the work until approval is granted. Can demolition work continue while waiting for sample desk approval?

Answer:

Demolition may continue while awaiting approval of the desk mockup.

Question:

Regarding construction of the new desk top, both weight and the ability to get through doors is a consideration. Is a splice in the desk top acceptable or do you require a continuous top?

Answer:

The desktops may be spliced as required for construction but the splices must occur directly over the sheet metal privacy panel splices and centered over the cast metal brackets as indicated on detail a/a1.15 with keyed note "12".

Question:

The specification is asking for AWI QCP certified millwork with labels and certifications. Will you accept non-certified shops? Will you allow shops that are members of AWI and build to the AWI specs, but are not AWI Quality Control Program Certified?


Answer:

Non-AWI certified millwork shops will not be allowed for this project. However, it has been decided that the requirement to provide AWI QCP labels as set forth in specification section 06 4023 1.5 B 1 will be deleted.

end of addendum

keyed notes

- 6 Existing threaded cast metal bottom bracket salvaged from bottom of tablet arm desk bracket during demolition.
- 23 Existing non-threaded cast metal bottom bracket salvaged from bottom of chair bracket during demolition.

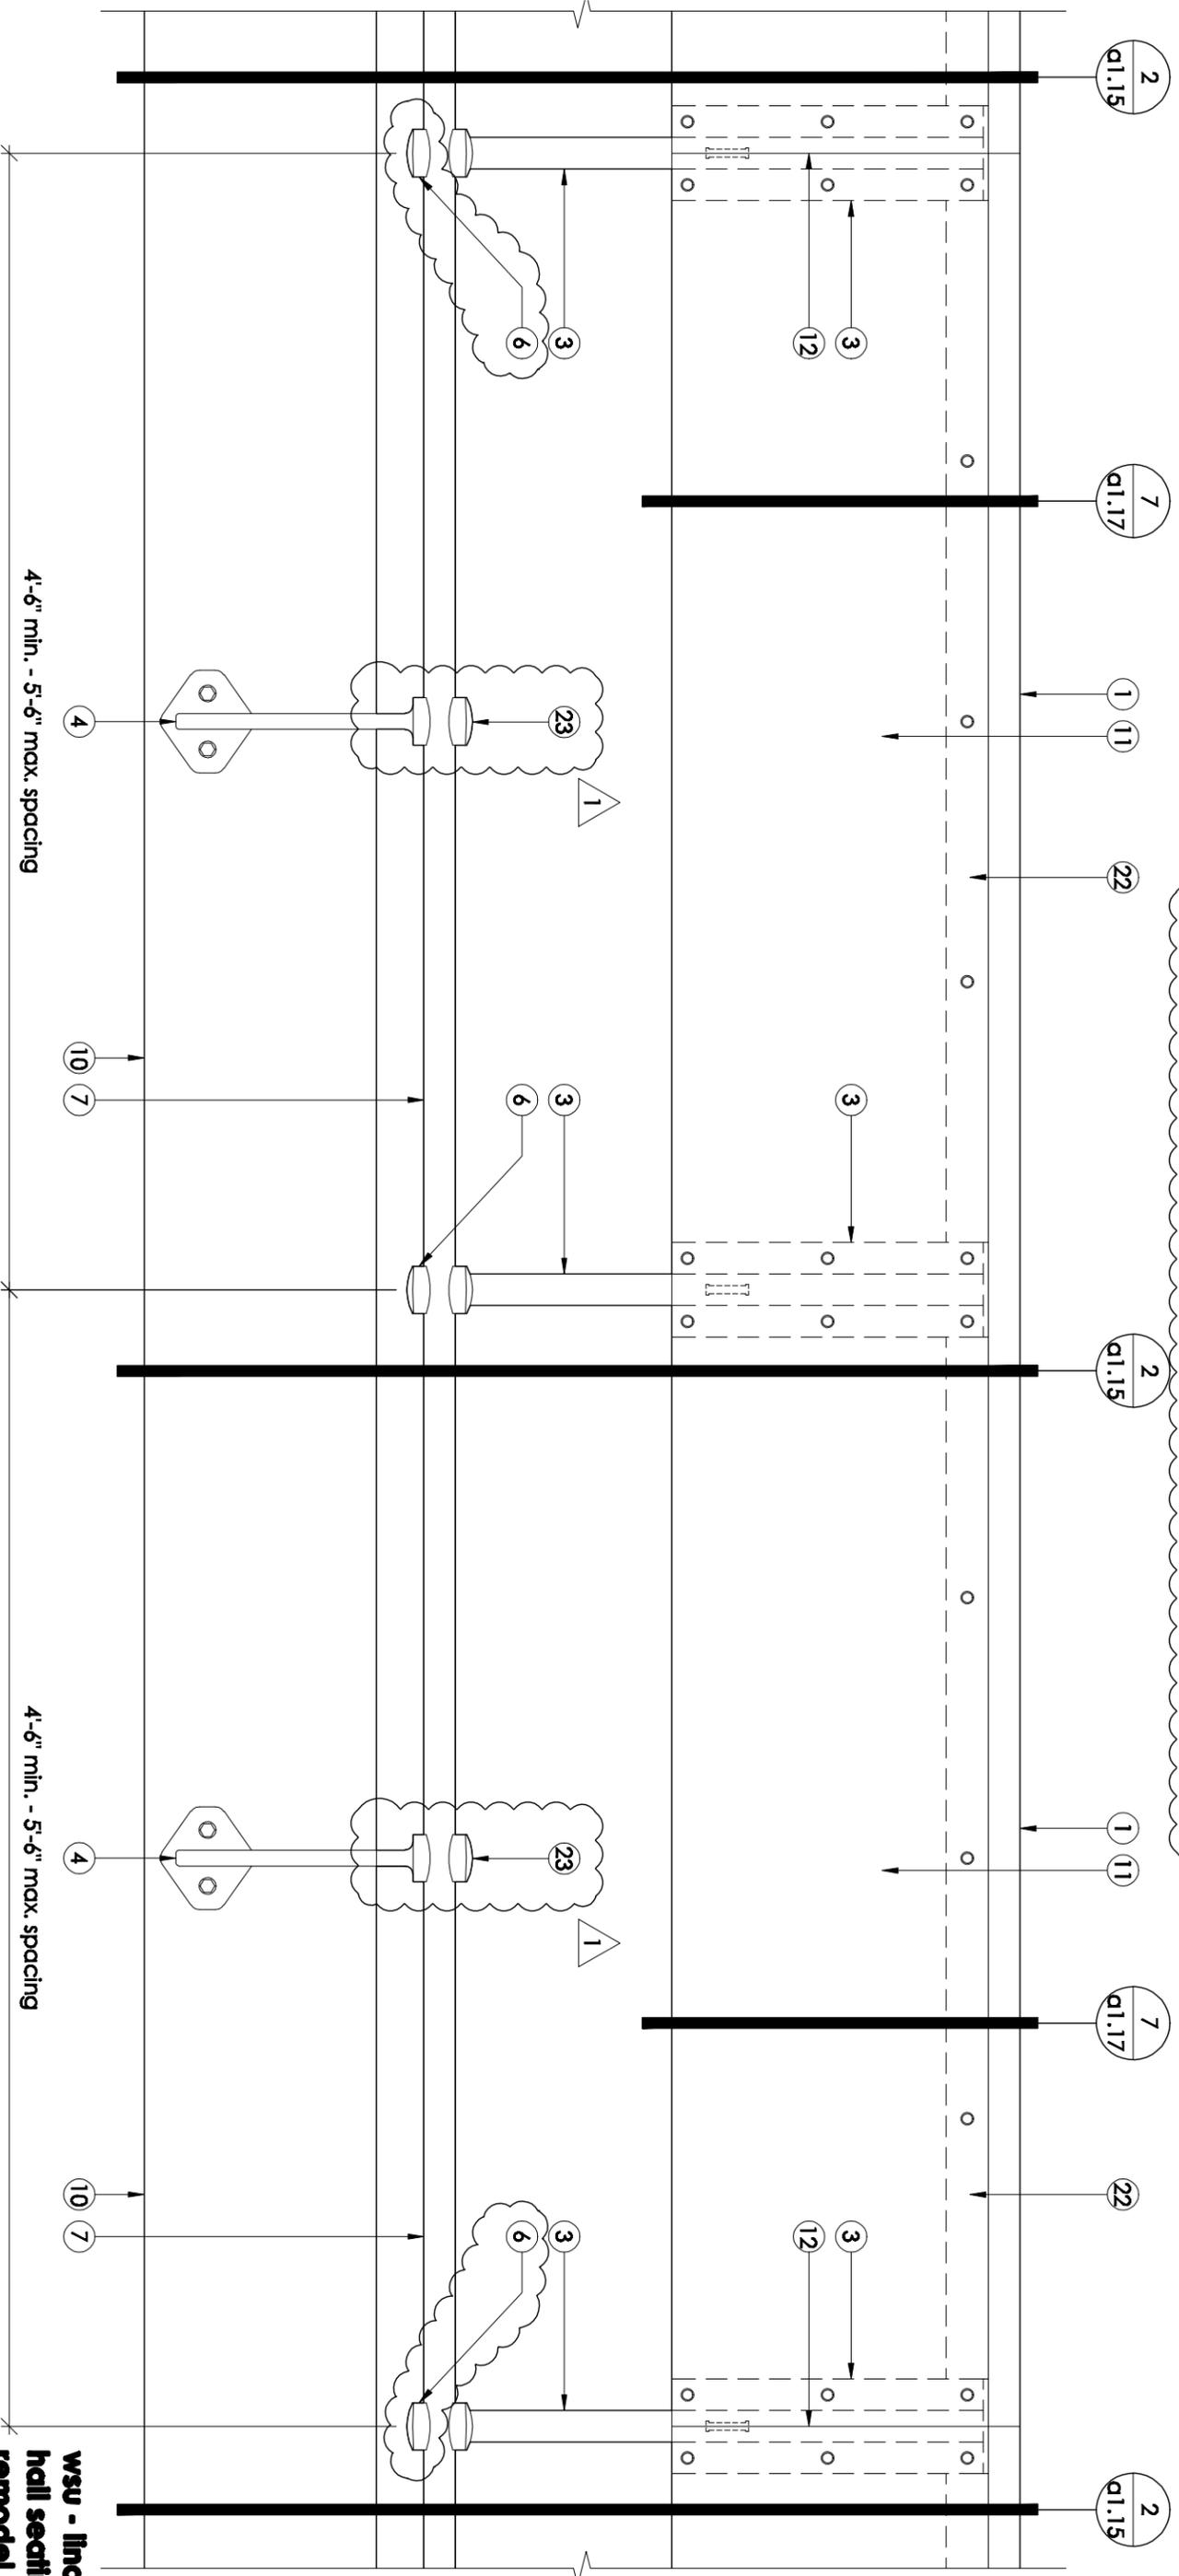

typ. elevation @ desk

scale: 1 1/2" = 1'-0"