



State of Utah

GARY R. HERBERT
Governor

GREGORY S. BELL
Lt. Governor

Department of Administrative Services

KIMBERLY K. HOOD
Executive Director

Division of Facilities Construction and Management

DAVID G. BUXTON
Director

ADDENDUM NO. 1

Date: March 25, 2010

To: Contractors

From: Wayne Smith - Project Manager

Reference: Probation Office ADA Ramp Reconstruction – West Valley Juvenile Courts
Administrative Office of the Courts – West Valley City, Utah
DFCM Project No. 09203150

Subject: **Addendum No. 1**

Pages	Addendum Cover Sheet	1 page
	<u>Engineer's Addendum</u>	2 pages
	Total	3 pages

Note: This Addendum shall be included as part of the Contract Documents. Items in this Addendum apply to all drawings and specification sections whether referenced or not involving the portion of the work added, deleted, modified, or otherwise addressed in the Addendum. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to Disqualification.

While we contend that SB220 should only be potentially applicable to a contract issued after the effective date of said bill, this is to clarify that for purposes of this contract, regardless of the execution or effective dates of this contract, the status of Utah Law and remedies available to the State of Utah and DFCM, as it relates to any matter referred to or affected by said SB220, shall be the Utah law in effect at the time of the issuance of this Addendum.

1.1 **SCHEDULE CHANGES:** No Project Schedule changes.

1.2 **GENERAL ITEMS:** See attached Engineer's Addendum dated March 25, 2010.



Structural
Engineering Inc.

442 NORTH MAIN STREET
SUITE 200 BOUNTIFUL, UTAH 84010
OFFICE 801-298-1118 FAX 801-298-1122
email – ken.willmore@wcaeng.com

Addendum

Date: March 25, 2010

Project: West Valley Juvenile Courts Probation Office ADA Ramp Reconstruction

DFCM Project Number: 09203150

Sheet GE100: Under Approved materials

Hand and Guardrail painting:

1. Existing hand and guardrail and post shall be primed and painted after removal of chips and flakes of existing paint.
2. New steel hand and guardrail and post shall have all oil and grease removed from surface before priming and painting.
3. Product: Sherwin Williams or equal Semi-Gloss Dry Film thickness Mils
 - Solvent: SSPC-SP1 solvent cleaning 2.5
or SSPC-SP6 Commercial Blast cleaning
 - Primer: DTM Acrylic primer/finish 2.5-5.0
 - Paint: DTM Acrylic coating 2.5-4.0

Epoxy Coated Rebar: ASTM A775/A775M-07b

Sheets SD101 and SE101:


1. Pedestrian Barriers will be required around all work areas. Barriers shall provide a 5' space between the work area and the barrier location.

Note: Barriers will also be required at alternate's #1, 2, and 3. See plan for proposed Base Bid Area.

2. Temporary Handicap Ramp: See attached plan.

Temporary ramps shall be 36" wide with approximate 5' x 6' and 5' x 5' landings. Maximum rise to run 1" in 12". Handrails to meet 50plf loading in any direction. Ramps and landings live Load = 100psf.

Kenneth P. Willmore, SE
WCA Structural Engineering, Inc.

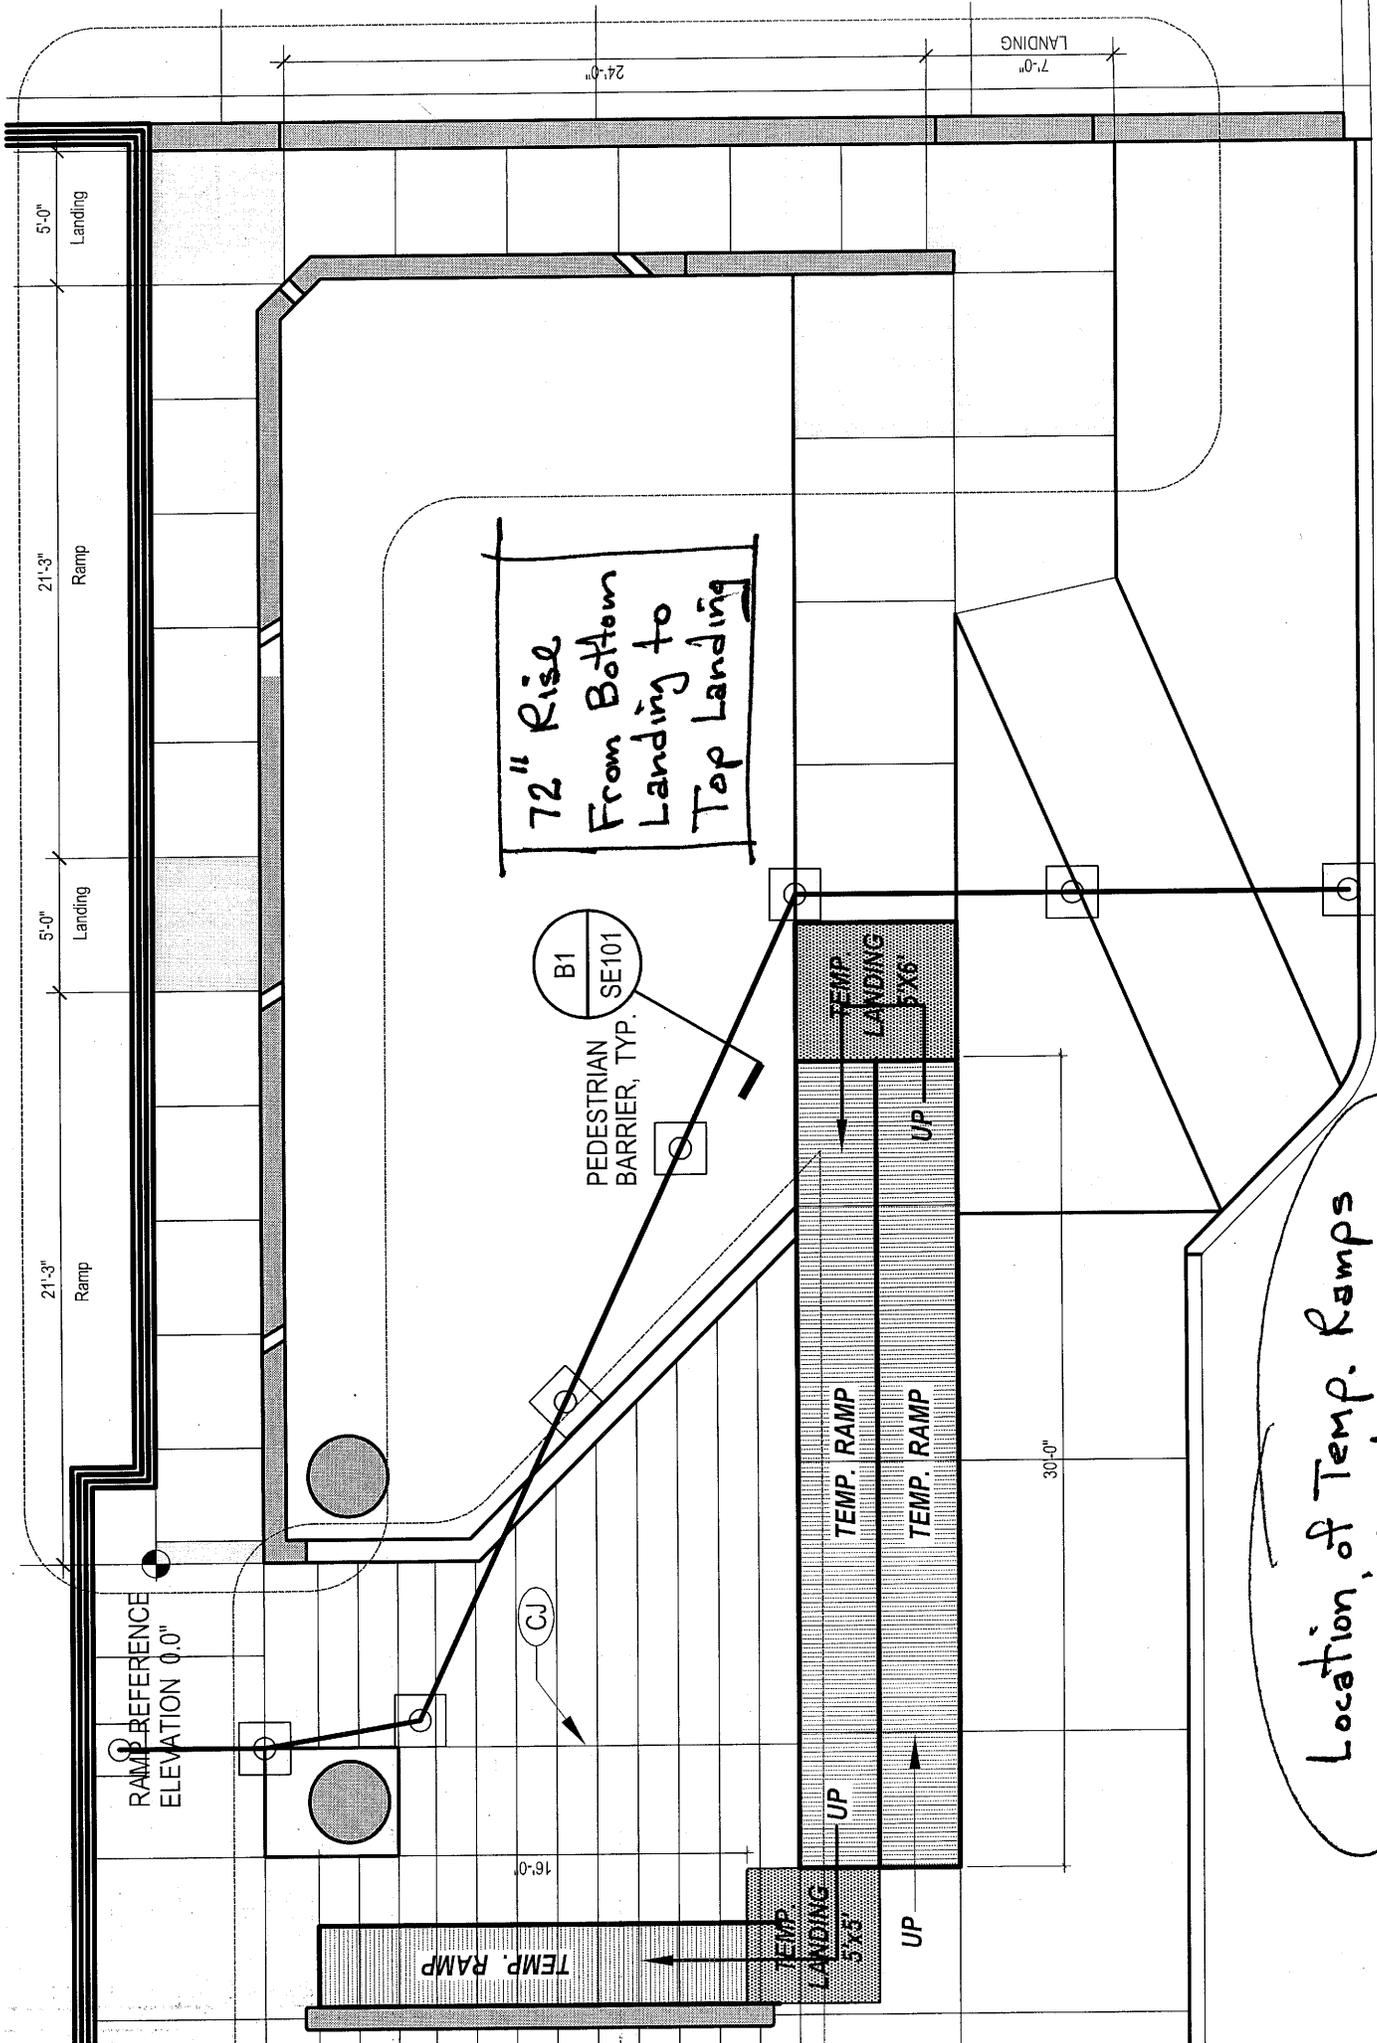

72" Rise
From Bottom
Landing to
Top Landing

B1
PEDESTRIAN
BARRIER, TYP.
SE101

RAMP REFERENCE
ELEVATION 0.0'

Location of Temp. Ramps
& Landings

5'-0"
Landing

21'-3"
Ramp

5'-0"
Landing

21'-3"
Ramp

24'-0"

7'-0"
LANDING

30'-0"

16'-0"

TEMP. RAMP

TEMP. RAMP

TEMP. RAMP

TEMP. LANDING 5'6"

TEMP. LANDING 5'6"

UP

UP

UP

UP

UP

CJ